

Atlanta Public Schools/ Mays Cluster

Cascade Elementary School

Revised

School Assessment Report

November 10, 2020



Table of Contents

School Executive Summary	4
School Dashboard Summary	6
School Condition Summary	7
<u>1994_Bldg 2010</u>	9
Executive Summary	9
Dashboard Summary	10
Condition Summary	11
Photo Album	12
Condition Detail	14
System Listing	15
System Notes	18
Renewal Schedule	30
Forecasted Sustainment Requirement	33
Condition Index Forecast by Investment Scenario	34
Deficiency Summary By System	35
Deficiency Summary By Priority	36
Deficiency By Priority Investment	37
Deficiency Summary By Category	38
Deficiency Details By Priority	39
<u>Site</u>	44
Executive Summary	44
Dashboard Summary	45
Condition Summary	46
Photo Album	47
Condition Detail	48
System Listing	49
System Notes	50
Renewal Schedule	54
Forecasted Sustainment Requirement	55

School Assessment Report

Condition Index Forecast by Investment Scenario	56
Deficiency Summary By System	57
Deficiency Summary By Priority	58
Deficiency By Priority Investment	59
Deficiency Summary By Category	60
Deficiency Details By Priority	61
Glossary	62

School Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as $100 - \text{Total FCI}$ (without the %) where 100 is best and 0 is worst condition.

Gross Area (SF):	70,101
Year Built:	1994
Last Renovation:	
Replacement Value:	\$14,330,465
Repair Cost:	\$2,811,987.00
Total FCI:	19.62 %
Total RSLI:	38.89 %
FCA Score:	80.38



Description:

Cascade Elementary School is located at 2326 Venetian Drive in Atlanta, Georgia . The school campus and site are well maintained in good overall condition. The one story, 70,101 square foot building was originally constructed in 1994.

This report contains condition and adequacy data collected during the 2019 Facility Condition Assessment (FCA) Update. Detailed condition and deficiency statements are contained in this report for the site and building elements.

A. SUBSTRUCTURE

The building rests on slab-on grade and is assumed to have standard cast-in-place concrete foundations. The building does not have a basement.

B. SUPERSTRUCTURE

Roof construction is steel. The exterior envelope is composed of walls of brick veneer over CMU. Exterior windows are double pane aluminum frame with fixed panes. Exterior doors are hollow metal steel mostly with glazing. Roofing is a custom designed spline single

School Assessment Report - Cascade Elementary School

-ply roof. Roof openings include skylights and rest room vents. Most building entrances appear to comply with ADA requirements.

C. INTERIORS

Interior partitions are typically CMU. Interior doors are generally solid core wood with hollow steel frames and mostly with glazing. Interior fittings include the following items: white boards, graphics and identifying devices, toilet accessories, storage shelving, handrails, fabricated toilet partitions. The interior wall finishes are typically painted CMU. Floor finishes in common areas are typically terrazzo tile. Floor finishes in assignable spaces is typically vinyl composition tile. Ceiling finishes in common areas are typically suspended acoustical tile. Ceiling finishes in assignable areas are typically suspended acoustical tile.

D. SERVICES

CONVEYING: The building does not include conveying equipment. Conveying equipment includes no hydraulic elevators, and no wheelchair lifts.

PLUMBING: Plumbing fixtures are typically low-flow water fixtures with manual control valves. Domestic water distribution is copper with electric and gas hot water heating. Sanitary waste system is cast iron. Rainwater drainage system is external and internal with gutters and roof drains.

HVAC: Heating is provided by gas fired boilers. Cooling is supplied by air cooled chiller systems. The heating/cooling distribution system is a ductwork system utilizing air handling units. Ceiling mounted exhaust fans are installed in bathrooms and other required areas. Controls and instrumentation are digital and are centrally controlled by an energy management system. This building has a remote Building Automation System.

FIRE PROTECTION: The building does have a fire sprinkler system. The building does not have additional fire suppression systems, which include an additional fire protection system in the kitchen for the hood. Fire extinguishers and cabinets are distributed near fire exits and corridors.

ELECTRICAL: The main electrical service is fed from a pad mounted transformer to the main 2000-AMP switchboard/distribution panel located in the building. Lighting is lay-in type, fluorescent light fixtures. Branch circuit wiring is typically copper serving electrical switches and receptacles. Emergency and life safety egress lighting systems are installed and exit signs are present at exit doors and near stairways and are typically illuminated.

COMMUNICATIONS AND SECURITY: The fire alarm system consists of audible/visual strobe annunciators in all common spaces. The system is activated by manual pull stations and smoke detectors and the system is centrally monitored. The telephone and data systems are segregated and include dedicated equipment closets. This building does have a local area network (LAN). The building includes an internal security system that is actuated by the following items: contacts, optical or a combination of all devices. The building has controlled entry doors access provided by card readers; entry doors are secured with magnetic door locks. The security system has CCTV cameras and is centrally monitored; this building has a public address and paging system combined with the telephone system.

OTHER ELECTRICAL SYSTEMS: This building does not have a separately derived emergency power system. There is no natural gas emergency generator.

E. EQUIPMENT & FURNISHINGS

This building includes the following items and equipment: fixed food service, library equipment, audio-visual, fixed casework, window treatment.

G. SITE

Campus site features include paved driveways and parking lots, pedestrian pavement, flagpole, landscaping, play areas, and fencing. Site mechanical and electrical features include water, sewer, propane, natural gas, and site lighting.

CODE REVIEW

ACCESSIBILITY: The building is generally in compliance with applicable ADA requirements with respect to path of travel, interior and exterior doors, interior signage, and toilet room dimensions, fixtures, and fittings. Most building entrances appear to comply with ADA requirements.

Attributes:

General Attributes:


Arch Condition Assessor:	Homero Guerrero	MEP Condition Assessor:	Hayden Collins
School Grades:	01, 02, 03, 04, 05, KK, PK	DOE Drawing Total GSF:	70286
DOE Facility Number:	1629	Total # of Modular/Portables:	0
DOE Interior Site SF:	70101	Total GSF of Modular/Portables:	0
Approx. Acres:	10	Status:	Active

School Dashboard Summary


Gross Area: 70,101
 Year Built: 1994
 Repair Cost: \$2,811,987
 FCI: 19.62 %

Last Renovation:
 Replacement Value: \$14,330,465
 RSLI%: 38.89 %


Deficiency By Category

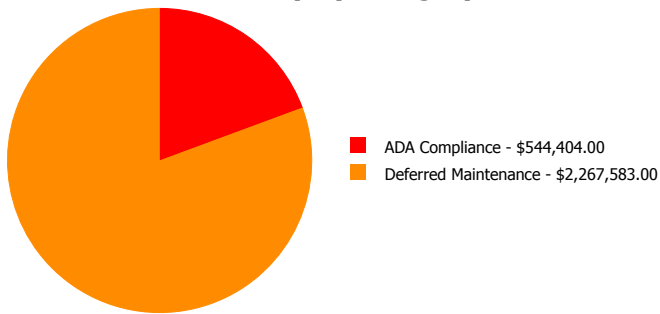


Deficiency By Priority

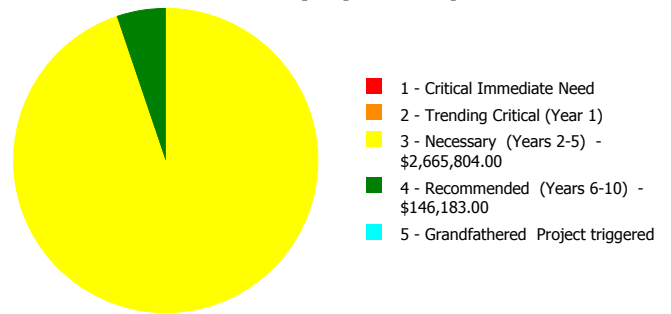

Deficiency By System

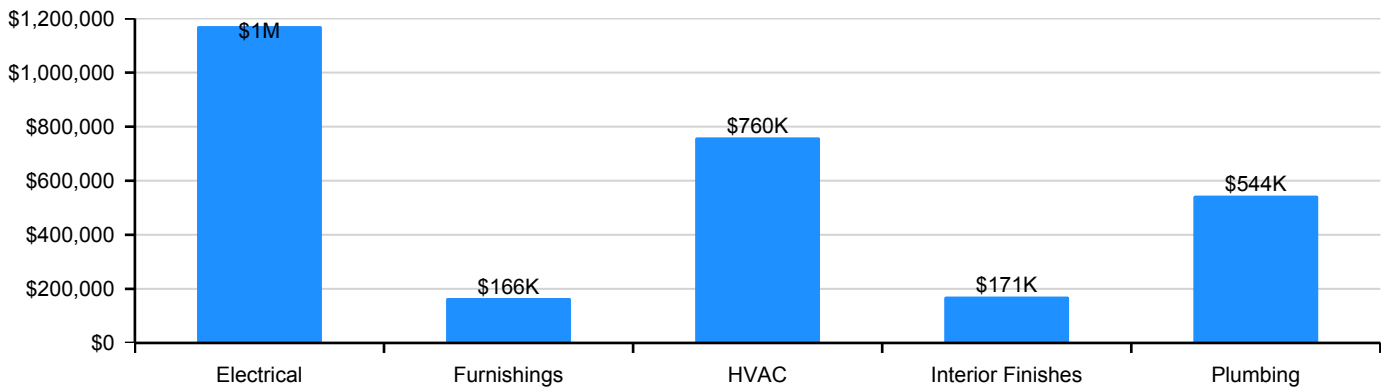

10 Year Investment Forecast

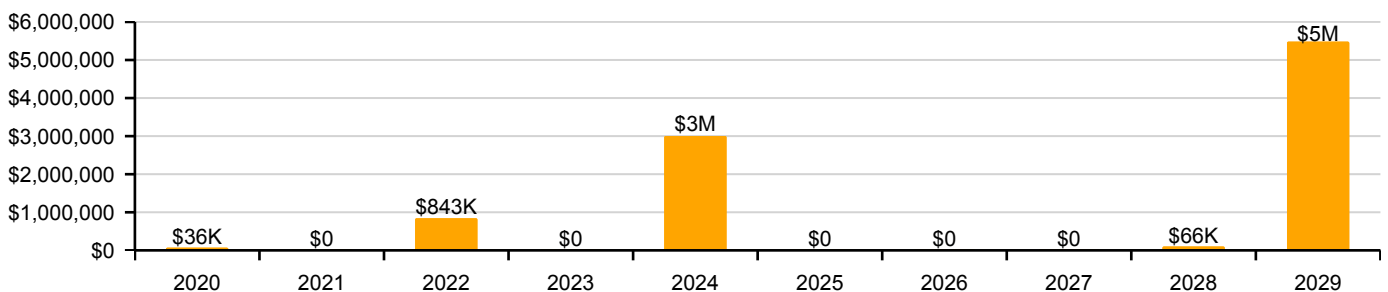

School Condition Summary

The Table below shows the RSLI and FCI for each major system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.


Current Investment Requirement and Condition by Unifomat Classification

UNIFORMAT Classification	RSLI%	FCI %	Current Repair
A10 - Foundations	75.00 %	0.00 %	\$0.00
B10 - Superstructure	75.00 %	0.00 %	\$0.00
B20 - Exterior Enclosure	51.27 %	0.00 %	\$0.00
B30 - Roofing	52.25 %	0.00 %	\$0.00
C10 - Interior Construction	57.92 %	0.00 %	\$0.00
C20 - Stairs	75.00 %	0.00 %	\$0.00
C30 - Interior Finishes	29.54 %	9.84 %	\$170,933.00
D20 - Plumbing	4.60 %	76.21 %	\$544,404.00
D30 - HVAC	34.48 %	32.78 %	\$759,544.00
D40 - Fire Protection	24.87 %	0.00 %	\$0.00
D50 - Electrical	18.53 %	72.65 %	\$1,171,317.00
E10 - Equipment	50.00 %	0.00 %	\$0.00
E20 - Furnishings	0.00 %	110.00 %	\$165,789.00
G20 - Site Improvements	25.32 %	0.00 %	\$0.00
G30 - Site Mechanical Utilities	50.00 %	0.00 %	\$0.00
G40 - Site Electrical Utilities	16.67 %	0.00 %	\$0.00
Totals:	38.89 %	19.62 %	\$2,811,987.00

Condition Deficiency Priority

Facility Name	Gross Area (S.F.)	FCI %	1 - Critical Immediate Need	2 - Trending Critical (Year 1)	3 - Necessary (Years 2-5)	4 - Recommended (Years 6-10)	5 - Grandfathered Project triggered
1994_Bldg 2010	70,101	23.08	\$0.00	\$0.00	\$2,665,804.00	\$146,183.00	\$0.00
Site	70,101	0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Total:		19.62	\$0.00	\$0.00	\$2,665,804.00	\$146,183.00	\$0.00

Deficiencies By Priority

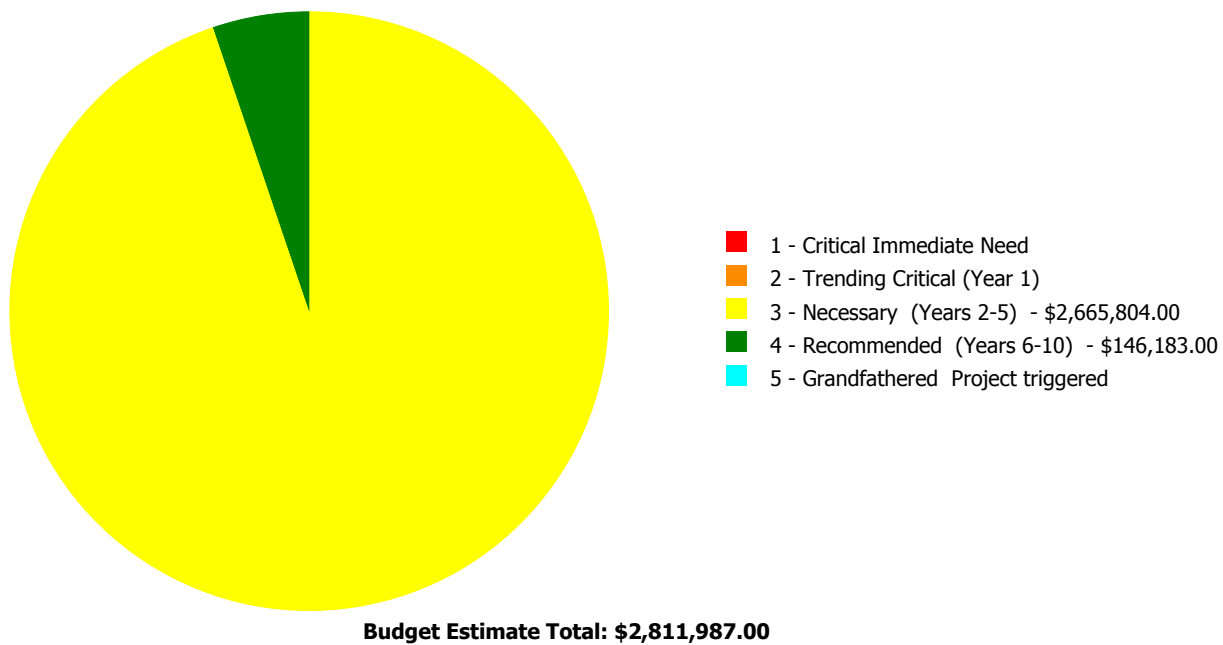

Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as $100 - \text{Total FCI}$ (without the %) where 100 is best and 0 is worst condition.

Function:	Elementary
Gross Area (SF):	70,101
Year Built:	1994
Last Renovation:	2009
Replacement Value:	\$12,181,170
Repair Cost:	\$2,811,987.00
Total FCI:	23.08 %
Total RSLI:	40.98 %
FCA Score:	76.92



Description:


The narrative for this building is included in the Executive Summary Description at the front of this report.

Attributes: This asset has no attributes.


Dashboard Summary

Function:	Elementary	Gross Area:	70,101
Year Built:	1994	Last Renovation:	2009
Repair Cost:	\$2,811,987	Replacement Value:	\$12,181,170
FCI:	23.08 %	RSLI%:	40.98 %


Deficiency By Category

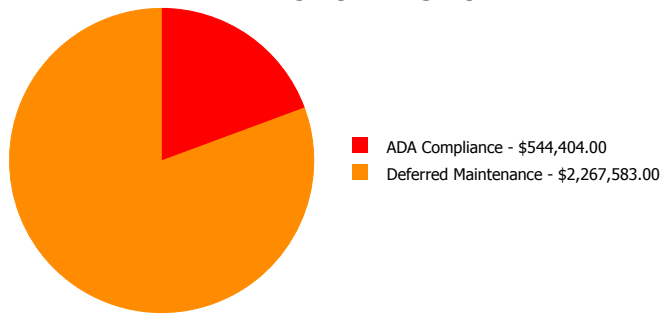


Deficiency By Priority

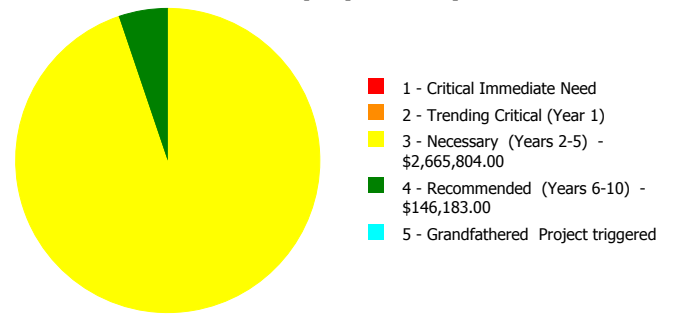

Deficiency By System

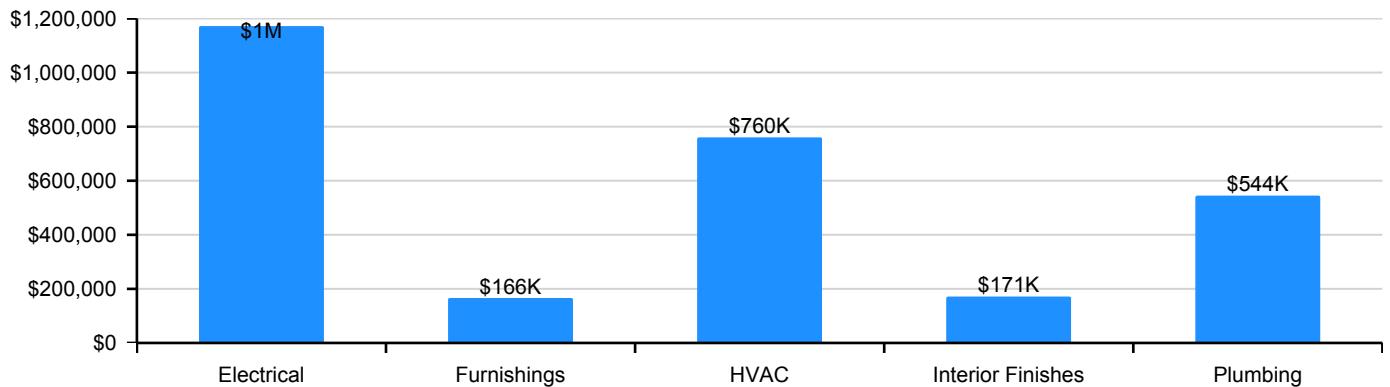

10 Year Investment Forecast

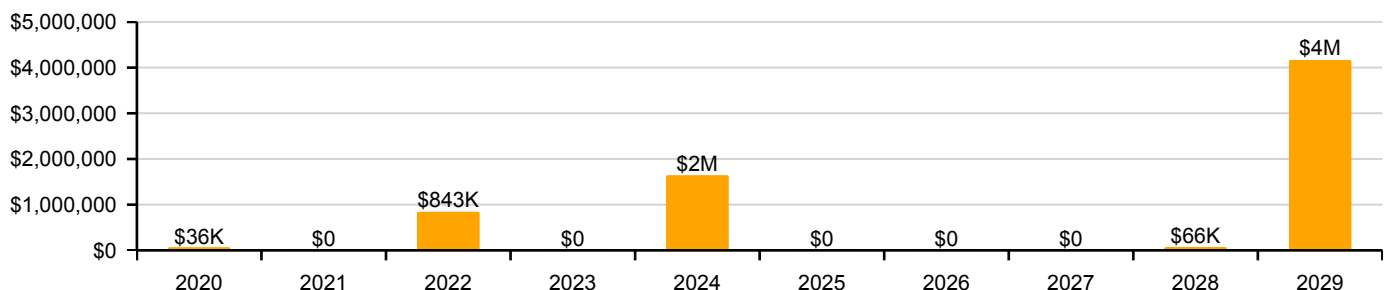

Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

UNIFORMAT Classification	RSLI %	FCI %	Current Repair Cost
A10 - Foundations	75.00 %	0.00 %	\$0.00
B10 - Superstructure	75.00 %	0.00 %	\$0.00
B20 - Exterior Enclosure	51.27 %	0.00 %	\$0.00
B30 - Roofing	52.25 %	0.00 %	\$0.00
C10 - Interior Construction	57.92 %	0.00 %	\$0.00
C20 - Stairs	75.00 %	0.00 %	\$0.00
C30 - Interior Finishes	29.54 %	9.84 %	\$170,933.00
D20 - Plumbing	4.60 %	76.21 %	\$544,404.00
D30 - HVAC	34.48 %	32.78 %	\$759,544.00
D40 - Fire Protection	24.87 %	0.00 %	\$0.00
D50 - Electrical	18.53 %	72.65 %	\$1,171,317.00
E10 - Equipment	50.00 %	0.00 %	\$0.00
E20 - Furnishings	0.00 %	110.00 %	\$165,789.00
Totals:	40.98 %	23.08 %	\$2,811,987.00

Photo Album

The photo album consists of the various cardinal compass directions of the building..

1). North Elevation - Dec 04, 2019



2). Northeast Elevation - Dec 04, 2019



3). Northeast Elevation - Dec 04, 2019



4). Southeast Elevation - Dec 04, 2019



5). Southeast Elevation - Dec 04, 2019



6). South Elevation - Dec 04, 2019



7). South Elevation - Dec 04, 2019



8). South Elevation - Dec 04, 2019



9). West Elevation - Dec 04, 2019



10). West Elevation - Dec 04, 2019



11). West Elevation - Dec 04, 2019



12). West Elevation - Dec 04, 2019



13). West Elevation - Dec 04, 2019



14). Center Elevation - Dec 04, 2019



Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment)
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system as new construction.

System Listing

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

School Assessment Report - 1994_Bldg 2010

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
A1010	Standard Foundations	\$8.19	S.F.	70,101	100	1994	2094		75.00 %	0.00 %	75			\$574,127
A1030	Slab on Grade	\$6.92	S.F.	70,101	100	1994	2094		75.00 %	0.00 %	75			\$485,099
B1020	Roof Construction	\$13.46	S.F.	70,101	100	1994	2094		75.00 %	0.00 %	75			\$943,559
B2010	Exterior Walls	\$15.36	S.F.	70,101	100	1994	2094		75.00 %	0.00 %	75			\$1,076,751
B2020	Exterior Windows	\$9.57	S.F.	70,101	30	1994	2024		16.67 %	0.00 %	5			\$670,867
B2030	Exterior Doors	\$0.96	S.F.	70,101	30	1994	2024		16.67 %	0.00 %	5			\$67,297
B3010120	Single Ply Membrane	\$5.37	S.F.	68,101	20	2009	2029		50.00 %	0.00 %	10			\$365,702
B3010130	Preformed Metal Roofing	\$8.50	S.F.	2,000	30	2009	2039		66.67 %	0.00 %	20			\$17,000
B3020	Roof Openings	\$0.57	S.F.	70,101	30	2009	2039		66.67 %	0.00 %	20			\$39,958
C1010	Partitions	\$6.22	S.F.	70,101	100	1994	2094		75.00 %	0.00 %	75			\$436,028
C1020	Interior Doors	\$4.05	S.F.	70,101	40	1994	2034		37.50 %	0.00 %	15			\$283,909
C1030	Fittings	\$2.98	S.F.	70,101	20	2009	2029		50.00 %	0.00 %	10			\$208,901
C2010	Stair Construction	\$1.00	S.F.	70,101	100	1994	2094		75.00 %	0.00 %	75			\$70,101
C3010230	Paint & Covering	\$1.47	S.F.	70,101	10	1994	2004		0.00 %	0.00 %	-15			\$103,048
C3020420	Ceramic Tile	\$16.74	S.F.	10,000	50	1994	2044		50.00 %	0.00 %	25			\$167,400
C3020430	Terrazzo	\$21.62	S.F.	30,000	50	1994	2044		50.00 %	0.00 %	25			\$648,600
C3020901	Carpet	\$7.50	S.F.	3,000	12	1994	2006		0.00 %	110.00 %	-13		\$24,750.00	\$22,500
C3020903	VCT	\$3.48	S.F.	27,101	15	1994	2009		0.00 %	155.00 %	-10		\$146,183.00	\$94,311
C3030	Ceiling Finishes	\$10.00	S.F.	70,101	20	1994	2014	2022	15.00 %	0.00 %	3			\$701,010
D2010	Plumbing Fixtures	\$7.06	S.F.	70,101	20	1994	2014		0.00 %	110.00 %	-5		\$544,404.00	\$494,913
D2020	Domestic Water Distribution	\$0.79	S.F.	70,101	30	1994	2024		16.67 %	0.00 %	5			\$55,380
D2030	Sanitary Waste	\$1.89	S.F.	70,101	30	1994	2024		16.67 %	0.00 %	5			\$132,491
D2040	Rain Water Drainage	\$0.45	S.F.	70,101	20	1994	2014	2020	5.00 %	0.00 %	1			\$31,545
D3010	Energy Supply	\$0.61	S.F.	70,101	30	1994	2024		16.67 %	0.00 %	5			\$42,762
D3020	Heat Generating Systems	\$4.00	S.F.	70,101	20	2009	2029		50.00 %	0.00 %	10			\$280,404
D3030	Cooling Generating Systems	\$6.78	S.F.	70,101	20	2009	2029		50.00 %	0.00 %	10			\$475,285
D3040	Distribution Systems	\$11.81	S.F.	70,101	20	2009	2029		50.00 %	0.00 %	10			\$827,893
D3050	Terminal & Package Units	\$7.39	S.F.	70,101	15	2009	2024	2019	0.00 %	110.00 %	0		\$569,851.00	\$518,046
D3060	Controls & Instrumentation	\$2.46	S.F.	70,101	15	2009	2024	2019	0.00 %	110.00 %	0		\$189,693.00	\$172,448
D4010	Sprinklers	\$4.54	S.F.	70,101	30	1994	2024		16.67 %	0.00 %	5			\$318,259
D4030	Fire Protection Specialties	\$0.56	S.F.	70,101	20	2009	2029		50.00 %	0.00 %	10			\$39,257
D4090	Other Fire Protection Systems	\$0.66	S.F.	70,101	15	2013	2028		60.00 %	0.00 %	9			\$46,267
D5010	Electrical Service/Distribution	\$2.55	S.F.	70,101	20	1994	2014		0.00 %	110.00 %	-5		\$196,633.00	\$178,758
D5020	Branch Wiring	\$5.06	S.F.	70,101	20	1994	2014		0.00 %	110.00 %	-5		\$390,182.00	\$354,711
D5020	Lighting	\$7.58	S.F.	70,101	20	1994	2014		0.00 %	110.00 %	-5		\$584,502.00	\$531,366
D5030810	Security & Detection Systems	\$1.51	S.F.	70,101	20	2009	2029		50.00 %	0.00 %	10			\$105,853
D5030910	Fire Alarm Systems	\$2.74	S.F.	70,101	20	2009	2029		50.00 %	0.00 %	10			\$192,077
D5030920	Data Communication	\$3.56	S.F.	70,101	25	2009	2034		60.00 %	0.00 %	15			\$249,560
E1020	Institutional Equipment	\$0.10	S.F.	70,101	20	2009	2029		50.00 %	0.00 %	10			\$7,010
E2010	Fixed Furnishings	\$2.15	S.F.	70,101	20	1994	2014		0.00 %	110.00 %	-5		\$165,789.00	\$150,717
Total									40.98 %	23.08 %			\$2,811,987.00	\$12,181,170

System Notes

The facility description in the executive summary contains an overview of each system. The system notes listed below provide additional information on select systems found within the facility.

System: B2010 - Exterior Walls



Note:

System: B2020 - Exterior Windows



Note:

System: B2030 - Exterior Doors



Note:

School Assessment Report - 1994_Bldg 2010

System: B3010120 - Single Ply Membrane





Note:

System: B3010130 - Preformed Metal Roofing



Note:


System: B3020 - Roof Openings

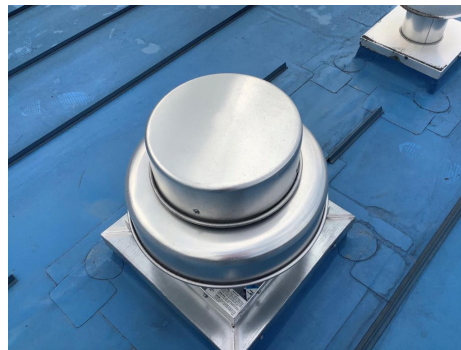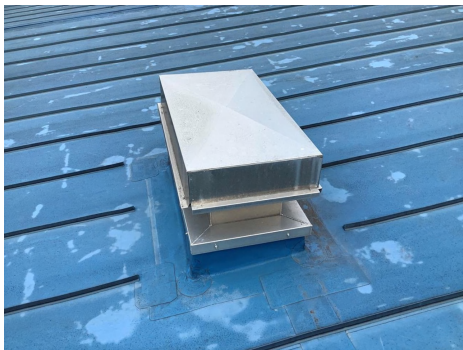

Note:

School Assessment Report - 1994_Bldg 2010

System: C1010 - Partitions

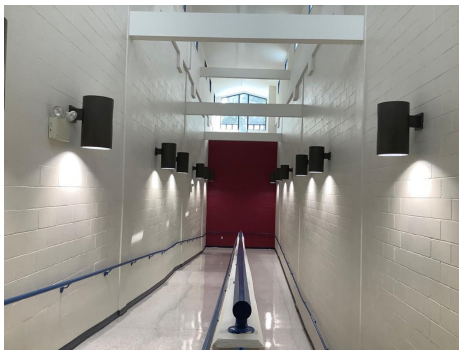


Note:

System: C1020 - Interior Doors



Note:


System: C1030 - Fittings

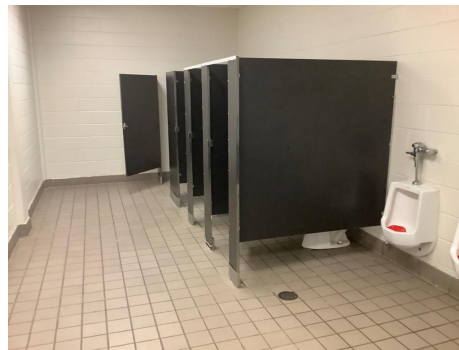

Note:

School Assessment Report - 1994_Bldg 2010

System: C2010 - Stair Construction

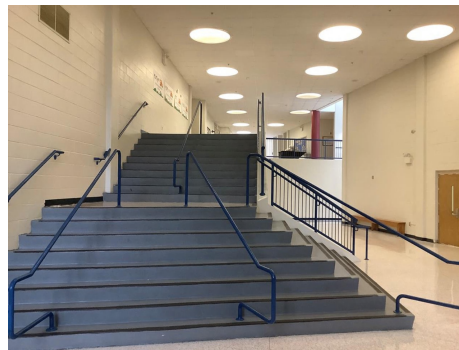

Note:

System: C3010230 - Paint & Covering



Note:

System: C3020420 - Ceramic Tile



Note:


School Assessment Report - 1994_Bldg 2010

System: C3020430 - Terrazzo



Note:

System: C3020901 - Carpet

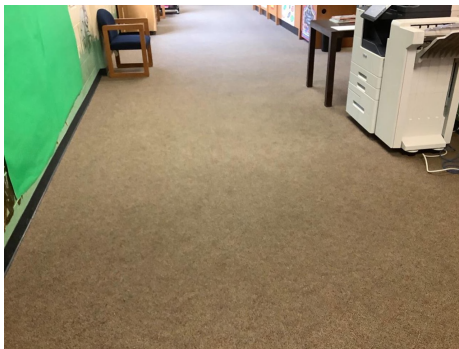

Note:

System: C3020903 - VCT



Note:

School Assessment Report - 1994_Bldg 2010

System: C3030 - Ceiling Finishes



Note:

System: D2010 - Plumbing Fixtures



Note:

System: D2020 - Domestic Water Distribution



Note:


School Assessment Report - 1994_Bldg 2010

System: D2030 - Sanitary Waste



Note:

System: D2040 - Rain Water Drainage

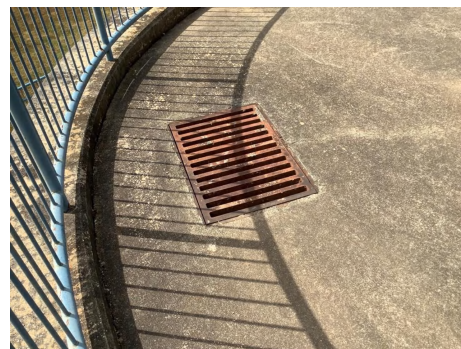

Note:


System: D3010 - Energy Supply



Note:


School Assessment Report - 1994_Bldg 2010

System: D3020 - Heat Generating Systems

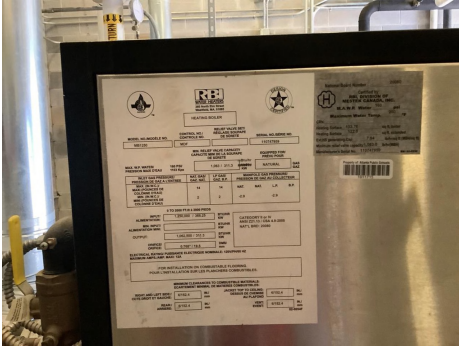

Note:

System: D3030 - Cooling Generating Systems

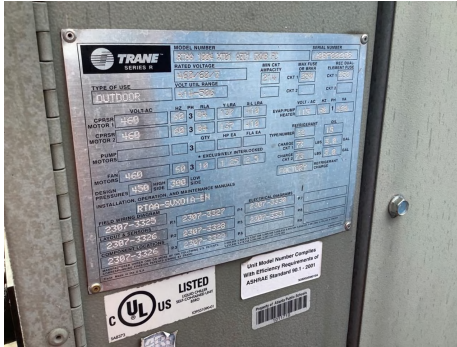

Note:

System: D3040 - Distribution Systems



Note:

School Assessment Report - 1994_Bldg 2010

System: D3050 - Terminal & Package Units




Note:

System: D3060 - Controls & Instrumentation



Note:

System: D4010 - Sprinklers

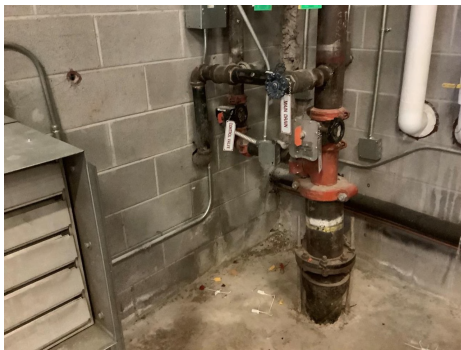

Note:

School Assessment Report - 1994_Bldg 2010

System: D4030 - Fire Protection Specialties



Note:

System: D5010 - Electrical Service/Distribution



Note:

System: D5020 - Branch Wiring



Note:


School Assessment Report - 1994_Bldg 2010

System: D5020 - Lighting



Note:

System: D5030 - Communications and Security

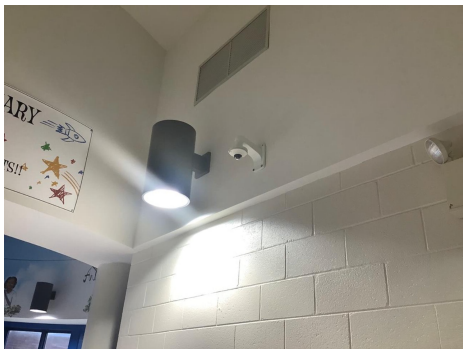

Note:

System: E1020 - Institutional Equipment



Note:

School Assessment Report - 1994_Bldg 2010

System: E2010 - Fixed Furnishings



Note:

Renewal Schedule

eCOMET forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the System Listing table. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.

Inflation Rate: 3%

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
Total:	\$2,811,987	\$35,741	\$0	\$842,614	\$0	\$1,641,254	\$0	\$0	\$0	\$66,404	\$4,166,168	\$9,564,167
* A - Substructure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A10 - Foundations	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A1010 - Standard Foundations	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A1030 - Slab on Grade	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B - Shell	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B10 - Superstructure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B1020 - Roof Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B20 - Exterior Enclosure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B2010 - Exterior Walls	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B2020 - Exterior Windows	\$0	\$0	\$0	\$0	\$0	\$855,490	\$0	\$0	\$0	\$0	\$0	\$855,490
B2030 - Exterior Doors	\$0	\$0	\$0	\$0	\$0	\$85,818	\$0	\$0	\$0	\$0	\$0	\$85,818
B30 - Roofing	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B3010 - Roof Coverings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B3010120 - Single Ply Membrane	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$855,164	\$855,164
B3010130 - Preformed Metal Roofing	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B3020 - Roof Openings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C - Interiors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C10 - Interior Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1010 - Partitions	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1020 - Interior Doors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1030 - Fittings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$308,820	\$308,820
C20 - Stairs	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* C2010 - Stair Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C30 - Interior Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3010 - Wall Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0

School Assessment Report - 1994_Bldg 2010

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
C3010230 - Paint & Covering	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$152,337	\$152,337
C3020 - Floor Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020420 - Ceramic Tile	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020430 - Terrazzo	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020901 - Carpet	\$24,750	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$24,750
C3020903 - VCT	\$146,183	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$146,183
C3030 - Ceiling Finishes	\$0	\$0	\$0	\$842,614	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$842,614
D - Services	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D20 - Plumbing	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2010 - Plumbing Fixtures	\$544,404	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$544,404
D2020 - Domestic Water Distribution	\$0	\$0	\$0	\$0	\$0	\$70,621	\$0	\$0	\$0	\$0	\$0	\$70,621
D2030 - Sanitary Waste	\$0	\$0	\$0	\$0	\$0	\$168,953	\$0	\$0	\$0	\$0	\$0	\$168,953
D2040 - Rain Water Drainage	\$0	\$35,741	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$35,741
D30 - HVAC	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3010 - Energy Supply	\$0	\$0	\$0	\$0	\$0	\$54,530	\$0	\$0	\$0	\$0	\$0	\$54,530
D3020 - Heat Generating Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$414,523	\$414,523
D3030 - Cooling Generating Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$702,617	\$702,617
D3040 - Distribution Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$1,223,880	\$1,223,880
D3050 - Terminal & Package Units	\$569,851	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$569,851
D3060 - Controls & Instrumentation	\$189,693	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$189,693
D40 - Fire Protection	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D4010 - Sprinklers	\$0	\$0	\$0	\$0	\$0	\$405,843	\$0	\$0	\$0	\$0	\$0	\$405,843
D4030 - Fire Protection Specialties	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$58,033	\$58,033
D4090 - Other Fire Protection Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$66,404	\$0	\$66,404
D50 - Electrical	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5010 - Electrical Service/Distribution	\$196,633	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$196,633
D5020 - Branch Wiring	\$390,182	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$390,182
D5020 - Lighting	\$584,502	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$584,502
D5030 - Communications and Security	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030810 - Security & Detection Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$156,483	\$156,483
D5030910 - Fire Alarm Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$283,948	\$283,948
D5030920 - Data Communication	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0


School Assessment Report - 1994_Bldg 2010

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
E - Equipment & Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E10 - Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E1020 - Institutional Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$10,363	\$10,363
E20 - Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E2010 - Fixed Furnishings	\$165,789	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$165,789

* Indicates non-renewable system

Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and forecasted capital renewal (sustainment) requirements over the next ten years.

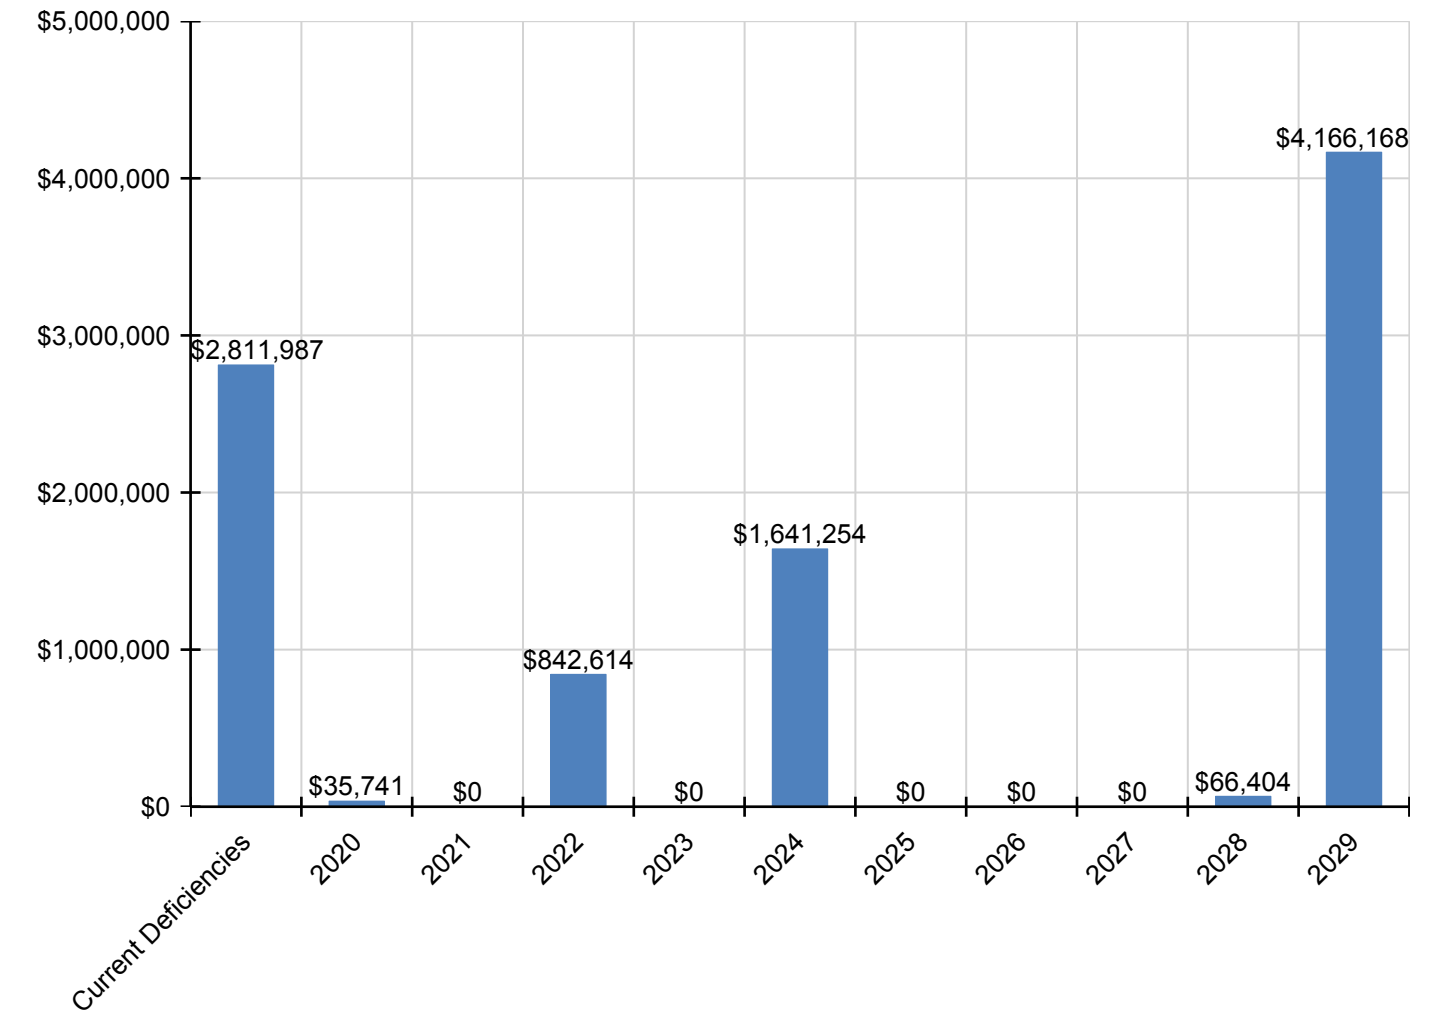


Condition Index Forecast by Investment Scenario

The chart below illustrates the effect of various investment levels on the building FCI for the next 10 years. The levels of investment shown below include:

- Current FCI: a variable investment amount based on renewing expired systems to maintain the current FCI for the building
- 2% Investment: an annual investment of 2% of the replacement value of the building, escalated for inflation
- 4% Investment: an annual investment of 4% of the replacement value of the building, escalated for inflation


Facility Investment vs. FCI Forecast

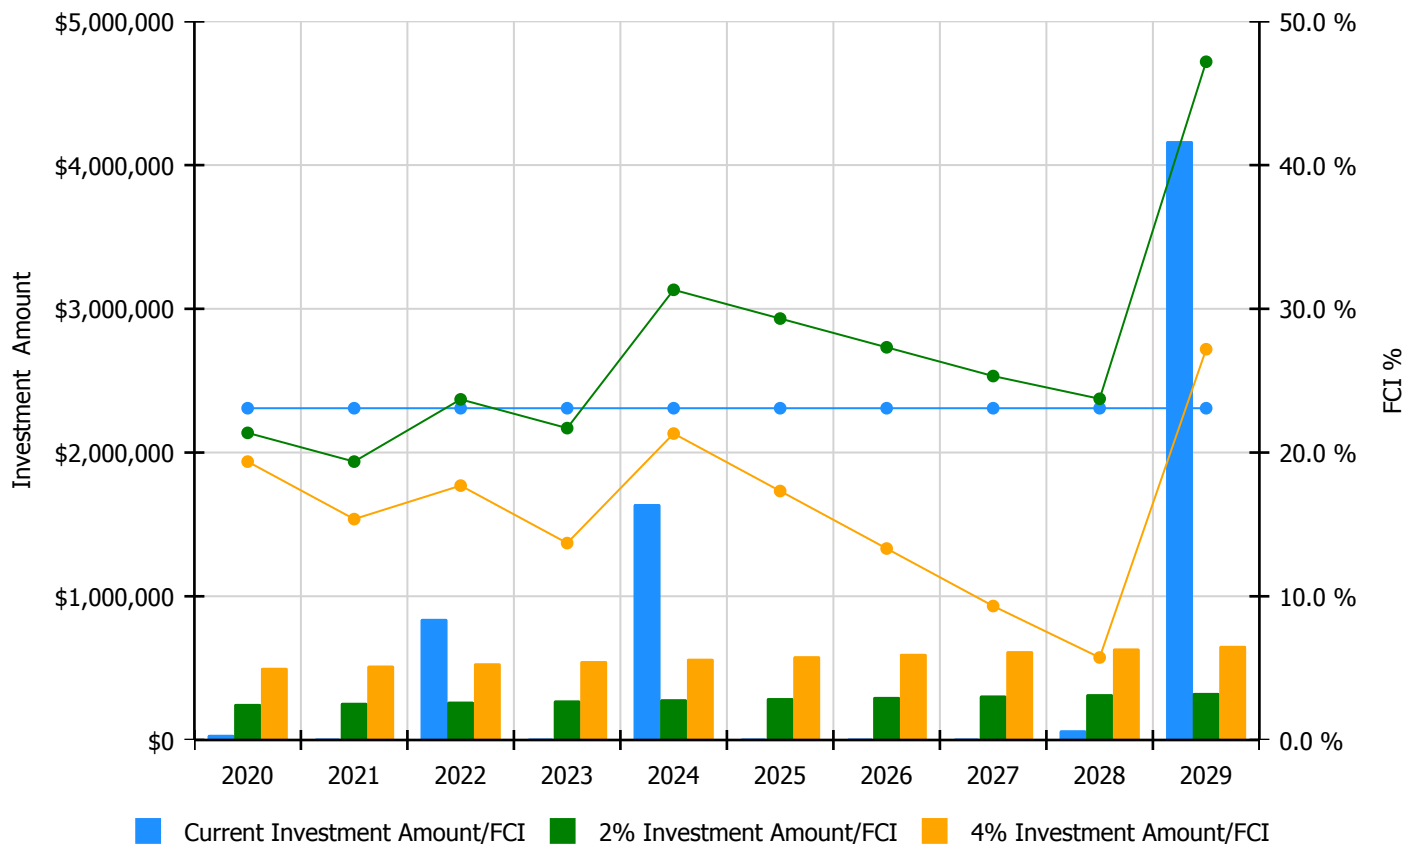

Year	Investment Amount Current FCI - 23.08%	2% Investment		4% Investment	
		Amount	FCI	Amount	FCI
2020	\$35,741	\$250,932.00	21.37 %	\$501,864.00	19.37 %
2021	\$0	\$258,460.00	19.37 %	\$516,920.00	15.37 %
2022	\$842,614	\$266,214.00	23.70 %	\$532,428.00	17.70 %
2023	\$0	\$274,200.00	21.70 %	\$548,401.00	13.70 %
2024	\$1,641,254	\$282,426.00	31.32 %	\$564,853.00	21.32 %
2025	\$0	\$290,899.00	29.32 %	\$581,798.00	17.32 %
2026	\$0	\$299,626.00	27.32 %	\$599,252.00	13.32 %
2027	\$0	\$308,615.00	25.32 %	\$617,230.00	9.32 %
2028	\$66,404	\$317,873.00	23.74 %	\$635,747.00	5.74 %
2029	\$4,166,168	\$327,409.00	47.19 %	\$654,819.00	27.19 %
Total:	\$6,752,180	\$2,876,654.00		\$5,753,312.00	

Deficiency Summary by System


Current deficiencies included assemblies that have reached or exceeded their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Useful Life'. The following chart lists all current deficiencies associated with this facility.

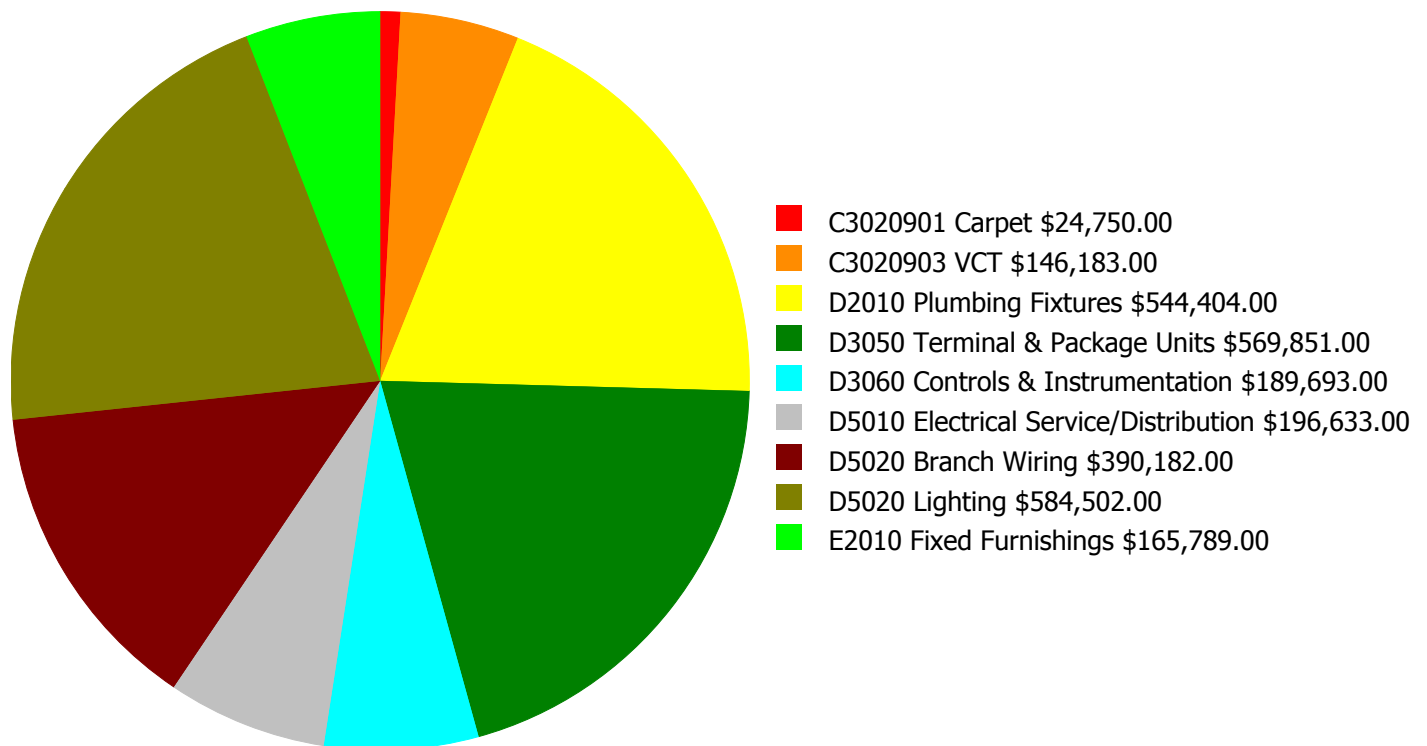

Budget Estimate Total: \$2,811,987.00

Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

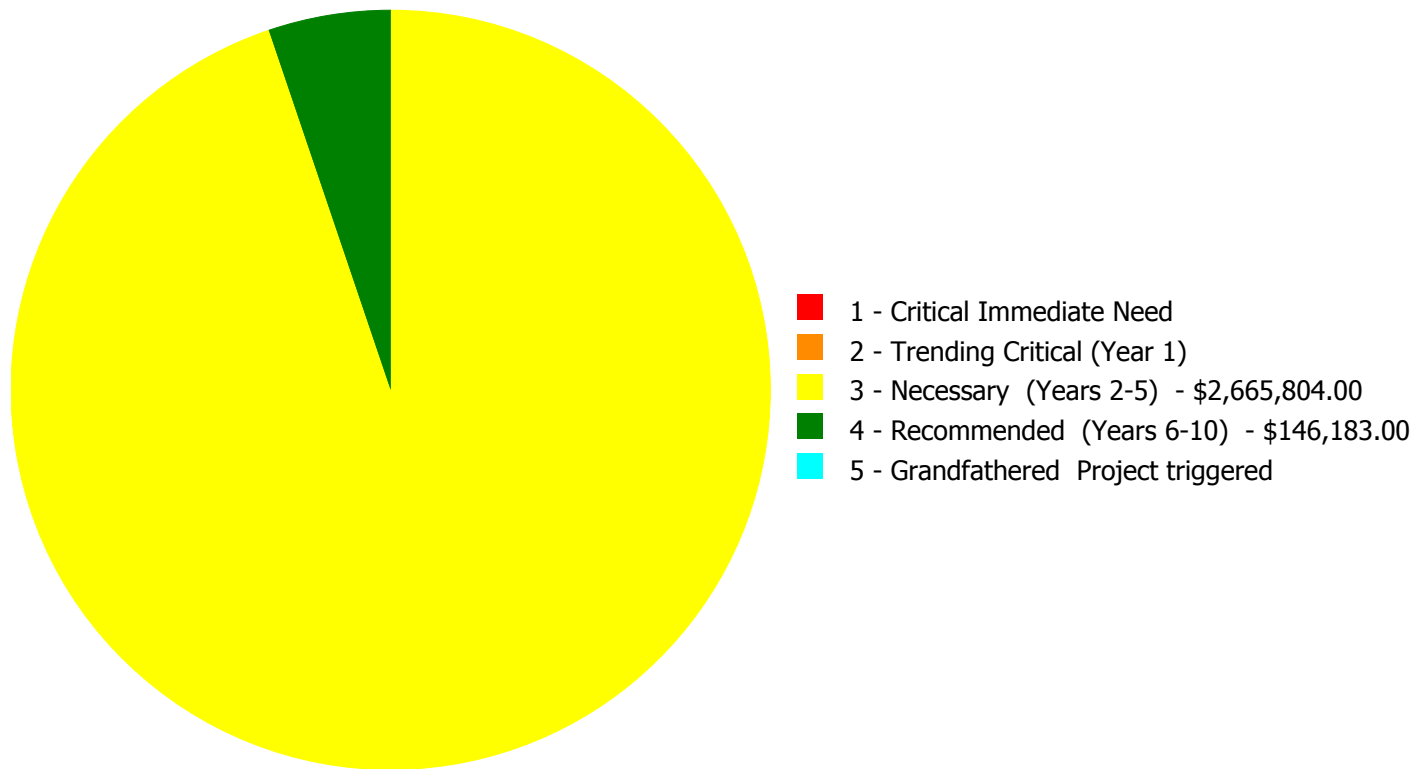

Budget Estimate Total: \$2,811,987.00


Deficiency By Priority Investment Table

The table below shows the current investment cost grouped by deficiency priority and building system.

System Code	System Description	1 - Critical Immediate Need	2 - Trending Critical (Year 1)	3 - Necessary (Years 2-5)	4 - Recommended (Years 6-10)	5 - Grandfathered Project triggered	Total
C3020901	Carpet	\$0.00	\$0.00	\$24,750.00	\$0.00	\$0.00	\$24,750.00
C3020903	VCT	\$0.00	\$0.00	\$0.00	\$146,183.00	\$0.00	\$146,183.00
D2010	Plumbing Fixtures	\$0.00	\$0.00	\$544,404.00	\$0.00	\$0.00	\$544,404.00
D3050	Terminal & Package Units	\$0.00	\$0.00	\$569,851.00	\$0.00	\$0.00	\$569,851.00
D3060	Controls & Instrumentation	\$0.00	\$0.00	\$189,693.00	\$0.00	\$0.00	\$189,693.00
D5010	Electrical Service/Distribution	\$0.00	\$0.00	\$196,633.00	\$0.00	\$0.00	\$196,633.00
D5020	Branch Wiring	\$0.00	\$0.00	\$390,182.00	\$0.00	\$0.00	\$390,182.00
D5020	Lighting	\$0.00	\$0.00	\$584,502.00	\$0.00	\$0.00	\$584,502.00
E2010	Fixed Furnishings	\$0.00	\$0.00	\$165,789.00	\$0.00	\$0.00	\$165,789.00
	Total:	\$0.00	\$0.00	\$2,665,804.00	\$146,183.00	\$0.00	\$2,811,987.00

Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

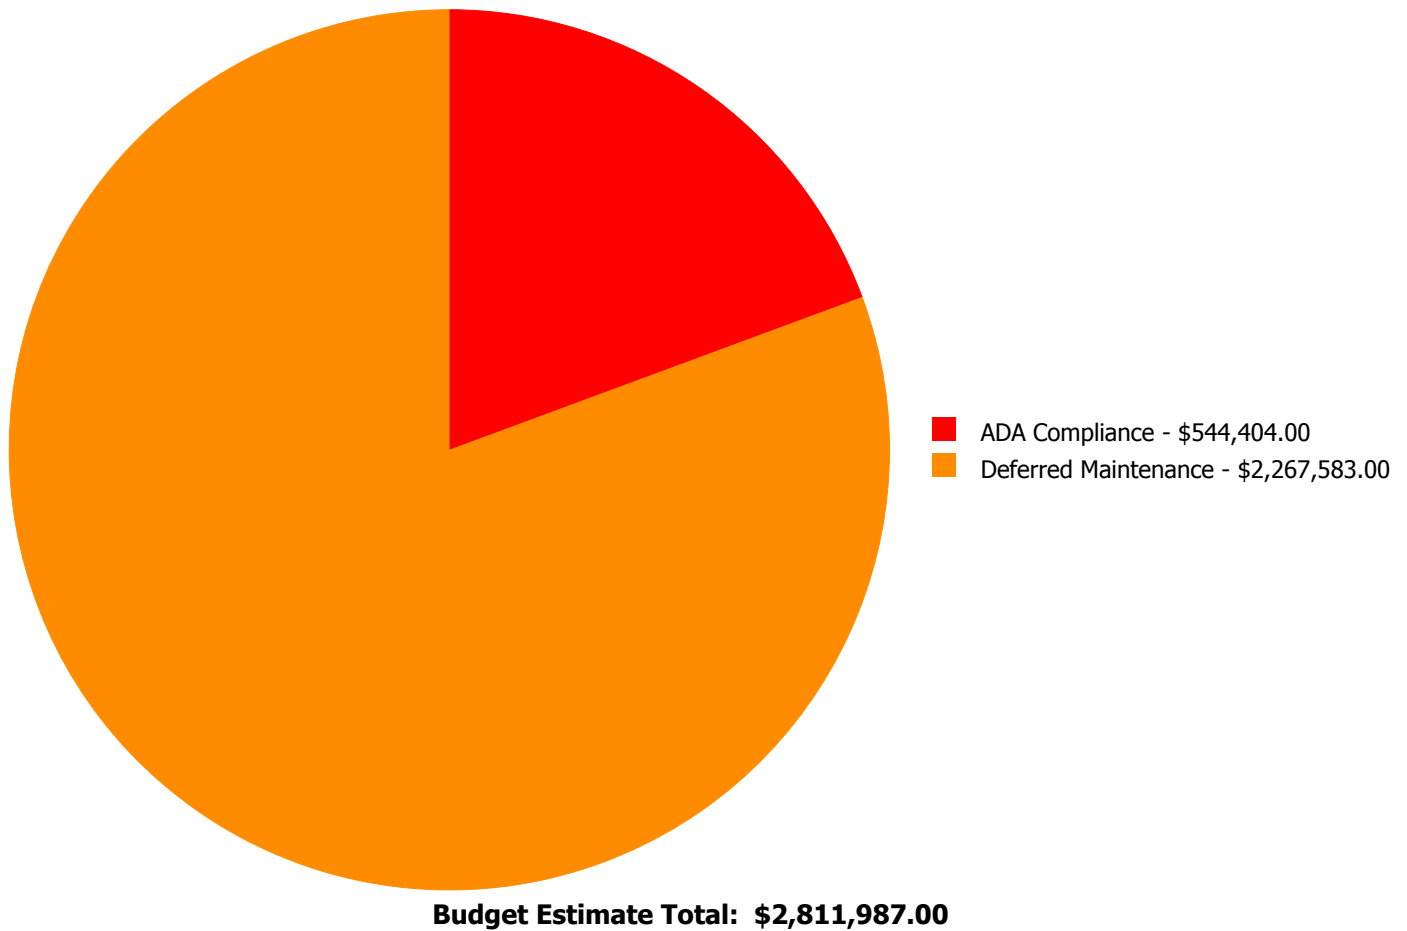

Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

Priority 3 - Necessary (Years 2-5):

System: C3020901 - Carpet



Location: Media Center and Administration Areas
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 3,000.00
Unit of Measure: S.F.
Estimate: \$24,750.00
Assessor Name: Eduardo Lopez
Date Created: 10/18/2019

Notes: The carpet is aged, worn and stained, and should be replaced.

System: D2010 - Plumbing Fixtures



Location: Throughout building
Distress: Beyond Expected Life
Category: ADA Compliance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 70,101.00
Unit of Measure: S.F.
Estimate: \$544,404.00
Assessor Name: Eduardo Lopez
Date Created: 09/17/2015

Notes: The restroom fixtures are from the 1994 original construction. The systems are beyond the expected life cycle and upgrades are warranted. The new restroom fixtures should include all aspects of the current ADA standards.

System: D3050 - Terminal & Package Units



Location: Throughout Building
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 70,101.00
Unit of Measure: S.F.
Estimate: \$569,851.00
Assessor Name: Eduardo Lopez
Date Created: 10/06/2020

Notes: The terminal and package units are beyond expected service life and should be scheduled for replacement.

System: D3060 - Controls & Instrumentation



Location: Throughout Building
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 70,101.00
Unit of Measure: S.F.
Estimate: \$189,693.00
Assessor Name: Eduardo Lopez
Date Created: 10/06/2020

Notes: The controls and instrumentation system is beyond service life and should be scheduled for replacement.

System: D5010 - Electrical Service/Distribution



Location: Throughout Building
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 70,101.00
Unit of Measure: S.F.
Estimate: \$196,633.00
Assessor Name: Eduardo Lopez
Date Created: 09/17/2015

Notes: The electrical services and distribution system consist of dry step down pad mounted transformer located in the main electrical room. This system has expired and will require upgrades.

System: D5020 - Branch Wiring



Location: Throughout Building
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 70,101.00
Unit of Measure: S.F.
Estimate: \$390,182.00
Assessor Name: Eduardo Lopez
Date Created: 09/17/2015

Notes: The original 1994 branch wiring system is operational but is aged and should be replaced with an energy efficient system.

System: D5020 - Lighting



Location: Throughout building
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 70,101.00
Unit of Measure: S.F.
Estimate: \$584,502.00
Assessor Name: Eduardo Lopez
Date Created: 10/17/2019

Notes: This buildings lighting system consists of a T12 hanging four rack two and four foot florescent system. The upgrades have no records to indicate the date of the installation. With this in mind this system is recommended for universal upgrades based on condition and estimated age.

System: E2010 - Fixed Furnishings



Location: Throughout building
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 70,101.00
Unit of Measure: S.F.
Estimate: \$165,789.00
Assessor Name: Eduardo Lopez
Date Created: 09/17/2015

Notes: Fittings, such as toilet partitions, lockers, signage and railing, are beyond their expected service life, outdated and missing in areas, and should be replaced and upgraded.

Priority 4 - Recommended (Years 6-10):

System: C3020903 - VCT



Location: Gym and Classrooms
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 4 - Recommended (Years 6-10)
Correction: Renew System
Qty: 27,101.00
Unit of Measure: S.F.
Estimate: \$146,183.00
Assessor Name: Eduardo Lopez
Date Created: 10/18/2019

Notes: The vinyl tile finish was installed in 1994 and is nearing the end of its useful life. This finish is recommended for upgrade based on life cycle.

Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as 100-Total FCI (without the %) where 100 is best and 0 is worst condition.

Function:

Gross Area (SF): 70,101

Year Built: 1994

Last Renovation:

Replacement Value: \$2,149,295

Repair Cost: \$0.00

Total FCI: 0.00 %

Total RSLI: 27.06 %

FCA Score: 100.00



Description:

The narrative for this site is included in the Executive Summary Description at the front of this report.

Attributes: This asset has no attributes.


Dashboard Summary

Function:		Gross Area:	70,101
Year Built:	1994	Last Renovation:	
Repair Cost:	\$0	Replacement Value:	\$2,149,295
FCI:	0.00 %	RSLI%:	27.06 %

No data found for this asset

No data found for this asset

No data found for this asset

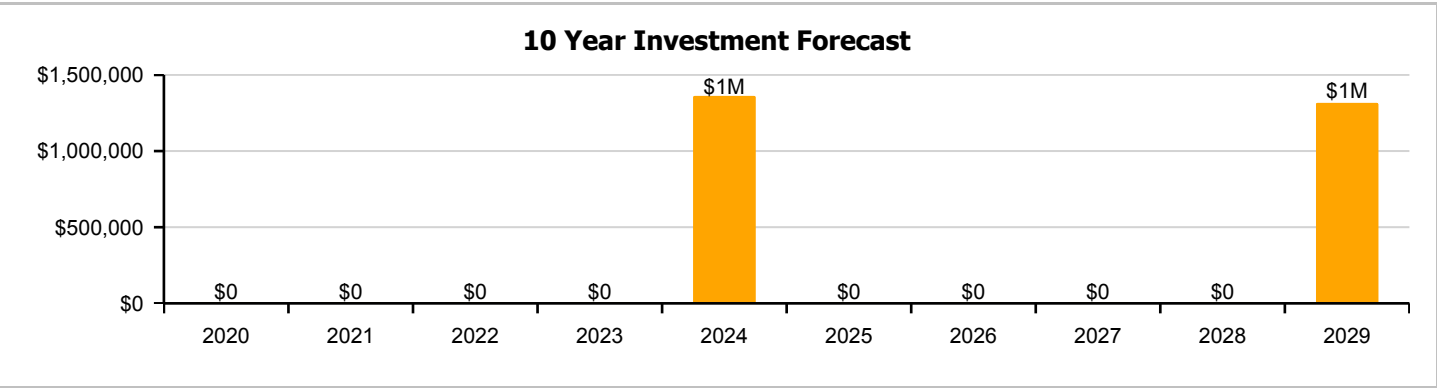

Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

UNIFORMAT Classification	RSLI %	FCI %	Current Repair Cost
G20 - Site Improvements	25.32 %	0.00 %	\$0.00
G30 - Site Mechanical Utilities	50.00 %	0.00 %	\$0.00
G40 - Site Electrical Utilities	16.67 %	0.00 %	\$0.00
Totals:	27.06 %	0.00 %	\$0.00

Photo Album

The photo album consists of the various cardinal compass directions of the building..



Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment)
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system as new construction.

System Listing

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
G2010	Roadways	\$2.37	S.F.	70,101	35	1994	2029		28.57 %	0.00 %	10			\$166,139
G2020	Parking Lots	\$8.00	S.F.	70,101	35	1994	2029		28.57 %	0.00 %	10			\$560,808
G2030	Pedestrian Paving	\$2.33	S.F.	70,101	35	1994	2029		28.57 %	0.00 %	10			\$163,335
G2040105	Fence & Guardrails	\$1.15	S.F.	70,101	30	1994	2024		16.67 %	0.00 %	5			\$80,616
G2040950	Playing Field	\$4.28	S.F.	70,101	20	1994	2014	2024	25.00 %	0.00 %	5			\$300,032
G2050	Landscaping	\$1.18	S.F.	70,101	25	1994	2019		0.00 %	0.00 %	0			\$82,719
G3010	Water Supply	\$1.09	S.F.	70,101	50	1994	2044		50.00 %	0.00 %	25			\$76,410
G3020	Sanitary Sewer	\$2.20	S.F.	70,101	50	1994	2044		50.00 %	0.00 %	25			\$154,222
G3030	Storm Sewer	\$1.25	S.F.	70,101	50	1994	2044		50.00 %	0.00 %	25			\$87,626
G4010	Electrical Distribution	\$2.55	S.F.	70,101	30	1994	2024		16.67 %	0.00 %	5			\$178,758
G4020	Site Lighting	\$2.98	S.F.	70,101	30	1994	2024		16.67 %	0.00 %	5			\$208,901
G4030	Site Communication and Security	\$1.28	S.F.	70,101	30	1994	2024		16.67 %	0.00 %	5			\$89,729
Total									27.06 %					\$2,149,295

System Notes

The facility description in the executive summary contains an overview of each system. The system notes listed below provide additional information on select systems found within the facility.

System: G2010 - Roadways



Note:

System: G2020 - Parking Lots



Note:

System: G2030 - Pedestrian Paving



Note:

School Assessment Report - Site

System: G2040105 - Fence & Guardrails



Note:

System: G2040950 - Playing Field



Note:

System: G2050 - Landscaping



Note:

School Assessment Report - Site

System: G3010 - Water Supply




Note:

System: G3020 - Sanitary Sewer



Note:

System: G3030 - Storm Sewer

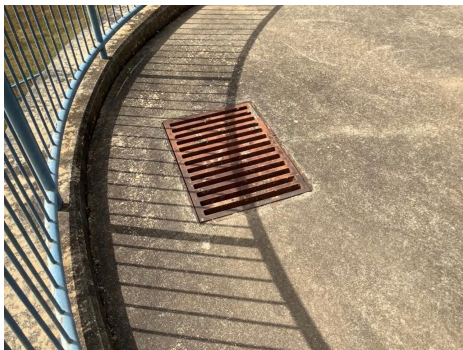

Note:

School Assessment Report - Site

System: G4010 - Electrical Distribution



Note:

System: G4020 - Site Lighting



Note:

System: G4030 - Site Communication and Security



Note:

Renewal Schedule

eCOMET forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the System Listing table. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.


Inflation Rate: 3%

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
Total:		\$0	\$0	\$0	\$0	\$1,361,989	\$0	\$0	\$0	\$0	\$1,316,112	\$2,678,101
G - Building Sitework	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G20 - Site Improvements	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2010 - Roadways	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$245,605	\$245,605
G2020 - Parking Lots	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$829,047	\$829,047
G2030 - Pedestrian Paving	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$241,460	\$241,460
G2040 - Site Development	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040105 - Fence & Guardrails	\$0	\$0	\$0	\$0	\$0	\$102,802	\$0	\$0	\$0	\$0	\$0	\$102,802
G2040950 - Playing Field	\$0	\$0	\$0	\$0	\$0	\$650,422	\$0	\$0	\$0	\$0	\$0	\$650,422
G2050 - Landscaping	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G30 - Site Mechanical Utilities	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G3010 - Water Supply	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G3020 - Sanitary Sewer	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G3030 - Storm Sewer	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G40 - Site Electrical Utilities	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G4010 - Electrical Distribution	\$0	\$0	\$0	\$0	\$0	\$227,952	\$0	\$0	\$0	\$0	\$0	\$227,952
G4020 - Site Lighting	\$0	\$0	\$0	\$0	\$0	\$266,391	\$0	\$0	\$0	\$0	\$0	\$266,391
G4030 - Site Communication and Security	\$0	\$0	\$0	\$0	\$0	\$114,423	\$0	\$0	\$0	\$0	\$0	\$114,423

* Indicates non-renewable system

Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and forecasted capital renewal (sustainment) requirements over the next ten years.

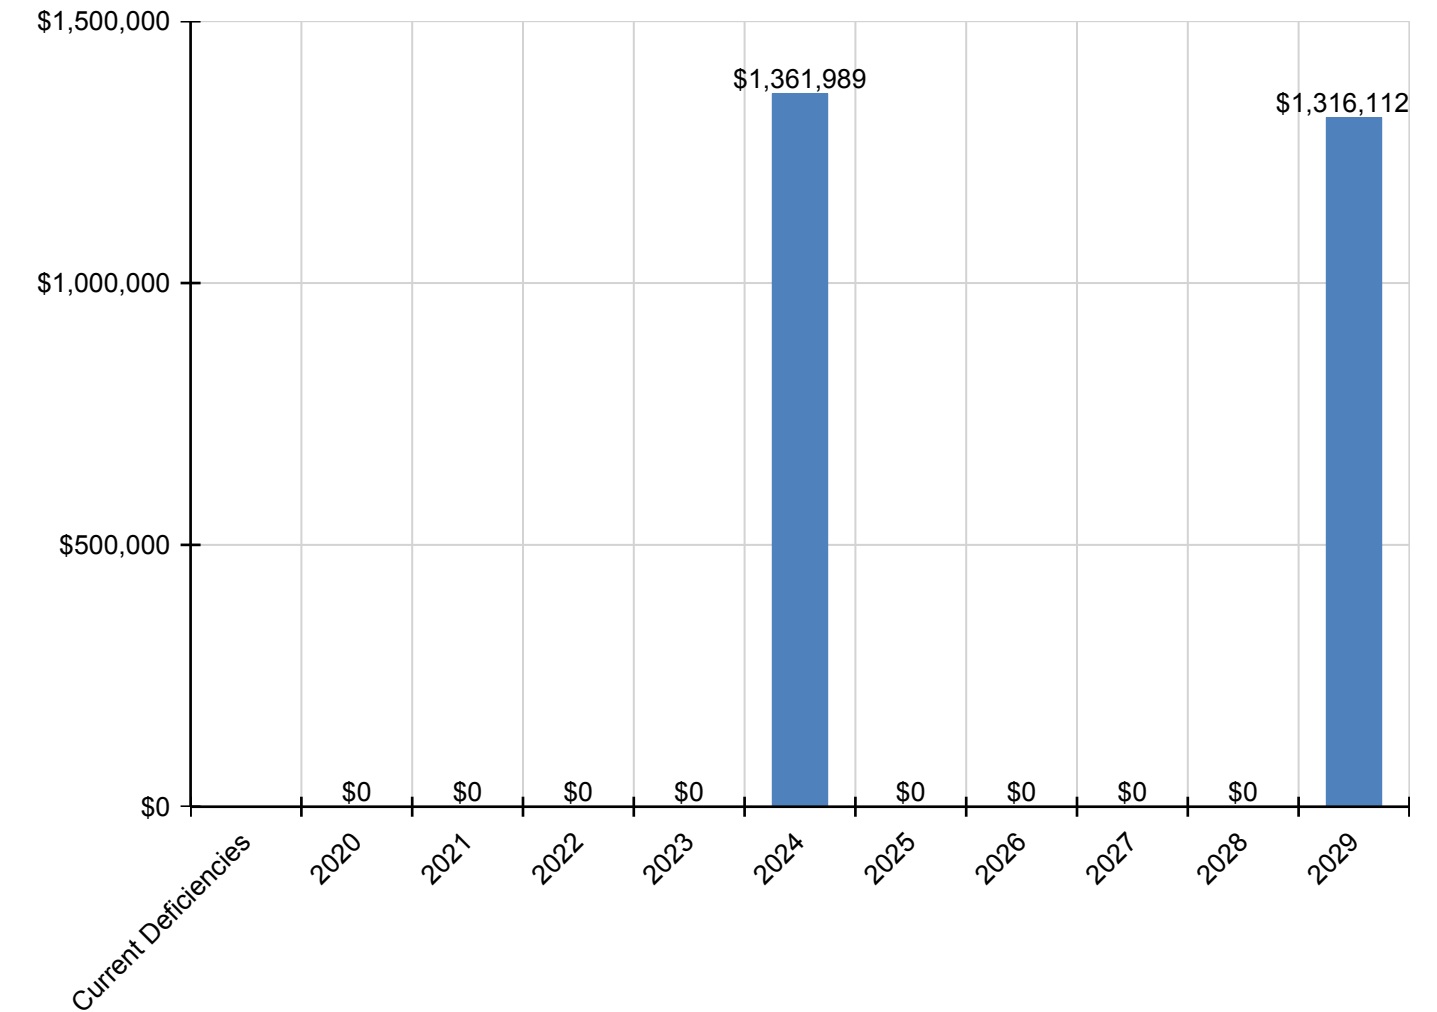


Condition Index Forecast by Investment Scenario

The chart below illustrates the effect of various investment levels on the building FCI for the next 10 years. The levels of investment shown below include:

- Current FCI: a variable investment amount based on renewing expired systems to maintain the current FCI for the building
- 2% Investment: an annual investment of 2% of the replacement value of the building, escalated for inflation
- 4% Investment: an annual investment of 4% of the replacement value of the building, escalated for inflation

Facility Investment vs. FCI Forecast

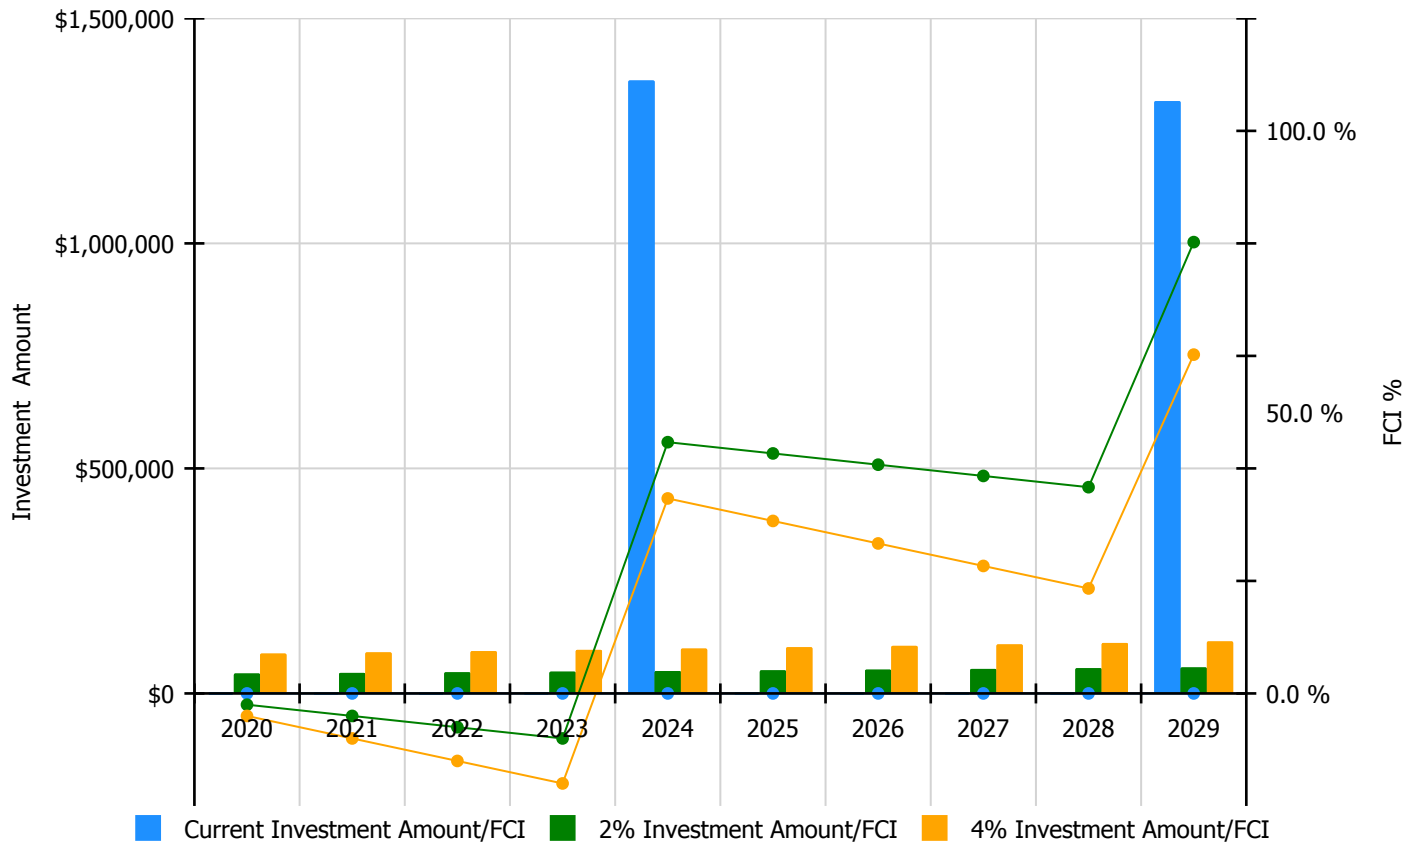

Year	Investment Amount Current FCI - 0%	2% Investment		4% Investment	
		Amount	FCI	Amount	FCI
2020	\$0	\$44,275.00	-2.00 %	\$88,551.00	-4.00 %
2021	\$0	\$45,604.00	-4.00 %	\$91,207.00	-8.00 %
2022	\$0	\$46,972.00	-6.00 %	\$93,944.00	-12.00 %
2023	\$0	\$48,381.00	-8.00 %	\$96,762.00	-16.00 %
2024	\$1,361,989	\$49,832.00	44.66 %	\$99,665.00	34.66 %
2025	\$0	\$51,327.00	42.66 %	\$102,655.00	30.66 %
2026	\$0	\$52,867.00	40.66 %	\$105,734.00	26.66 %
2027	\$0	\$54,453.00	38.66 %	\$108,907.00	22.66 %
2028	\$0	\$56,087.00	36.66 %	\$112,174.00	18.66 %
2029	\$1,316,112	\$57,769.00	80.23 %	\$115,539.00	60.23 %
Total:	\$2,678,101	\$507,567.00		\$1,015,138.00	

Deficiency Summary by System

Current deficiencies included assemblies that have reached or exceeded their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Useful Life'. The following chart lists all current deficiencies associated with this facility.

No data found for this asset

Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

No data found for this asset

Deficiency By Priority Investment Table

The table below shows the current investment cost grouped by deficiency priority and building system.

No data found for this asset

Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

No data found for this asset

Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

No data found for this asset

Glossary

Abandoned	A facility owned by the city that is not occupied and not maintained. See Vacant.
Additional Cost	Total project cost is composed of hard and soft costs. Additional costs or soft expenses are costs that are necessary to accomplish the corrective work but are not directly attributable to the deficient systems direct construction cost, which are often referred to as hard cost. The components included in the soft costs vary by owner but usually include architect and contractor fees, contingencies and other owner-incurred costs necessary to fully develop and build a facility. These soft cost factors can be adjusted anytime within the eCOMET database at the owner's discretion.
Assessment	Visual survey of a facility to determine its condition. It involves looking at the age of systems, reviewing information from local sources and visual evidence of potential problems to assign a condition rating. It does not include destructive testing of materials or testing of systems or equipment for functionality.
ASTM	ASTM International (ASTM): Originally known as the American Society for Testing and Materials, ASTM is an international standards organization that develops and publishes voluntary consensus technical standards for a wide range of materials, products, systems, and services.
BOMA	Building Owners Managers of America (BOMA): National organization of public and private facility owners focused on building management tools and maintenance techniques. eCOMET® reference: Building and component system effective economic life expectancies.
Building	A fully enclosed and roofed structure that can be traversed internally without exiting to the exterior.
Building Addition	An area, space or component of a building added to a building after the original building's year built date. NOTE: As a convention in the database, "Main" was used to designate the original building. Additions built prior to 1987 (30 years) were included in the main building area calculations to reflect their predicted system depreciation characteristics and remaining service life.
Building Systems	eCOMET® uses UNIFORMAT II to organize building data. UNIFORMAT II was originally developed by the federal General Services Administration to delineate building costs by systems rather than by material. UNIFORMAT II was formalized by an NIST standard, NISTIR 6389 in 1999. It has been further quantified and updated by ASTM standard 2005, E1557-05. The Construction Specifications Institute, CSI, has taken over the standard as part of their MasterFormat / MasterSpec system.
Calculated Next Renewal	The year a system or building element would be expected to expire based solely on the date it was installed and the expected useful lifetime for that kind of system.
Capital Renewal	Capital renewal refers to the cyclical replacement of building systems or elements as they become obsolete or beyond their useful life. It is not normally included in an annual operating/maintenance budget. See calculated next renewal and next renewal.
City Cost Index (CCI)	RS Means provides building system, equipment, and construction costs at a national level. The City Cost Index (also provided by RS Means) localizes those costs to a geographic region of the United States. In eCOMET®, each building or site is assigned a City Cost Index, which adjusts all of the associated costs for systems, deficiencies and inventory to the local value.
Condition	Condition refers to the state of physical fitness or readiness of a facility system or system element for its intended use.
Condition Budget	The Condition Budget, also known as Condition Needs, represents the budgeted contractor installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging the work.

School Assessment Report - Cascade Elementary School

Condition Index (CI) %	The Condition Index (CI) also known as the Remaining Service Life Index (RSLI) is calculated as the sum of a renewable system's Remaining Service Life (RSL) Value divided by the sum of a system's Replacement Value (both values exclude soft cost to simplify calculation updates) expressed as a percentage ranging from 100.00% (new) to 0.00% (expired - no remaining life).
Correction	Correction refers to an assessor's recommended deficiency repair or replacement action. For any system or element deficiency, there can be multiple and alternative solutions for its repair or replacement. A Correction is user defined and tied to a UNIFORMAT II element, or system it is intended to address. It excludes other peripheral costs that may also be included in the packaging of repair, replacement or renewal improvements that may also be triggered by the deficiency correction.
Cost Model	A cost model is a list of facility systems which could represent the installed systems a given facility. Included in the cost model are standard unit cost estimates, gross areas, life cycles and installed dates. Also represented is the repair cost for deficient systems, replacement values. See eCOMET® cost models.
Criteria	Criteria refer to the set of requirements, guidelines or standards that are assessed and rated to develop a score.
Current Period	The Current Period is the current year plus a user defined number of forward years.
Current Replacement Value (CRV)	The Current Replacement Value (CRV) of a facility, building or system represents the hypothetical cost of rebuilding or replacing an existing facility under today's codes and construction standards, using its current configuration. It is calculated by multiplying the gross area of the facility by a square foot cost developed in that facility's cost model. Replacement cost includes construction costs and owner's additional or soft costs for fees, permits and other expenses to reflect a total project cost.
Deferred Maintenance	Deferred maintenance is condition work deferred on a planned or unplanned basis to a future budget cycle or postponed until funds are available.
Deficiency	A deficiency is a repair item that is damaged, missing, inadequate or insufficient for an intended purpose.
Deficiency Category	Category refers to the type or class of a user defined deficiency grouping with shared or similar characteristics. Category descriptions include, but are not limited to: Accessibility Code Compliance, Appearance, Building Code Compliance, Deferred Maintenance, Energy, Environmental, Life Safety Code Compliance, and Safety.
Deficiency Priority	Priority refers to a deficiency's urgency for repair as determined by the assessment team. Five typical industry priority settings were used for the assessment: Priority 1 – Currently Critical; Priority 2 – Potentially Critical; Priority 3 – Necessary/Not Yet Critical; Priority 4 – Recommended.
Distress	Distress refers to a user-defined root cause of a deficiency. Distress descriptions are: Beyond Service Life, Damaged, Inadequate, Needs Remediation, and Missing.
eCOMET®	Energy and Condition Management Estimation Technology (eCOMET®) is Parsons proprietary facility asset management software developed to provide facility managers with a state of the art, web-based tool to develop and maintain a comprehensive database of FCA data and information used for facility asset management, maintenance and repair, and capital renewal planning. eCOMET® is used by Parsons and its clients as the primary tool for collecting FCA data, preparing cost estimates, generating individual facility reports and cost estimates, and developing the overall capital renewal program.
eCOMET® Cost Models	eCOMET cost models are derived from RS Means Square Foot Cost Data cost models and these models are used to develop the current replacement value (CRV) and assign life cycle costs to the various systems within a building. Cost models are assigned current costs-per-square-foot to establish replacement values. The Cost models are designed to represent a client specific facility that meets local standards cost trends.

School Assessment Report - Cascade Elementary School

Element	Elements are the major components that comprise building systems as defined by UNIFORMAT II.
Expected Life	Also referred to as Useful Life. See Useful Life definition.
Facility	A facility refers to site(s) building(s) or building addition(s) or combinations thereof that provide a particular service.
Facility Attributes	Customizable eCOMET fields to identify attributes specific to a facility. These fields are part of the eCOMET database set-up with the owner.
Facility Condition Assessment (FCA)	A facility condition assessment (FCA) is a visual inspection of buildings and grounds at a facility to identify and estimate current and future needed repairs or replacements of major systems for planning and budgeting purposes. It is typically performed for organizations that are tasked with the day to day maintenance, operation, and capital renewal (replacement) of building systems and components of a large inventory of facilities. The primary goal of an FCA is to objectively and quantifiably identify, inspect, and prioritize the repair and replacement needs of the building and ground systems (e.g., roofs, windows, doors, floor finishes, plumbing fixtures, parking lot, and sidewalks) within facilities that have either failed or have surpassed their service life, and to identify and forecast future capital replacement needs for systems that have not yet failed, but planned replacement of those systems is needed to ensure that the facilities will continue to meet the mission of the organization.
Facility Condition Index (FCI%)	FCI is an industry-standard measurement of a facility's condition that is the ratio of the cost to correct a facility's deficiencies to the Current Replacement Value of the facilities. The higher the FCI the poorer the condition of a facility. After an FCI is established for all buildings within a portfolio a building's condition can be ranked relative to other buildings. The FCI may also represent the condition of a portfolio based on the cumulative FCIs of the portfolio's facilities.
Forecast Period	The Forecast Period refers to a user defined number of years forward of the Current Period.
Gen (Generate)	The Cost Model has a Gen box for each system line item. By checking the box, eCOMET will generate life cycle deficiencies based on the Year Installed and the Life for that system. Systems that typically do not re-generate (foundations, floor construction, roof construction, basement walls, etc.) would not have the Gen box checked as those systems would not re-generate at the end of a life cycle. In those instances, it would be more practical and cost effective to demolish the entire facility than re-new those systems.
Gross Square Feet (GSF)	The size of the enclosed floor space of a building in square feet measured to the outside face of the enclosing wall.
Life Cycle	Life cycle refers to the period of time that a building or site system or element can be expected to adequately serve its intended function. Parsons assigns expected life cycles to all building systems based on Building Operators and Managers of America (BOMA) recommended life cycles, manufacturers suggested life, and RS Means cost data, and client-provided historical data. BOMA standards are a nationally recognized source of life cycle data for various components and/or systems associated with facilities. RS Means is a national company specializing in construction estimating and costs.
Next Renewal	Next Renewal refers to a manually-adjusted expected useful life of a system or element based on on-site inspection either by reducing or extending the Calculated Next Renewal to more accurately reflect current conditions.
Order of Magnitude	Order of Magnitude refers to a rough approximation made with a degree of knowledge and confidence that the budgeted, projected or estimated cost falls within a reasonable range of cost values.
Remaining Service Life (RSL)	RSL is the number of years service remaining for a system or equipment item. It is automatically calculated based on the difference between the current year and the 'Calculated Next Renewal' date or the 'Next Renewal' date whichever one is the later date.

School Assessment Report - Cascade Elementary School

Remaining Service Life Index (RSLI)	The Remaining Service Life Index (RSLI), also known as the Condition Index (CI), is calculated as the sum of a renewable system's or component's Remaining Service Life (RSL) Value divided by the sum of a system's or component's Replacement Value (both values exclude softcost to simplify calculation updates) expressed as a percentage ranging from 100.00% (new) to 0.00% (expired - no remaining service life).
Remaining Service Life Value	Remaining Service Life Value, also known as the RSL Weight, is a calculated value used to determine the RSLI and is equal to the system Value (Unit Cost * Qty) * RSL (not displayed).
Renewal Factors	Renewal factors represent the difference in cost of renovating or replacing an existing system, rather than new construction of a building system. For example, installing a new built-up roof on an existing building would include removing and disposing of the old roof, a cost not associated with new construction. Using a renewal premium to account for demolition and other difficulty costs, Parsons typically assigns a renewal factor of 110%.
Renewal Schedule	A timeline that provides the items that need repair the year in which the repair is needed and the estimated price of the renewal.
Repair Cost	Repair cost is the sum of all the deficiencies associated with a building or multiple buildings/facilities. It will include any applied soft costs or City Cost Indexes.
Replacement Value	See Current Replacement Value.
Site	A facility's grounds and its utilities, roadways, landscaping, fencing and other typical land improvements needed to support a facility.
Soft Costs	Soft Costs are a construction industry term that refers to expense items that are not considered direct construction costs. Soft costs are user-defined and include architectural, engineering, management, testing, and mitigation fees, and other owner pre- and post-construction expenses.
Sustainability	Sustainability refers to the collection of policies and strategies that meet society's present needs without compromising the ability of future generations to meet their own needs.
System	System refers to building and related site work elements as described by ASTM Uniformat II Classification for Building Elements (E1557-97) a format for classifying major facility elements common to most buildings. Elements usually perform a given function regardless of the design specification construction method or materials used. See also Uniformat II.
System Generated Deficiency	eCOMET automatically generates system deficiencies based on system life cycles using the systems installation dates as the base year. By adjusting the Next Renewal date ahead or behind the predicted or stated life cycle date, a system cost will come due earlier or later than the originally installed life cycle date. This utility accounts for good maintenance conditions and a longer life, or early expiration of a system life due to any number of adverse factors such as poor installation, acts of god, material defects, poor design applications and other factors that may shorten the life of a material or system. It is important to mention that the condition of the systems is not necessarily a reflection of maintenance practices, but a combination of system usage and age.
UNIFORMAT	ASTM UNIFORMAT II, Classification for Building Elements (E1557-97), a publication of the Construction Specification Institute (CSI), is a format used to classify major facility components common to most buildings. The format is based on functional elements or parts of a facility characterized by their functions without regard to the materials and methods used to accomplish them. These elements are often referred to as systems or assemblies.
Unit Price	The Unit Price (Raw) x the Additional Cost Template percentage.
Unit Price (Raw)	The actual \$/sq. ft. cost being used for the building and systems. It will include adjustments for the City Cost Index applied to the facility.

School Assessment Report - Cascade Elementary School

Useful Life	Also known as Expected Life, Useful Life refers to the intrinsic period of time a system or element is expected to perform as intended. Useful life is generally provided by manufacturers of materials, systems and elements through their literature, testing and experience. Useful Lives in the database are derived from the Building Owners and Managers (BOMA) organization's guidelines, RSMeans cost data, and from client- defined historical experience.
Vacant	Vacant refers to a facility that is not occupied but is a maintained facility. See Abandoned.
Year Built	The year that a building or addition was originally built based on substantial completion or occupancy.
Year Installed	The year a system or element was built or the most recent major renovation date where a minimum of 70% of the system's Current Replacement Value (CRV) was replaced.



Suitability Report - Full

Project #: 12382	County: Atlanta Public Schools	Site #: 1629
Project: APS Assessments 2019	Region: 761	Site: Cascade ES
Grade Config: PK-5	Site Type: Elementary	Site Size: 9.00

Suitability	Rating	Score	Possible Score	Percent Score
Suitability - ES				
Learning Environment				
Learning Style Variety	Good	4.00	5.00	80.00
Interior Environment	Good	1.60	2.00	80.00
Exterior Environment	Good	1.20	1.50	80.00
General Classrooms				
Environment	Excel	4.65	4.65	100.00
Size	Excel	11.63	11.63	100.00
Location	Excel	3.49	3.49	100.00
Storage/Fixed Equip	Excel	3.49	3.49	100.00
Kindergarten				
Environment	Excel	0.42	0.42	100.00
Size	Excel	1.04	1.04	100.00
Location	Excel	0.31	0.31	100.00
Storage/Fixed Equip	Excel	0.31	0.31	100.00
ECE				
Environment	Excel	0.50	0.50	100.00
Size	Excel	1.25	1.25	100.00
Location	Excel	0.37	0.37	100.00
Storage/Fixed Equip	Excel	0.37	0.37	100.00
Self-Contained Special Ed				
Environment	Excel	0.48	0.48	100.00
Size	Excel	1.20	1.20	100.00
Location	Excel	0.36	0.36	100.00
Storage/Fixed Equip	Excel	0.36	0.36	100.00
Instructional Resource Rooms				
Environment	Excel	0.72	0.72	100.00
Size	Good	1.44	1.80	80.00
Location	Excel	0.54	0.54	100.00
Storage/Fixed Equip	Excel	0.54	0.54	100.00
Science				
Environment	Excel	0.40	0.40	100.00
Size	Excel	1.00	1.00	100.00
Location	Excel	0.30	0.30	100.00
Storage/Fixed Equip	Good	0.24	0.30	80.00
Music				
Environment	Excel	0.74	0.74	100.00

Project #: 12382

County: Atlanta Public Schools

Site #: 1629

Project: APS Assessments 2019

Region: 761

Site: Cascade ES

Grade Config: PK-5

Site Type: Elementary

Site Size: 9.00

Suitability	Rating	Score	Possible Score	Percent Score
Size	Excel	1.85	1.85	100.00
Location	Excel	0.56	0.56	100.00
Storage/Fixed Equip	Excel	0.56	0.56	100.00
Art				
Environment	Excel	0.47	0.47	100.00
Size	Excel	1.17	1.17	100.00
Location	Excel	0.35	0.35	100.00
Storage/Fixed Equip	Good	0.28	0.35	80.00
Maker Space				
Environment	(N/A)	0.00	0.00	0.00
Size	(N/A)	0.00	0.00	0.00
Location	(N/A)	0.00	0.00	0.00
Storage/Fixed Equip	(N/A)	0.00	0.00	0.00
Computer Labs				
Environment	(N/A)	0.00	0.00	0.00
Size	(N/A)	0.00	0.00	0.00
Location	(N/A)	0.00	0.00	0.00
Storage/Fixed Equip	(N/A)	0.00	0.00	0.00
P.E.				
Environment	Good	1.54	1.92	80.00
Size	Excel	4.80	4.80	100.00
Location	Excel	1.44	1.44	100.00
Storage/Fixed Equip	Good	1.15	1.44	80.00
Performing Arts				
Environment	Excel	0.60	0.60	100.00
Size	Excel	1.51	1.51	100.00
Location	Excel	0.45	0.45	100.00
Storage/Fixed Equip	Good	0.36	0.45	80.00
Media Center				
Environment	Excel	0.97	0.97	100.00
Size	Excel	2.44	2.44	100.00
Location	Excel	0.73	0.73	100.00
Storage/Fixed Equip	Excel	0.73	0.73	100.00
Restrooms (Student)	Good	0.71	0.89	80.00
Administration	Excel	2.56	2.56	100.00
Counseling	Fair	0.19	0.29	65.00
Clinic	Excel	0.58	0.58	100.00
Staff WkRm/Toilets	Excel	1.27	1.27	100.00
Cafeteria	Excel	5.00	5.00	100.00
Food Service and Prep	Excel	6.20	6.20	100.00
Custodial and Maintenance	Excel	0.50	0.50	100.00
Outside				
Vehicular Traffic	Excel	2.00	2.00	100.00
Pedestrian Traffic	Excel	0.97	0.97	100.00
Parking	Fair	0.53	0.81	65.00
Play Areas	Excel	2.34	2.34	100.00

Project #: 12382

County: Atlanta Public Schools

Site #: 1629

Project: APS Assessments 2019

Region: 761

Site: Cascade ES

Grade Config: PK-5

Site Type: Elementary

Site Size: 9.00

Suitability	Rating	Score	Possible Score	Percent Score
Safety and Security				
Fencing	Excel	0.75	0.75	100.00
Signage & Way Finding	Poor	0.50	1.00	50.00
Ease of Supervision	Fair	1.95	3.00	65.00
Controlled Entrances	Good	0.40	0.50	80.00
Total For Site:		91.38	96.54	94.65

Comments

Suitability - ES

Cascade Elementary School is the regional center for students with physically handicapping conditions. It is in the process of applying to be an International Baccalaureate School. Cascade is a neighborhood school serving students in grades PreK through 5. Cascade was built in 1994. It is surrounded by a wooded area.

Suitability - ES->Computer Labs

The room used as a computer lab was designed to be a science classroom. It is scored under the science section. The size and space meet standard for both science and computer lab spaces.

Suitability - ES->Counseling

The counseling office is located within the media center. There is no waiting area and no easy access to student records.

Suitability - ES->Outside-->Parking

There is inadequate parking for staff and visitors. No visitor parking is marked. Overflow parking is on the street.

Suitability - ES->Safety and Security-->Signage & Way Finding

Room signage is missing or inaccurate. Outside the building there is no sign for the main entrance to the building. All four safety signs are present.

Suitability - ES->Safety and Security-->Ease of Supervision

There are blind spots in each alcove going to classrooms. The outdoor space for learning does not have cameras and is not visible to the doors.