

Atlanta Public Schools/ Therrell Cluster

Continental Colony Elementary School

Revised

School Assessment Report

November 10, 2020



Table of Contents

School Executive Summary	4
School Dashboard Summary	7
School Condition Summary	8
<u>1963_1970 Bldg 2010_2011_2012</u>	10
Executive Summary	10
Dashboard Summary	11
Condition Summary	12
Photo Album	13
Condition Detail	14
System Listing	15
System Notes	17
Renewal Schedule	30
Forecasted Sustainment Requirement	33
Condition Index Forecast by Investment Scenario	34
Deficiency Summary By System	35
Deficiency Summary By Priority	36
Deficiency By Priority Investment	37
Deficiency Summary By Category	38
Deficiency Details By Priority	39
<u>1993 Bldg 2020_2030</u>	40
Executive Summary	40
Dashboard Summary	41
Condition Summary	42
Photo Album	43
Condition Detail	44
System Listing	45
System Notes	47
Renewal Schedule	58
Forecasted Sustainment Requirement	61

School Assessment Report

Condition Index Forecast by Investment Scenario	62
Deficiency Summary By System	63
Deficiency Summary By Priority	64
Deficiency By Priority Investment	65
Deficiency Summary By Category	66
Deficiency Details By Priority	67
Site	68
Executive Summary	68
Dashboard Summary	69
Condition Summary	70
Photo Album	71
Condition Detail	72
System Listing	73
System Notes	74
Renewal Schedule	79
Forecasted Sustainment Requirement	80
Condition Index Forecast by Investment Scenario	81
Deficiency Summary By System	82
Deficiency Summary By Priority	83
Deficiency By Priority Investment	84
Deficiency Summary By Category	85
Deficiency Details By Priority	86
Glossary	87

School Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as $100 - \text{Total FCI}$ (without the %) where 100 is best and 0 is worst condition.

Gross Area (SF):	117,384
Year Built:	1963
Last Renovation:	2011
Replacement Value:	\$25,176,131
Repair Cost:	\$166,957.00
Total FCI:	0.66 %
Total RSLI:	53.68 %
FCA Score:	99.34



Description:

The Continental Colony Elementary School campus consists of (1) main school buildings located at 3181 Hogan Road, S.W., Atlanta. The original 117,384 SF campus was constructed in 1963 and additions to the main school building were constructed in 1970 and 1993. The school campus and site had a major renovation in 2011.

This report contains condition and adequacy data collected during the 2019 Facility Condition Assessment (FCA) Update. Detailed condition and deficiency statements are contained in this report for the site and building elements.

SUBSTRUCTURE

The buildings rest on slab-on grade and are assumed to have standard cast-in-place concrete foundations.

SUPERSTRUCTURE

School Assessment Report - Continental Colony Elementary School

1963_1970 Building 2010_2011_2012 The superstructure is concrete frame. Floor construction is slab on-grade. Roof construction is metal pan deck with lightweight fill. The exterior enclosure is comprised of walls of brick veneer over CMU. Exterior windows are aluminum frame mostly with fixed panes. Exterior doors are hollow metal steel mostly with glazing. Roofing is typically low slope with built-up system.

1993 Building 2020_2030 The superstructure is steel frame. Floor construction is slab on-grade. Roof construction is metal pan deck with lightweight fill. The exterior enclosure is comprised of walls of brick veneer over CMU. Exterior windows are aluminum frame with fixed panes. Exterior doors are hollow metal steel mostly with glazing. Roofing is pitched with standing seam metal.

Roof openings include a roof hatch with fixed ladder access. Most building entrances appear to comply with ADA requirements.

INTERIORS

Interior partitions are typically CMU. Interior doors are generally solid core wood with metal frames and mostly with glazing. Interior fittings include the following items: white boards, graphics and identifying devices, lockers, toilet accessories, storage shelving, handrails, fabricated toilet partitions. The interior wall finishes are typically painted CMU. Floor finishes in common areas are typically vinyl composition tile. Floor finishes in consist of vinyl composition tile, ceramic tile for restrooms, neoprene for multipurpose facilities, and carpet for the administration and Media Center. Ceiling finishes in common areas are typically suspended acoustical tile. Ceiling finishes in assignable areas are typically painted drywall.

SERVICES CONVEYING:

The school has an elevator and wheelchair lift in the main building.

PLUMBING:

Plumbing fixtures are typically low-flow water fixtures with manual control valves. Domestic water distribution is combination of copper and galvanized steel with electric hot water heating. Sanitary waste system is cast iron. Rainwater drainage system on most buildings is a combination of internal and external roof drains.

HVAC:

Cooling is provided by a cooling tower chiller system and heating is provided by gas fired boilers. Additionally, ground level and rooftop package DX units are utilized for heating and cooling. The heating/cooling distribution system is a ductwork system utilizing air handling units. Ceiling mounted exhaust fans are installed in bathrooms and other required areas. Controls and instrumentation are digital and are centrally controlled by an energy management system. This building has a remote Building Automation System.

FIRE PROTECTION:

The buildings do have a fire sprinkler system. Also, fire extinguishers and cabinets are distributed near fire exits and corridors.

ELECTRICAL:

The main electrical service is fed from a pad mounted transformer to the main switchboard/distribution panel located in the building. Lighting is lay-in type, fluorescent light fixtures. Branch circuit wiring is typically copper serving electrical switches and receptacles. Emergency and life safety egress lighting systems are installed and exit signs are present at exit doors and are typically illuminated.

COMMUNICATIONS AND SECURITY:

The fire alarm system consists of audible/visual strobe annunciators in common spaces, and interior corridors. The system is activated by manual pull stations and smoke detectors and the system is centrally monitored. The telephone and data systems are segregated and include dedicated equipment closets. This building does have a local area network (LAN). The building includes an internal security system that is actuated by the following items: contacts, infrared, optical or a combination of all devices. The building has controlled entry doors access provided by card readers; entry doors are secured with magnetic door locks. The security system has CCTV cameras and is centrally monitored; this building has a public address and paging system combined with the telephone system.

OTHER ELECTRICAL SYSTEMS:

School Assessment Report - Continental Colony Elementary School

This school does have a natural gas emergency generator on-site.

EQUIPMENT & FURNISHINGS

This school includes the following items and equipment: fixed food service, library equipment, audio-visual equipment, athletic equipment, fixed furnishings, and computers.

SITE

Campus site features include paved driveways and parking lots, pedestrian pavement, covered walkways, flagpole, landscaping, playground equipment, and fencing. Site mechanical and electrical features include water, sewer, natural gas, and site lighting.

CODE REVIEW

ACCESSIBILITY:

The buildings are generally in compliance with applicable ADA requirements with respect to path of travel, interior and exterior doors, interior signage, and toilet room dimensions, fixtures, and fittings. Most building entrances appear to comply with ADA requirements.

LIFE-SAFETY SYSTEMS:

The buildings are covered with a wet sprinkler system. Fire extinguishers are located throughout the buildings. Power outlets in wet areas are GFIC protected. The fire alarm system includes detection devices, audio/visual alarms, and pull stations. Emergency/egress lighting is a combination of battery and special circuit systems. Illuminated exit signage is present in corridors and at exit doors.

Attributes:

General Attributes:


Arch Condition Assessor:	Jejuan Hall	MEP Condition Assessor:	Hayden Collins
School Grades:	01, 02, 03, 04, 05, KK, PK	DOE Drawing Total GSF:	117384
DOE Facility Number:	3057	Total # of Modular/Portables:	0
DOE Interior Site SF:	117384	Total GSF of Modular/Portables:	0
Approx. Acres:	8.7	Status:	Active

School Dashboard Summary


Gross Area: 117,384
 Year Built: 1963
 Repair Cost: \$166,957
 FCI: 0.66 %

Last Renovation: 2011
 Replacement Value: \$25,176,131
 RSLI%: 53.68 %


Deficiency By Category

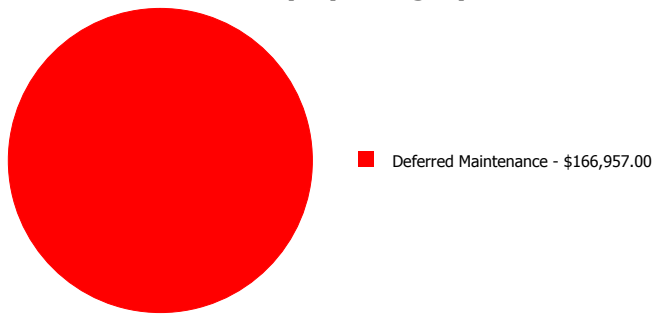


Deficiency By Priority

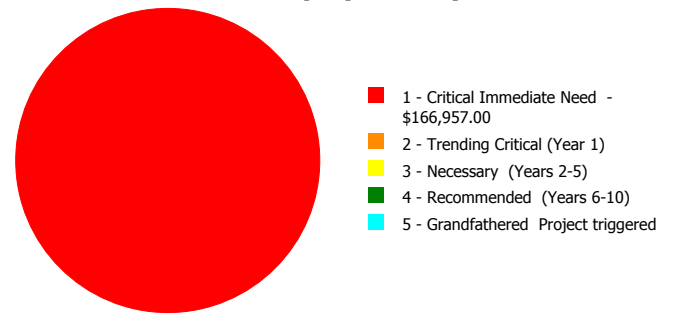

Deficiency By System

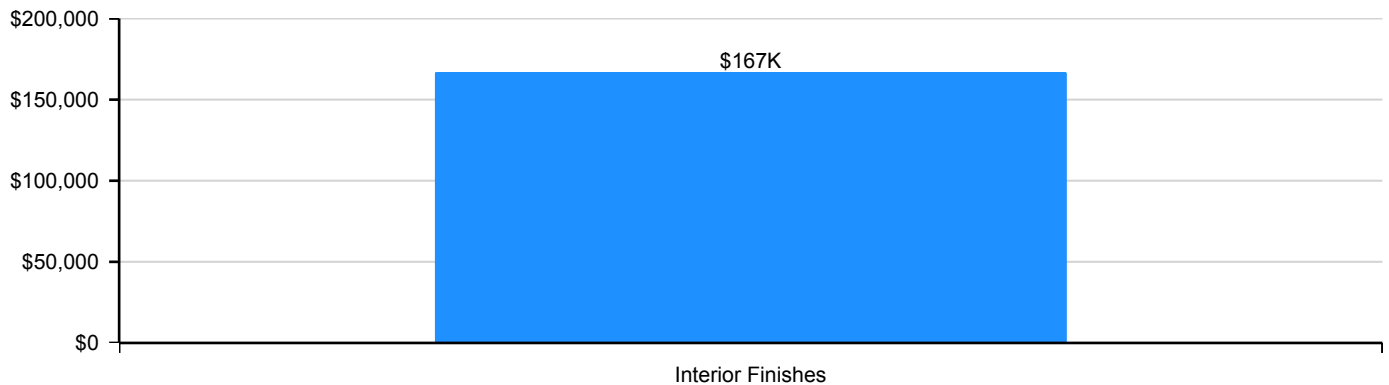

10 Year Investment Forecast

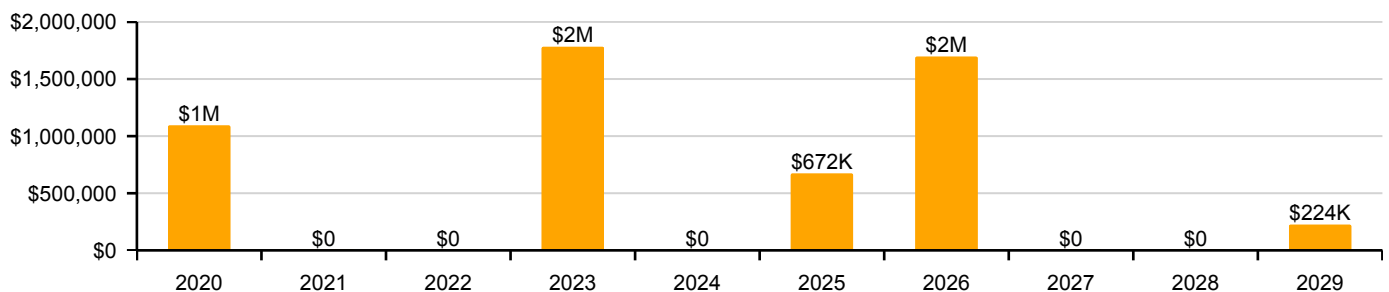

School Condition Summary

The Table below shows the RSLI and FCI for each major system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.


Current Investment Requirement and Condition by Unifomat Classification

UNIFORMAT Classification	RSLI%	FCI %	Current Repair
A10 - Foundations	50.41 %	0.00 %	\$0.00
A20 - Basement Construction	44.00 %	0.00 %	\$0.00
B10 - Superstructure	46.88 %	0.00 %	\$0.00
B20 - Exterior Enclosure	35.30 %	0.00 %	\$0.00
B30 - Roofing	12.34 %	0.00 %	\$0.00
C10 - Interior Construction	61.60 %	0.00 %	\$0.00
C20 - Stairs	50.41 %	0.00 %	\$0.00
C30 - Interior Finishes	54.76 %	8.15 %	\$166,957.00
D10 - Conveying	60.00 %	0.00 %	\$0.00
D20 - Plumbing	63.70 %	0.00 %	\$0.00
D30 - HVAC	56.95 %	0.00 %	\$0.00
D40 - Fire Protection	70.43 %	0.00 %	\$0.00
D50 - Electrical	60.94 %	0.00 %	\$0.00
E10 - Equipment	65.37 %	0.00 %	\$0.00
E20 - Furnishings	60.00 %	0.00 %	\$0.00
G20 - Site Improvements	74.93 %	0.00 %	\$0.00
G30 - Site Mechanical Utilities	48.00 %	0.00 %	\$0.00
G40 - Site Electrical Utilities	52.29 %	0.00 %	\$0.00
Totals:	53.68 %	0.66 %	\$166,957.00

Condition Deficiency Priority

Facility Name	Gross Area (S.F.)	FCI %	1 - Critical Immediate Need	2 - Trending Critical (Year 1)	3 - Necessary (Years 2-5)	4 - Recommended (Years 6-10)	5 - Grandfathered Project triggered
1963_1970 Bldg 2010_2011_2012	94,537	0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
1993 Bldg 2020_2030	22,847	4.15	\$166,957.00	\$0.00	\$0.00	\$0.00	\$0.00
Site	117,384	0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Total:		0.66	\$166,957.00	\$0.00	\$0.00	\$0.00	\$0.00

Deficiencies By Priority

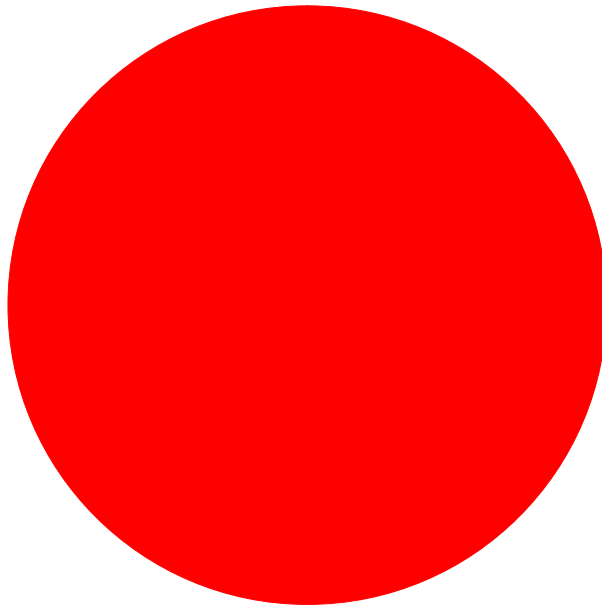

- 1 - Critical Immediate Need - \$166,957.00
- 2 - Trending Critical (Year 1)
- 3 - Necessary (Years 2-5)
- 4 - Recommended (Years 6-10)
- 5 - Grandfathered Project triggered

Budget Estimate Total: \$166,957.00

Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as $100 - \text{Total FCI}$ (without the %) where 100 is best and 0 is worst condition.

Function:	Elementary
Gross Area (SF):	94,537
Year Built:	1963
Last Renovation:	2011
Replacement Value:	\$17,491,890
Repair Cost:	\$0.00
Total FCI:	0.00 %
Total RSLI:	50.09 %
FCA Score:	100.00



Description:

The narrative for this building is included in the Executive Summary Description at the front of this report.

Attributes: This asset has no attributes.

Dashboard Summary


Function:	Elementary	Gross Area:	94,537
Year Built:	1963	Last Renovation:	2011
Repair Cost:	\$0	Replacement Value:	\$17,491,890
FCI:	0.00 %	RSLI%:	50.09 %

No data found for this asset

No data found for this asset

No data found for this asset

10 Year Investment Forecast

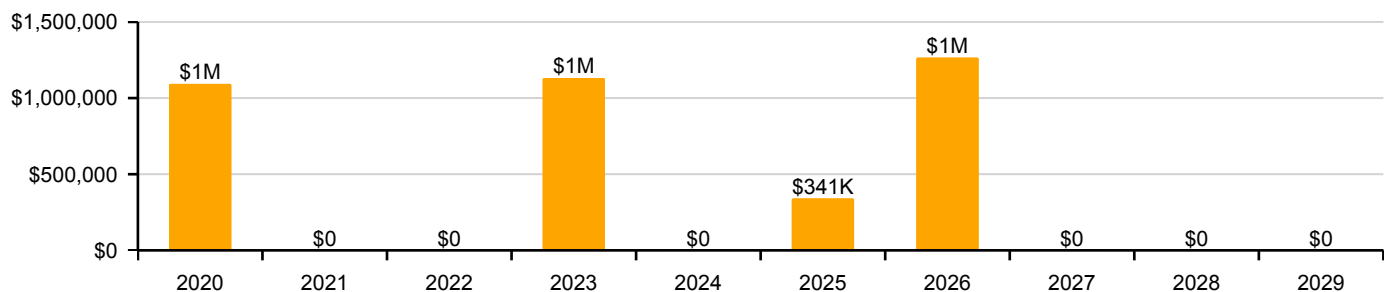

Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

UNIFORMAT Classification	RSLI %	FCI %	Current Repair Cost
A10 - Foundations	44.00 %	0.00 %	\$0.00
A20 - Basement Construction	44.00 %	0.00 %	\$0.00
B10 - Superstructure	44.00 %	0.00 %	\$0.00
B20 - Exterior Enclosure	31.50 %	0.00 %	\$0.00
B30 - Roofing	9.25 %	0.00 %	\$0.00
C10 - Interior Construction	58.58 %	0.00 %	\$0.00
C20 - Stairs	44.00 %	0.00 %	\$0.00
C30 - Interior Finishes	59.62 %	0.00 %	\$0.00
D10 - Conveying	60.00 %	0.00 %	\$0.00
D20 - Plumbing	63.71 %	0.00 %	\$0.00
D30 - HVAC	57.13 %	0.00 %	\$0.00
D40 - Fire Protection	69.78 %	0.00 %	\$0.00
D50 - Electrical	60.96 %	0.00 %	\$0.00
E10 - Equipment	60.00 %	0.00 %	\$0.00
E20 - Furnishings	60.00 %	0.00 %	\$0.00
Totals:	50.09 %	0.00 %	\$0.00

Photo Album

The photo album consists of the various cardinal compass directions of the building..

1). West Elevation - Feb 07, 2020



2). South Elevation - Feb 07, 2020



3). East Elevation - Feb 07, 2020



4). North Elevation - Feb 07, 2020



Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment)
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system as new construction.

System Listing

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
A1010	Standard Foundations	\$7.67	S.F.	94,537	100	1963	2063		44.00 %	0.00 %	44			\$725,099
A1030	Slab on Grade	\$6.48	S.F.	94,537	100	1963	2063		44.00 %	0.00 %	44			\$612,600
A2010	Basement Excavation	\$0.21	S.F.	94,537	100	1963	2063		44.00 %	0.00 %	44			\$19,853
A2020	Basement Walls	\$2.43	S.F.	94,537	100	1963	2063		44.00 %	0.00 %	44			\$229,725
B1010	Floor Construction	\$18.95	S.F.	94,537	100	1963	2063		44.00 %	0.00 %	44			\$1,791,476
B1020	Roof Construction	\$12.24	S.F.	94,537	100	1963	2063		44.00 %	0.00 %	44			\$1,157,133
B2010	Exterior Walls	\$12.98	S.F.	94,537	100	1963	2063		44.00 %	0.00 %	44			\$1,227,090
B2020	Exterior Windows	\$8.13	S.F.	94,537	30	1993	2023		13.33 %	0.00 %	4			\$768,586
B2030	Exterior Doors	\$0.80	S.F.	94,537	30	1993	2023		13.33 %	0.00 %	4			\$75,630
B3010105	Built-Up	\$7.15	S.F.	94,537	20	2000	2020		5.00 %	0.00 %	1			\$675,940
B3020	Roof Openings	\$0.50	S.F.	94,537	30	2010	2040		70.00 %	0.00 %	21			\$47,269
C1010	Partitions	\$5.51	S.F.	94,537	100	1963	2063		44.00 %	0.00 %	44			\$520,899
C1020	Interior Doors	\$3.58	S.F.	94,537	40	2011	2051		80.00 %	0.00 %	32			\$338,442
C1030	Fittings	\$2.61	S.F.	94,537	20	2011	2031		60.00 %	0.00 %	12			\$246,742
C2010	Stair Construction	\$2.81	S.F.	94,537	100	1963	2063		44.00 %	0.00 %	44			\$265,649
C3010220	Tile	\$9.25	S.F.	10,000	25	2010	2035		64.00 %	0.00 %	16			\$92,500
C3010230	Paint & Covering	\$1.47	S.F.	84,537	10	2016	2026		70.00 %	0.00 %	7			\$124,269
C3020420	Ceramic Tile	\$16.74	S.F.	10,000	50	2010	2060		82.00 %	0.00 %	41			\$167,400
C3020901	Carpet	\$6.99	S.F.	10,000	8	2015	2023		50.00 %	0.00 %	4			\$69,900
C3020903	VCT	\$3.48	S.F.	74,537	15	2010	2025		40.00 %	0.00 %	6			\$259,389
C3030	Ceiling Finishes	\$8.89	S.F.	94,537	20	2011	2031		60.00 %	0.00 %	12			\$840,434
D1010	Elevators and Lifts	\$1.41	S.F.	94,537	20	2011	2031		60.00 %	0.00 %	12			\$133,297
D2010	Plumbing Fixtures	\$6.49	S.F.	94,537	20	2011	2031		60.00 %	0.00 %	12			\$613,545
D2020	Domestic Water Distribution	\$0.75	S.F.	94,537	30	2011	2041		73.33 %	0.00 %	22			\$70,903
D2030	Sanitary Waste	\$1.75	S.F.	94,537	30	2011	2041		73.33 %	0.00 %	22			\$165,440
D3010	Energy Supply	\$0.61	S.F.	94,537	30	2011	2041		73.33 %	0.00 %	22			\$57,668
D3020	Heat Generating Systems	\$3.69	S.F.	94,537	20	2011	2031		60.00 %	0.00 %	12			\$348,842
D3030	Cooling Generating Systems	\$6.25	S.F.	94,537	20	2011	2031		60.00 %	0.00 %	12			\$590,856
D3040	Distribution Systems	\$14.21	S.F.	94,537	20	2011	2031		60.00 %	0.00 %	12			\$1,343,371
D3050	Terminal & Package Units	\$5.32	S.F.	94,537	15	2011	2026		46.67 %	0.00 %	7			\$502,937
D3060	Controls & Instrumentation	\$2.26	S.F.	94,537	15	2011	2026		46.67 %	0.00 %	7			\$213,654
D4010	Sprinklers	\$4.15	S.F.	94,537	30	2011	2041		73.33 %	0.00 %	22			\$392,329

School Assessment Report - 1963_1970 Bldg 2010_2011_2012

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
D4020	Standpipes	\$0.34	S.F.	94,537	30	2011	2041		73.33 %	0.00 %	22			\$32,143
D4030	Fire Protection Specialties	\$0.09	S.F.	94,537	15	2011	2026		46.67 %	0.00 %	7			\$8,508
D4090	Other Fire Protection Systems	\$0.60	S.F.	94,537	15	2011	2026		46.67 %	0.00 %	7			\$56,722
D5010	Electrical Service/Distribution	\$2.29	S.F.	94,537	20	2011	2031		60.00 %	0.00 %	12			\$216,490
D5020	Branch Wiring	\$5.69	S.F.	94,537	20	2011	2031		60.00 %	0.00 %	12			\$537,916
D5020	Lighting	\$9.34	S.F.	94,537	20	2011	2031		60.00 %	0.00 %	12			\$882,976
D5030810	Security & Detection Systems	\$1.51	S.F.	94,537	20	2011	2031		60.00 %	0.00 %	12			\$142,751
D5030910	Fire Alarm Systems	\$2.74	S.F.	94,537	20	2011	2031		60.00 %	0.00 %	12			\$259,031
D5030920	Data Communication	\$3.56	S.F.	94,537	25	2011	2036		68.00 %	0.00 %	17			\$336,552
D5090	Other Electrical Systems	\$0.31	S.F.	94,537	15	2011	2026		46.67 %	0.00 %	7			\$29,306
E1020	Institutional Equipment	\$0.10	S.F.	94,537	20	2011	2031		60.00 %	0.00 %	12			\$9,454
E1090	Other Equipment	\$0.89	S.F.	94,537	20	2011	2031		60.00 %	0.00 %	12			\$84,138
E2010	Fixed Furnishings	\$2.19	S.F.	94,537	20	2011	2031		60.00 %	0.00 %	12			\$207,036
Total									50.09 %					\$17,491,890

System Notes

The facility description in the executive summary contains an overview of each system. The system notes listed below provide additional information on select systems found within the facility.

System: B2010 - Exterior Walls




Note:

System: B2020 - Exterior Windows



Note:

System: B2030 - Exterior Doors

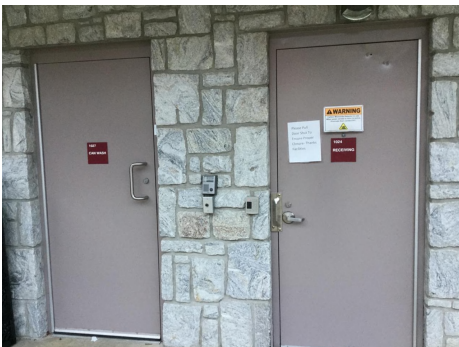

Note:

School Assessment Report - 1963_1970 Bldg 2010_2011_2012

System: B3010105 - Built-Up




Note:

System: B3020 - Roof Openings



Note:

System: C1010 - Partitions

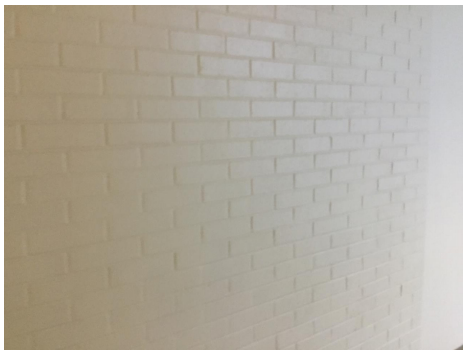

Note:


School Assessment Report - 1963_1970 Bldg 2010_2011_2012

System: C1020 - Interior Doors



Note:

System: C1030 - Fittings

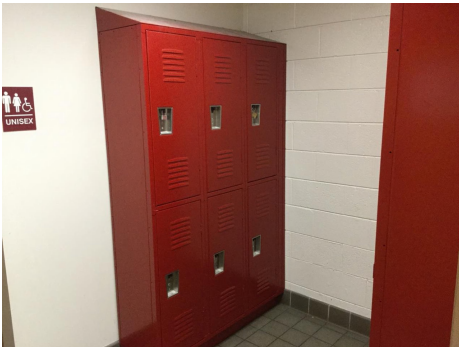

Note:



System: C2010 - Stair Construction



Note:



School Assessment Report - 1963_1970 Bldg 2010_2011_2012

System: C3010220 - Tile

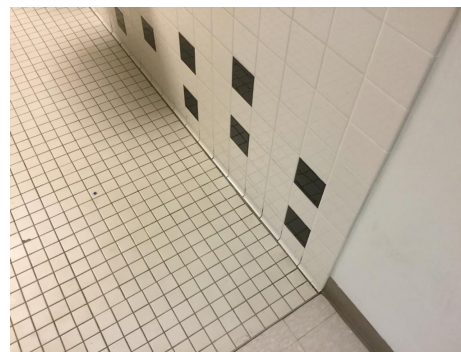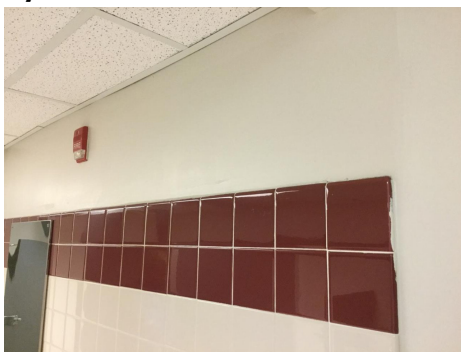


Note:

System: C3010230 - Paint & Covering

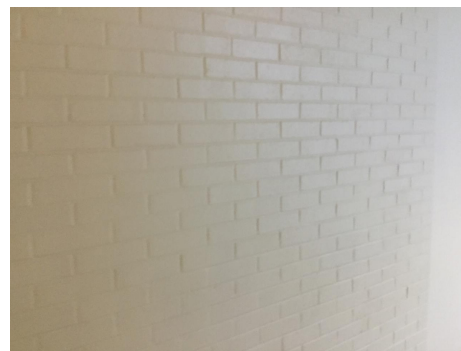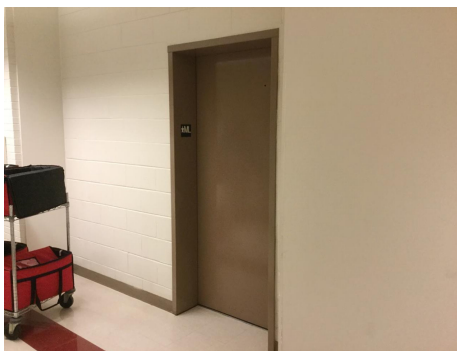

Note:


System: C3020420 - Ceramic Tile

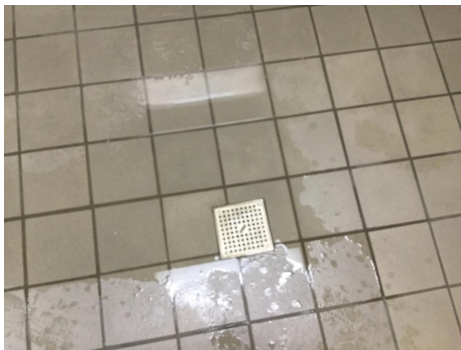

Note:

School Assessment Report - 1963_1970 Bldg 2010_2011_2012

System: C3020901 - Carpet

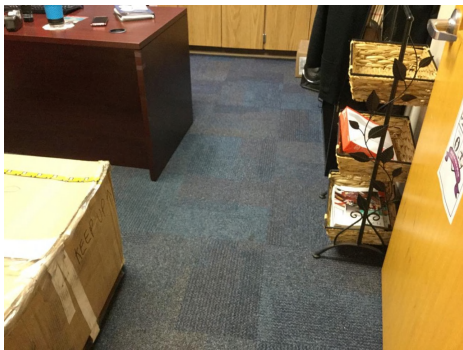

Note:

System: C3020903 - VCT



Note:


System: C3030 - Ceiling Finishes



Note:


School Assessment Report - 1963_1970 Bldg 2010_2011_2012

System: D1010 - Elevators and Lifts

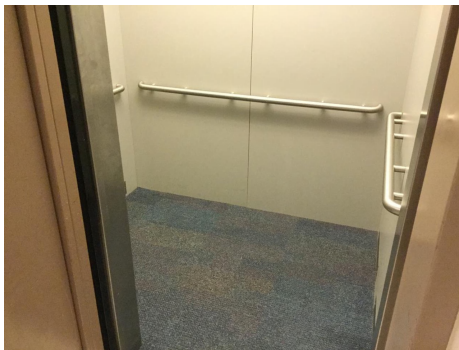

Note:

System: D2010 - Plumbing Fixtures

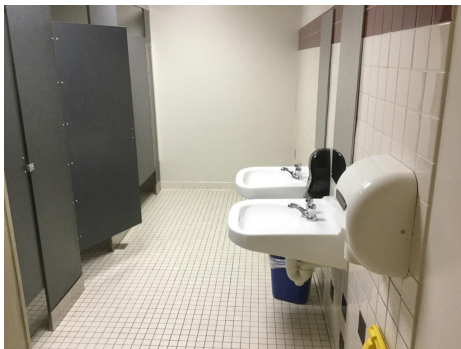

Note:

System: D2020 - Domestic Water Distribution



Note:

School Assessment Report - 1963_1970 Bldg 2010_2011_2012

System: D2030 - Sanitary Waste



Note:

System: D3010 - Energy Supply



Note:


System: D3020 - Heat Generating Systems



Note:

School Assessment Report - 1963_1970 Bldg 2010_2011_2012

System: D3030 - Cooling Generating Systems

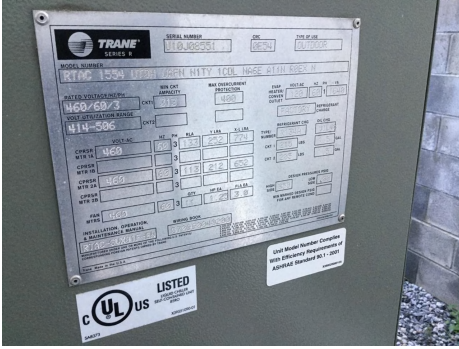

Note:

System: D3040 - Distribution Systems



Note:

System: D3050 - Terminal & Package Units



Note:



School Assessment Report - 1963_1970 Bldg 2010_2011_2012

System: D3060 - Controls & Instrumentation



Note:

System: D4010 - Sprinklers

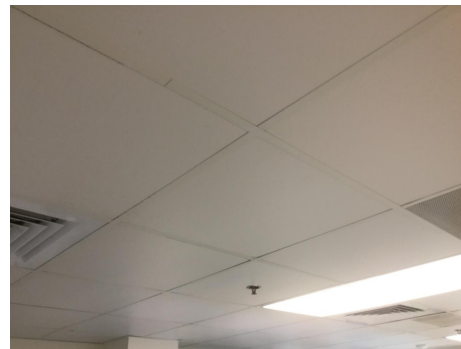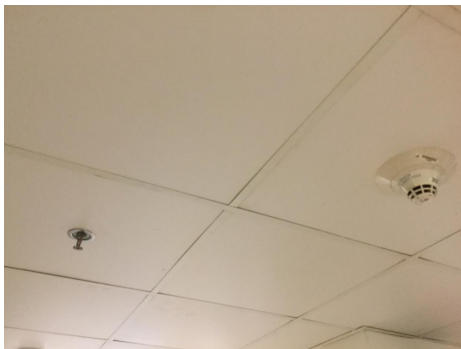

Note:

System: D4020 - Standpipes



Note:

School Assessment Report - 1963_1970 Bldg 2010_2011_2012

System: D4030 - Fire Protection Specialties



Note:

System: D4090 - Other Fire Protection Systems



Note:

System: D5010 - Electrical Service/Distribution



Note:

School Assessment Report - 1963_1970 Bldg 2010_2011_2012

System: D5020 - Branch Wiring



Note:

System: D5020 - Lighting



Note:

System: D5030810 - Security & Detection Systems



Note:

School Assessment Report - 1963_1970 Bldg 2010_2011_2012

System: D5030910 - Fire Alarm Systems



Note:

System: D5030920 - Data Communication



Note:


System: D5090 - Other Electrical Systems



Note:

School Assessment Report - 1963_1970 Bldg 2010_2011_2012

System: E1020 - Institutional Equipment

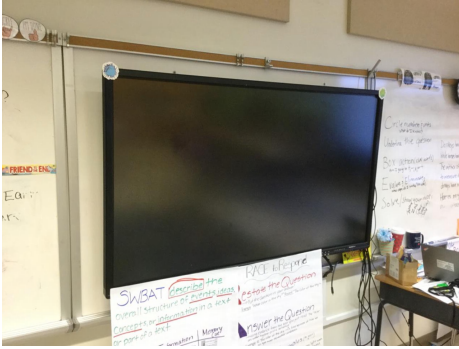

Note:

System: E1090 - Other Equipment



Note:

System: E2010 - Fixed Furnishings



Note:

Renewal Schedule

eCOMET forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the System Listing table. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.

Inflation Rate: 3%

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
Total:		\$1,093,062	\$0	\$0	\$1,131,729	\$0	\$340,697	\$1,265,461	\$0	\$0	\$0	\$3,830,949
* A - Substructure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A10 - Foundations	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A1010 - Standard Foundations	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A1030 - Slab on Grade	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A20 - Basement Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A2010 - Basement Excavation	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A2020 - Basement Walls	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B - Shell	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B10 - Superstructure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B1010 - Floor Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B1020 - Roof Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B20 - Exterior Enclosure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B2010 - Exterior Walls	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B2020 - Exterior Windows	\$0	\$0	\$0	\$0	\$951,555	\$0	\$0	\$0	\$0	\$0	\$0	\$951,555
B2030 - Exterior Doors	\$0	\$0	\$0	\$0	\$93,634	\$0	\$0	\$0	\$0	\$0	\$0	\$93,634
B30 - Roofing	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B3010 - Roof Coverings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B3010105 - Built-Up	\$0	\$1,093,062	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$1,093,062
B3020 - Roof Openings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C - Interiors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C10 - Interior Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1010 - Partitions	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1020 - Interior Doors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1030 - Fittings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C20 - Stairs	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0

School Assessment Report - 1963_1970 Bldg 2010_2011_2012

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
* C2010 - Stair Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C30 - Interior Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3010 - Wall Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3010220 - Tile	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3010230 - Paint & Covering	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$168,119	\$0	\$0	\$0	\$168,119
C3020 - Floor Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020420 - Ceramic Tile	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020901 - Carpet	\$0	\$0	\$0	\$0	\$86,540	\$0	\$0	\$0	\$0	\$0	\$0	\$86,540
C3020903 - VCT	\$0	\$0	\$0	\$0	\$0	\$0	\$340,697	\$0	\$0	\$0	\$0	\$340,697
C3030 - Ceiling Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D - Services	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D10 - Conveying	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D1010 - Elevators and Lifts	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D20 - Plumbing	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2010 - Plumbing Fixtures	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2020 - Domestic Water Distribution	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2030 - Sanitary Waste	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D30 - HVAC	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3010 - Energy Supply	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3020 - Heat Generating Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3030 - Cooling Generating Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3040 - Distribution Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3050 - Terminal & Package Units	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$680,404	\$0	\$0	\$0	\$680,404
D3060 - Controls & Instrumentation	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$289,044	\$0	\$0	\$0	\$289,044
D40 - Fire Protection	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D4010 - Sprinklers	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D4020 - Standpipes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D4030 - Fire Protection Specialties	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$11,510	\$0	\$0	\$0	\$11,510
D4090 - Other Fire Protection Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$76,737	\$0	\$0	\$0	\$76,737
D50 - Electrical	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5010 - Electrical Service/Distribution	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5020 - Branch Wiring	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0


School Assessment Report - 1963_1970 Bldg 2010_2011_2012

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
D5020 - Lighting	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030 - Communications and Security	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030810 - Security & Detection Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030910 - Fire Alarm Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030920 - Data Communication	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5090 - Other Electrical Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$39,647	\$0	\$0	\$0	\$39,647
E - Equipment & Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E10 - Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E1020 - Institutional Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E1090 - Other Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E20 - Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E2010 - Fixed Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0

* Indicates non-renewable system

Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and forecasted capital renewal (sustainment) requirements over the next ten years.

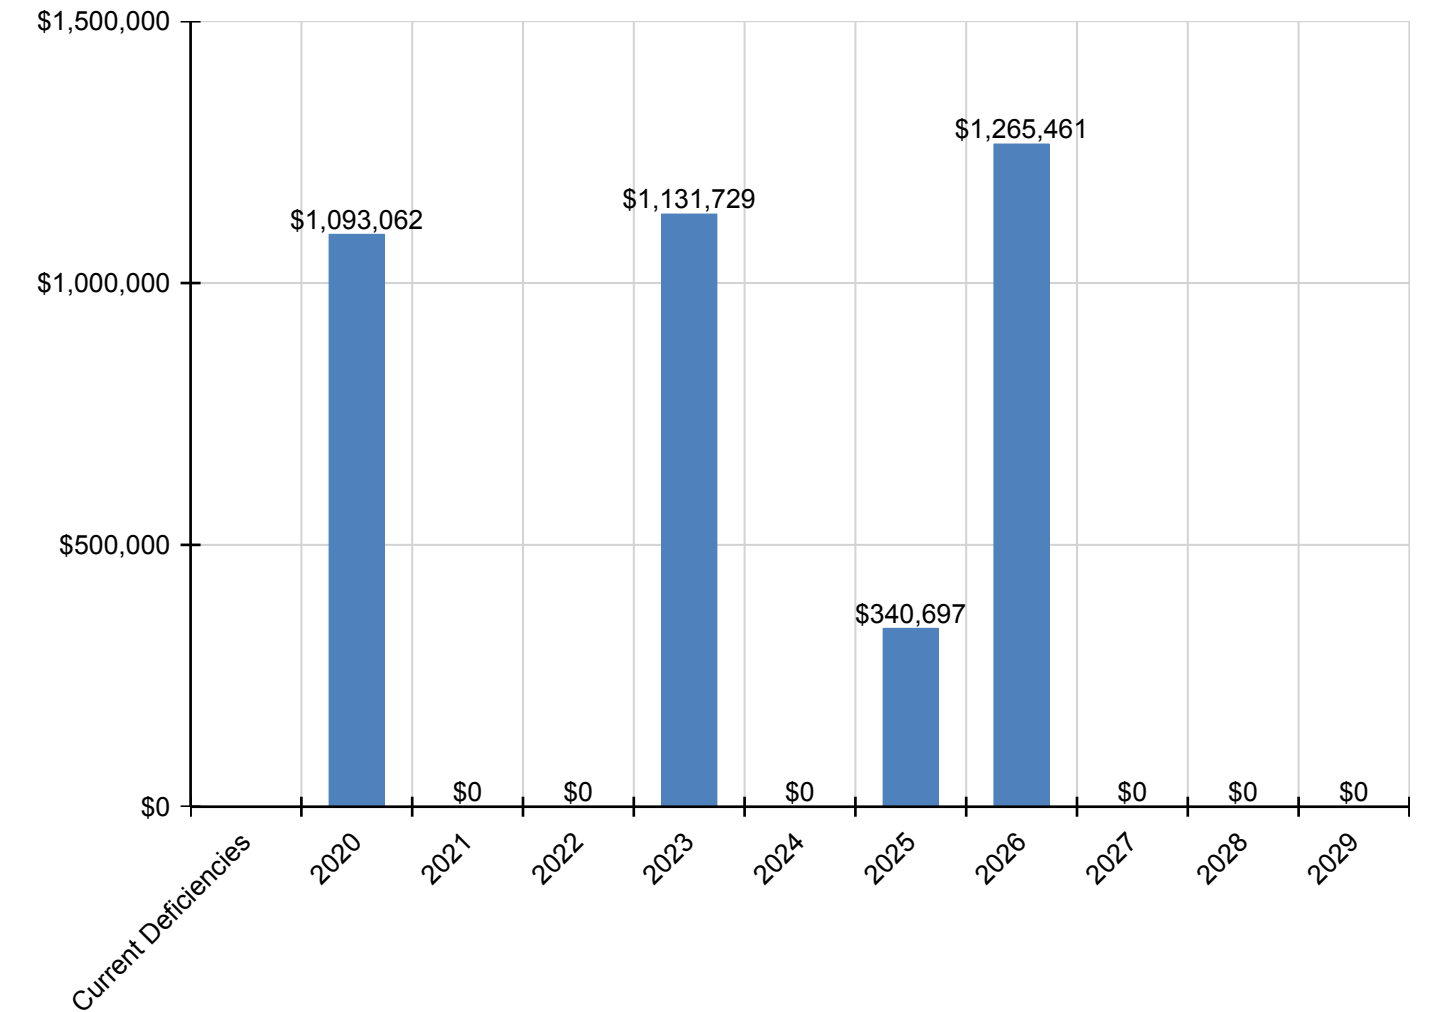


Condition Index Forecast by Investment Scenario

The chart below illustrates the effect of various investment levels on the building FCI for the next 10 years. The levels of investment shown below include:

- Current FCI: a variable investment amount based on renewing expired systems to maintain the current FCI for the building
- 2% Investment: an annual investment of 2% of the replacement value of the building, escalated for inflation
- 4% Investment: an annual investment of 4% of the replacement value of the building, escalated for inflation

Facility Investment vs. FCI Forecast

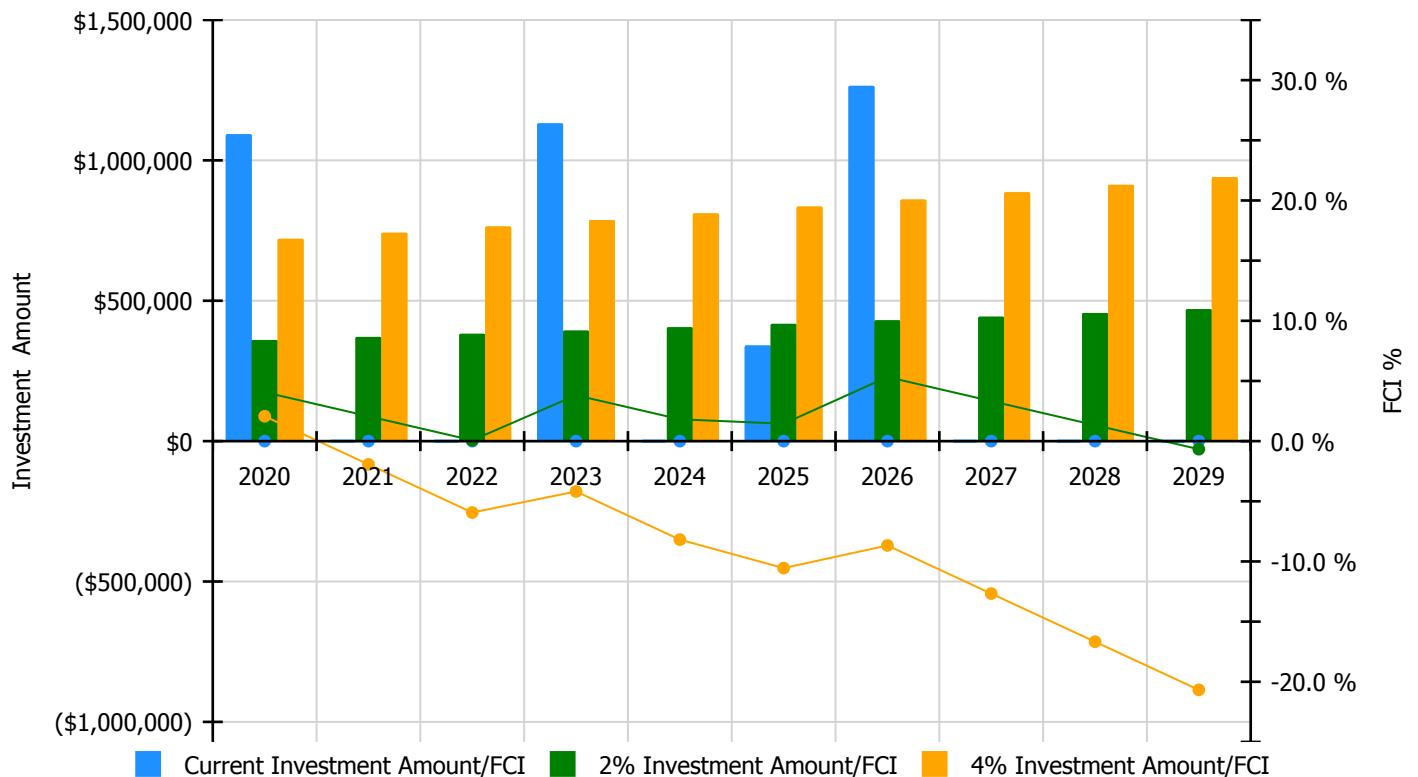

Year	Investment Amount Current FCI - 0%	2% Investment		4% Investment	
		Amount	FCI	Amount	FCI
2020	\$1,093,062	\$360,333.00	4.07 %	\$720,666.00	2.07 %
2021	\$0	\$371,143.00	2.07 %	\$742,286.00	-1.93 %
2022	\$0	\$382,277.00	0.07 %	\$764,554.00	-5.93 %
2023	\$1,131,729	\$393,746.00	3.82 %	\$787,491.00	-4.18 %
2024	\$0	\$405,558.00	1.82 %	\$811,116.00	-8.18 %
2025	\$340,697	\$417,725.00	1.45 %	\$835,449.00	-10.55 %
2026	\$1,265,461	\$430,256.00	5.33 %	\$860,513.00	-8.67 %
2027	\$0	\$443,164.00	3.33 %	\$886,328.00	-12.67 %
2028	\$0	\$456,459.00	1.33 %	\$912,918.00	-16.67 %
2029	\$0	\$470,153.00	-0.67 %	\$940,305.00	-20.67 %
Total:	\$3,830,949	\$4,130,814.00		\$8,261,626.00	

Deficiency Summary by System

Current deficiencies included assemblies that have reached or exceeded their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Useful Life'. The following chart lists all current deficiencies associated with this facility.

No data found for this asset

Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

No data found for this asset

Deficiency By Priority Investment Table

The table below shows the current investment cost grouped by deficiency priority and building system.

No data found for this asset

Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

No data found for this asset

Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

No data found for this asset

Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as $100 - \text{Total FCI}$ (without the %) where 100 is best and 0 is worst condition.

Function:	Elementary
Gross Area (SF):	22,847
Year Built:	1993
Last Renovation:	2011
Replacement Value:	\$4,019,512
Repair Cost:	\$166,957.00
Total FCI:	4.15 %
Total RSLI:	57.85 %
FCA Score:	95.85



Description:


The narrative for this building is included in the Executive Summary Description at the front of this report.

Attributes: This asset has no attributes.


Dashboard Summary

Function:	Elementary	Gross Area:	22,847
Year Built:	1993	Last Renovation:	2011
Repair Cost:	\$166,957	Replacement Value:	\$4,019,512
FCI:	4.15 %	RSLI%:	57.85 %


Deficiency By Category

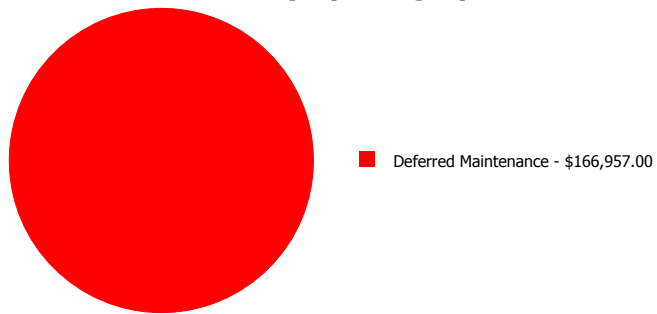


Deficiency By Priority

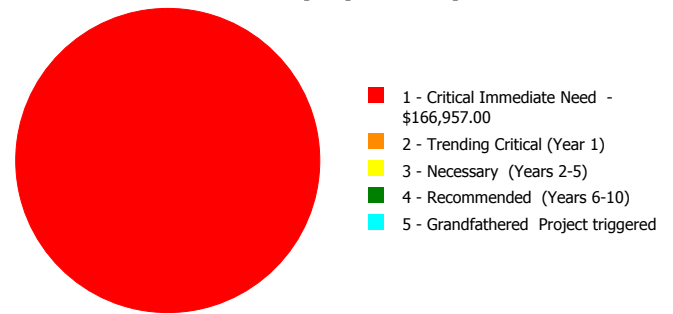

Deficiency By System

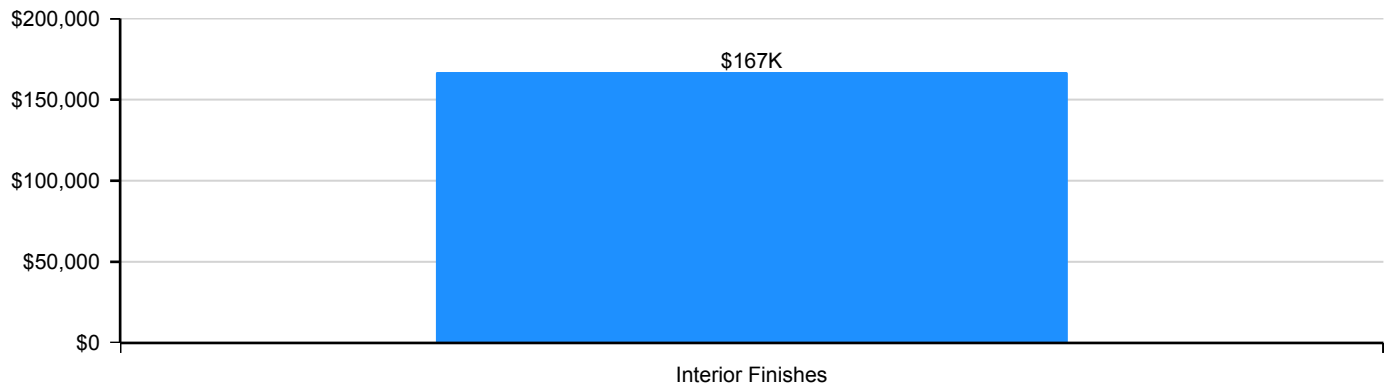

10 Year Investment Forecast

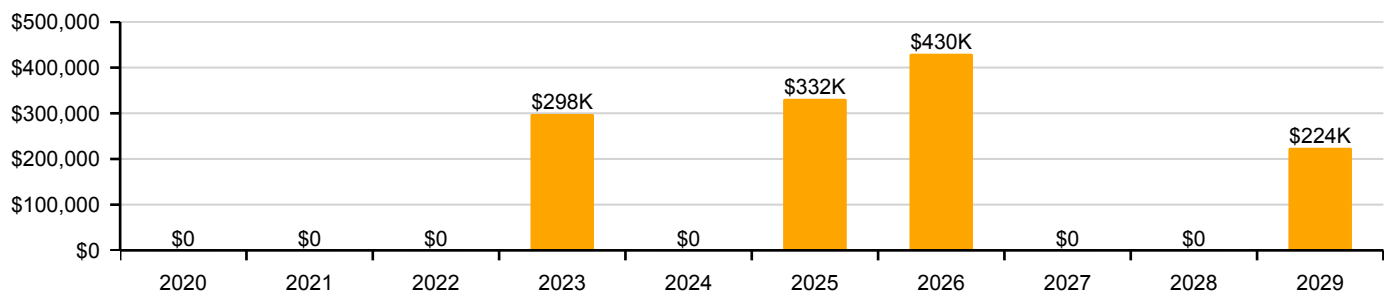

Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

UNIFORMAT Classification	RSLI %	FCI %	Current Repair Cost
A10 - Foundations	74.00 %	0.00 %	\$0.00
B10 - Superstructure	74.00 %	0.00 %	\$0.00
B20 - Exterior Enclosure	49.31 %	0.00 %	\$0.00
B30 - Roofing	23.14 %	0.00 %	\$0.00
C10 - Interior Construction	72.72 %	0.00 %	\$0.00
C20 - Stairs	74.00 %	0.00 %	\$0.00
C30 - Interior Finishes	39.49 %	33.72 %	\$166,957.00
D20 - Plumbing	63.69 %	0.00 %	\$0.00
D30 - HVAC	56.13 %	0.00 %	\$0.00
D40 - Fire Protection	73.33 %	0.00 %	\$0.00
D50 - Electrical	60.87 %	0.00 %	\$0.00
E10 - Equipment	85.00 %	0.00 %	\$0.00
E20 - Furnishings	60.00 %	0.00 %	\$0.00
Totals:	57.85 %	4.15 %	\$166,957.00

Photo Album

The photo album consists of the various cardinal compass directions of the building..

1). West Elevation - Feb 07, 2020



2). North Elevation - Feb 07, 2020



3). East Elevation - Feb 07, 2020



4). South Elevation - Feb 07, 2020



Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment)
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system as new construction.

System Listing

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

School Assessment Report - 1993 Bldg 2020_2030

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
A1010	Standard Foundations	\$8.63	S.F.	22,847	100	1993	2093		74.00 %	0.00 %	74			\$197,170
A1030	Slab on Grade	\$7.28	S.F.	22,847	100	1993	2093		74.00 %	0.00 %	74			\$166,326
B1020	Roof Construction	\$13.69	S.F.	22,847	100	1993	2093		74.00 %	0.00 %	74			\$312,775
B2010	Exterior Walls	\$14.57	S.F.	22,847	100	1993	2093		74.00 %	0.00 %	74			\$332,881
B2020	Exterior Windows	\$9.08	S.F.	22,847	30	1993	2023		13.33 %	0.00 %	4			\$207,451
B2030	Exterior Doors	\$0.92	S.F.	22,847	30	1993	2023		13.33 %	0.00 %	4			\$21,019
B3010130	Preformed Metal Roofing	\$8.50	S.F.	22,847	30	1993	2023	2025	20.00 %	0.00 %	6			\$194,200
B3020	Roof Openings	\$0.57	S.F.	22,847	30	2010	2040		70.00 %	0.00 %	21			\$13,023
C1010	Partitions	\$6.18	S.F.	22,847	100	1993	2093		74.00 %	0.00 %	74			\$141,194
C1020	Interior Doors	\$4.01	S.F.	22,847	40	2011	2051		80.00 %	0.00 %	32			\$91,616
C1030	Fittings	\$2.92	S.F.	22,847	20	2011	2031		60.00 %	0.00 %	12			\$66,713
C2010	Stair Construction	\$3.16	S.F.	22,847	100	1993	2093		74.00 %	0.00 %	74			\$72,197
C3010220	Tile	\$9.25	S.F.	1,000	30	1993	2023		13.33 %	0.00 %	4			\$9,250
C3010230	Paint & Covering	\$1.47	S.F.	22,847	10	2016	2026		70.00 %	0.00 %	7			\$33,585
C3020420	Ceramic Tile	\$16.74	S.F.	1,000	50	1993	2043		48.00 %	0.00 %	24			\$16,740
C3020903	VCT	\$3.48	S.F.	16,156	15	2011	2026		46.67 %	0.00 %	7			\$56,223
C3020999	Other - Rubber or Neoprene	\$26.67	S.F.	5,691	10	1993	2003		0.00 %	110.00 %	-16		\$166,957.00	\$151,779
C3030	Ceiling Finishes	\$9.96	S.F.	22,847	20	2011	2031		60.00 %	0.00 %	12			\$227,556
D2010	Plumbing Fixtures	\$7.26	S.F.	22,847	20	2011	2031		60.00 %	0.00 %	12			\$165,869
D2020	Domestic Water Distribution	\$0.83	S.F.	22,847	30	2011	2041		73.33 %	0.00 %	22			\$18,963
D2030	Sanitary Waste	\$1.95	S.F.	22,847	30	2011	2041		73.33 %	0.00 %	22			\$44,552
D3040	Distribution Systems	\$21.01	S.F.	22,847	20	2011	2031		60.00 %	0.00 %	12			\$480,015
D3050	Terminal & Package Units	\$6.08	S.F.	22,847	15	2011	2026		46.67 %	0.00 %	7			\$138,910
D3060	Controls & Instrumentation	\$2.52	S.F.	22,847	15	2011	2026		46.67 %	0.00 %	7			\$57,574
D4010	Sprinklers	\$4.66	S.F.	22,847	30	2011	2041		73.33 %	0.00 %	22			\$106,467
D4030	Fire Protection Specialties	\$0.10	S.F.	22,847	15	2015	2030		73.33 %	0.00 %	11			\$2,285
D5010	Electrical Service/Distribution	\$2.57	S.F.	22,847	20	2011	2031		60.00 %	0.00 %	12			\$58,717
D5020	Branch Wiring	\$6.78	S.F.	22,847	20	2011	2031		60.00 %	0.00 %	12			\$154,903
D5020	Lighting	\$9.22	S.F.	22,847	20	2011	2031		60.00 %	0.00 %	12			\$210,649
D5030810	Security & Detection Systems	\$1.51	S.F.	22,847	20	2011	2031		60.00 %	0.00 %	12			\$34,499
D5030910	Fire Alarm Systems	\$2.74	S.F.	22,847	20	2011	2031		60.00 %	0.00 %	12			\$62,601
D5030920	Data Communication	\$3.56	S.F.	22,847	25	2011	2036		68.00 %	0.00 %	17			\$81,335
D5090	Other Electrical Systems	\$0.38	S.F.	22,847	15	2011	2026		46.67 %	0.00 %	7			\$8,682
E1020	Institutional Equipment	\$0.12	S.F.	22,847	20	2016	2036		85.00 %	0.00 %	17			\$2,742
E1090	Other Equipment	\$1.00	S.F.	22,847	20	2016	2036		85.00 %	0.00 %	17			\$22,847
E2010	Fixed Furnishings	\$2.46	S.F.	22,847	20	2011	2031		60.00 %	0.00 %	12			\$56,204
Total									57.85 %	4.15 %			\$166,957.00	\$4,019,512

System Notes

The facility description in the executive summary contains an overview of each system. The system notes listed below provide additional information on select systems found within the facility.

System: B2010 - Exterior Walls





Note:

System: B2020 - Exterior Windows



Note:

System: B2030 - Exterior Doors

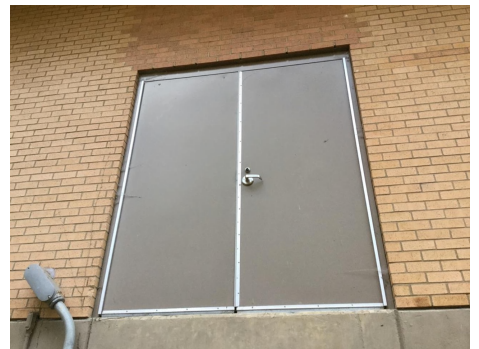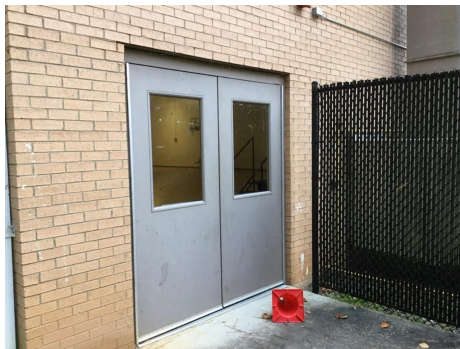

Note:

School Assessment Report - 1993 Bldg 2020_2030

System: B3010130 - Preformed Metal Roofing





Note:

System: B3020 - Roof Openings



Note:

System: C1010 - Partitions

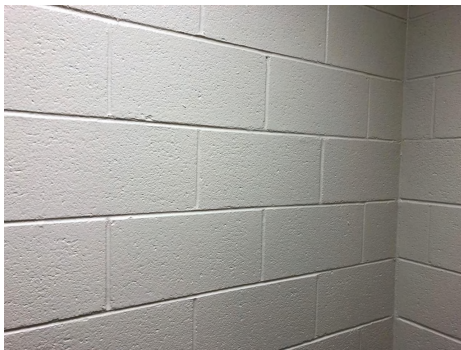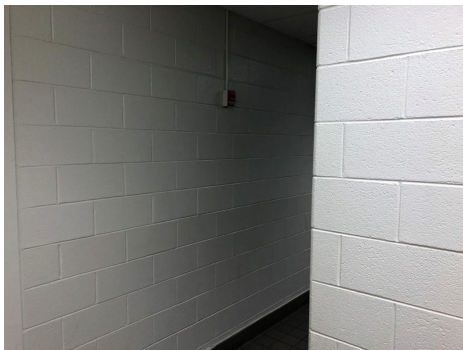

Note:



School Assessment Report - 1993 Bldg 2020_2030

System: C1020 - Interior Doors




Note:

System: C1030 - Fittings

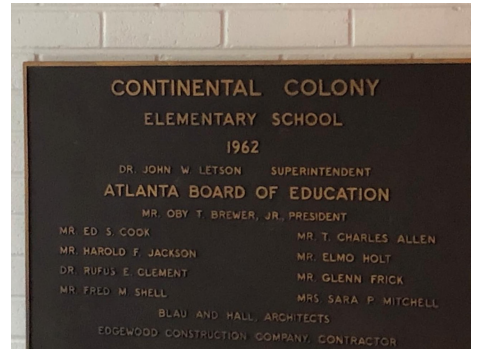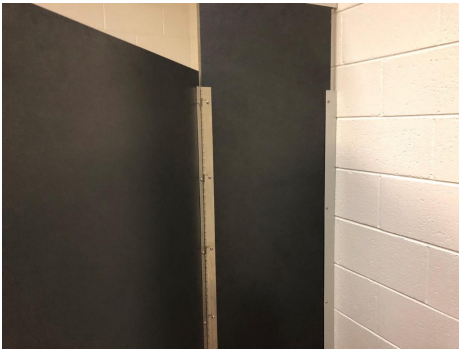

Note:


System: C2010 - Stair Construction

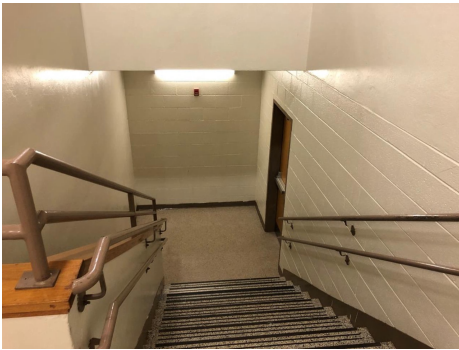

Note:

School Assessment Report - 1993 Bldg 2020_2030

System: C3010220 - Tile

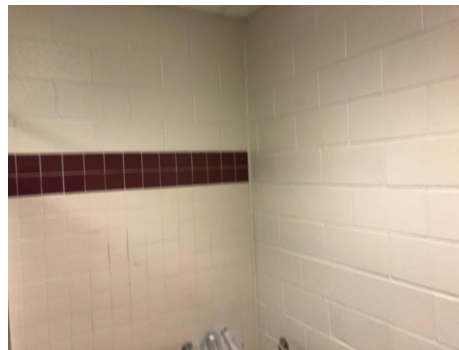



Note:

System: C3010230 - Paint & Covering



Note:


System: C3020420 - Ceramic Tile

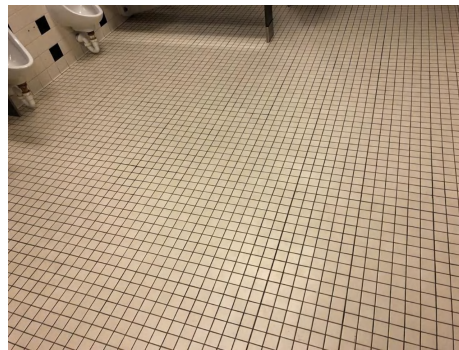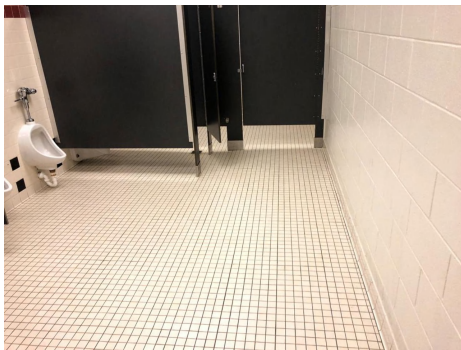

Note:


School Assessment Report - 1993 Bldg 2020_2030

System: C3020903 - VCT

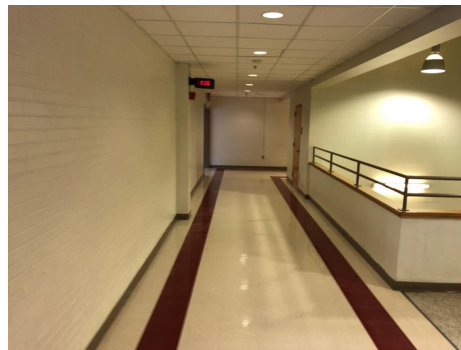

Note:

System: C3020999 - Other - Rubber or Neoprene

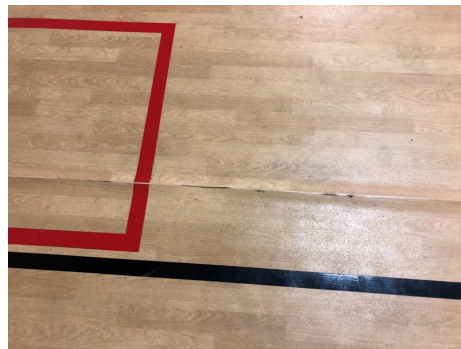

Note:


System: C3030 - Ceiling Finishes



Note:

School Assessment Report - 1993 Bldg 2020_2030

System: D2010 - Plumbing Fixtures

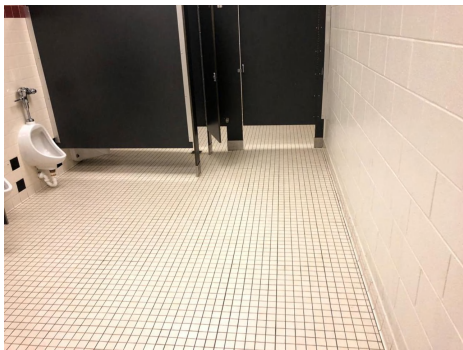

Note:

System: D2020 - Domestic Water Distribution



Note:


System: D2030 - Sanitary Waste



Note:

School Assessment Report - 1993 Bldg 2020_2030

System: D3040 - Distribution Systems

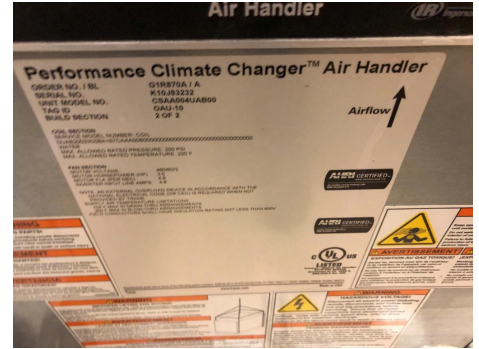


Note:

System: D3050 - Terminal & Package Units



Note:

System: D3060 - Controls & Instrumentation

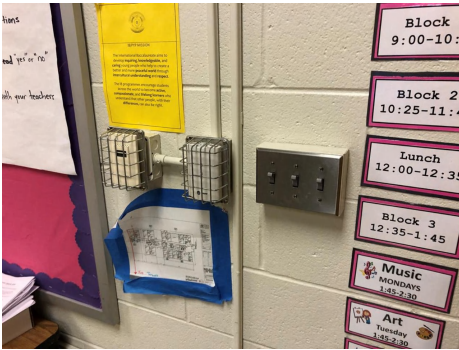

Note:


School Assessment Report - 1993 Bldg 2020_2030

System: D4010 - Sprinklers



Note:

System: D4030 - Fire Protection Specialties

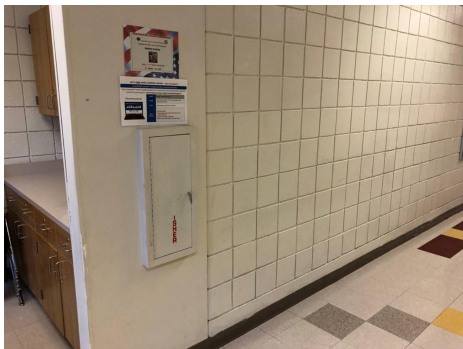

Note:

System: D5010 - Electrical Service/Distribution



Note:


School Assessment Report - 1993 Bldg 2020_2030

System: D5020 - Branch Wiring



Note:

System: D5020 - Lighting

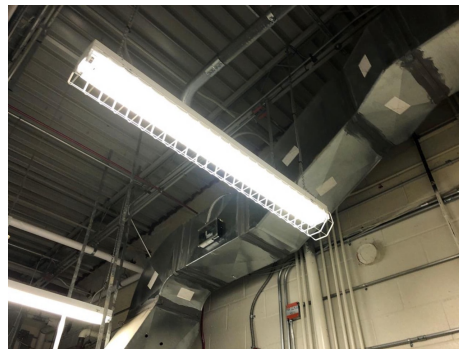

Note:

System: D5030810 - Security & Detection Systems



Note:

School Assessment Report - 1993 Bldg 2020_2030

System: D5030910 - Fire Alarm Systems



Note:

System: D5030920 - Data Communication



Note:

System: D5090 - Other Electrical Systems



Note:

School Assessment Report - 1993 Bldg 2020_2030

System: E1020 - Institutional Equipment



Note:

System: E1090 - Other Equipment



Note:

System: E2010 - Fixed Furnishings



Note:

Renewal Schedule

eCOMET forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the System Listing table. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.

Inflation Rate: 3%

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
Total:	\$166,957	\$0	\$0	\$0	\$298,476	\$0	\$331,594	\$430,175	\$0	\$0	\$224,376	\$1,451,579
* A - Substructure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A10 - Foundations	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A1010 - Standard Foundations	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A1030 - Slab on Grade	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B - Shell	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B10 - Superstructure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B1020 - Roof Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B20 - Exterior Enclosure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B2010 - Exterior Walls	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B2020 - Exterior Windows	\$0	\$0	\$0	\$0	\$256,837	\$0	\$0	\$0	\$0	\$0	\$0	\$256,837
B2030 - Exterior Doors	\$0	\$0	\$0	\$0	\$26,023	\$0	\$0	\$0	\$0	\$0	\$0	\$26,023
B30 - Roofing	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B3010 - Roof Coverings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B3010130 - Preformed Metal Roofing	\$0	\$0	\$0	\$0	\$0	\$0	\$331,594	\$0	\$0	\$0	\$0	\$331,594
B3020 - Roof Openings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C - Interiors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C10 - Interior Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1010 - Partitions	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1020 - Interior Doors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1030 - Fittings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C20 - Stairs	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C2010 - Stair Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C30 - Interior Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3010 - Wall Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3010220 - Tile	\$0	\$0	\$0	\$0	\$15,616	\$0	\$0	\$0	\$0	\$0	\$0	\$15,616

School Assessment Report - 1993 Bldg 2020_2030

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
C3010230 - Paint & Covering	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$45,436	\$0	\$0	\$0	\$45,436
C3020 - Floor Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020420 - Ceramic Tile	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020903 - VCT	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$107,177	\$0	\$0	\$0	\$107,177
C3020999 - Other - Rubber or Neoprene	\$166,957	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$224,376	\$391,333
C3030 - Ceiling Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D - Services	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D20 - Plumbing	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2010 - Plumbing Fixtures	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2020 - Domestic Water Distribution	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2030 - Sanitary Waste	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D30 - HVAC	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3040 - Distribution Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3050 - Terminal & Package Units	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$187,926	\$0	\$0	\$0	\$187,926
D3060 - Controls & Instrumentation	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$77,890	\$0	\$0	\$0	\$77,890
D40 - Fire Protection	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D4010 - Sprinklers	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D4030 - Fire Protection Specialties	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D50 - Electrical	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5010 - Electrical Service/Distribution	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5020 - Branch Wiring	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5020 - Lighting	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030 - Communications and Security	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030810 - Security & Detection Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030910 - Fire Alarm Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030920 - Data Communication	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5090 - Other Electrical Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$11,745	\$0	\$0	\$0	\$11,745
E - Equipment & Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E10 - Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E1020 - Institutional Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E1090 - Other Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E20 - Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0


School Assessment Report - 1993 Bldg 2020_2030

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
E2010 - Fixed Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0

** Indicates non-renewable system*

Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and forecasted capital renewal (sustainment) requirements over the next ten years.

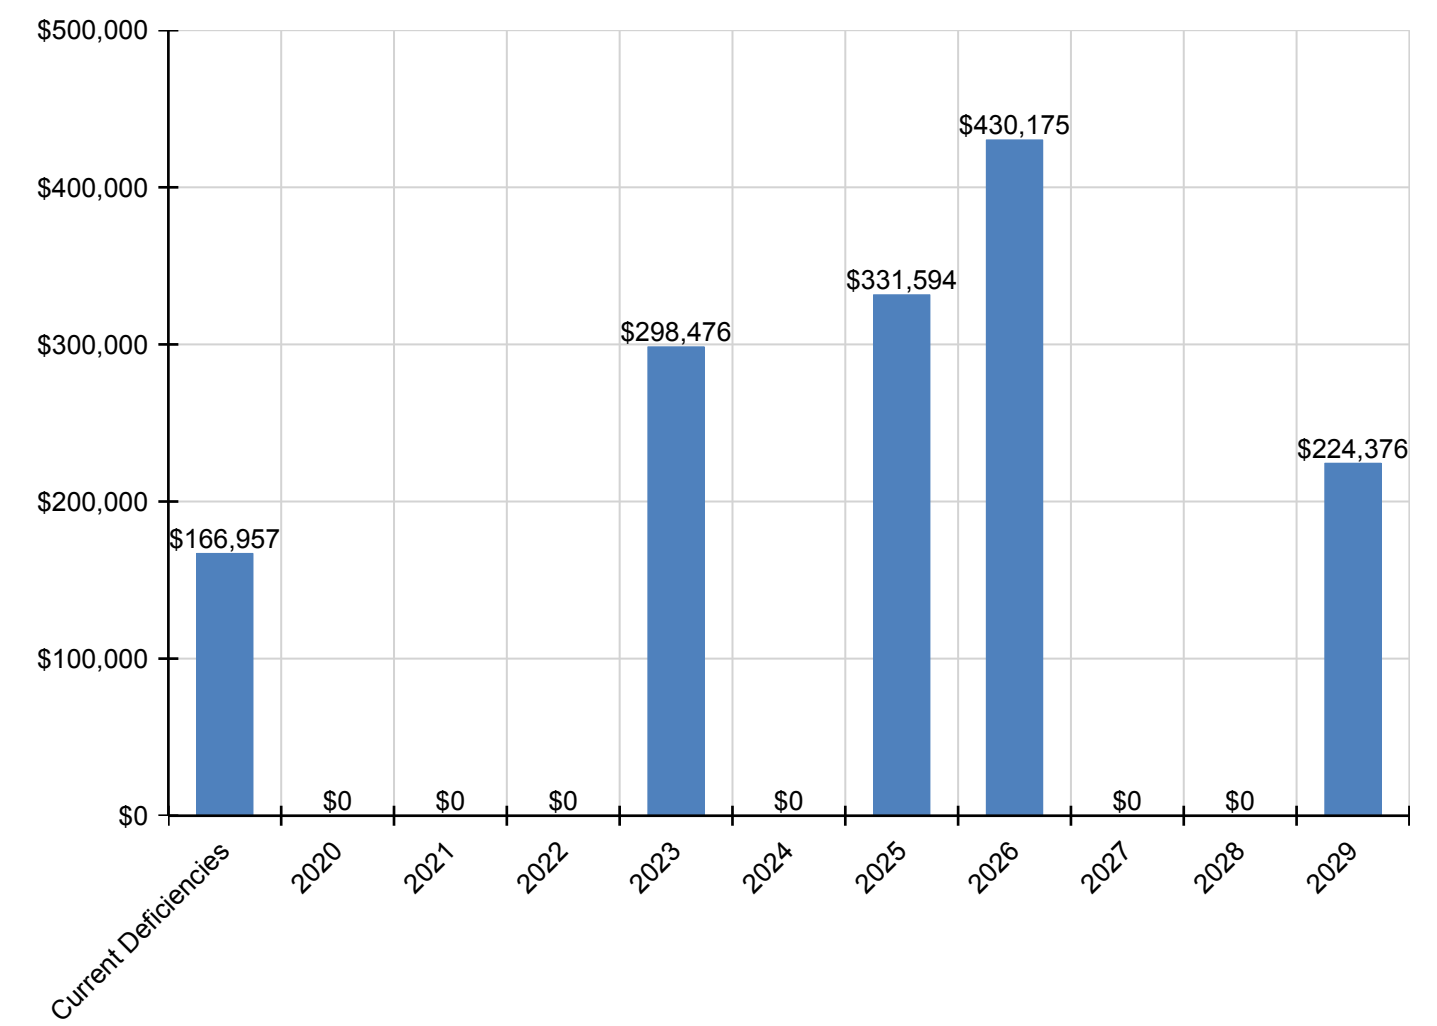


Condition Index Forecast by Investment Scenario

The chart below illustrates the effect of various investment levels on the building FCI for the next 10 years. The levels of investment shown below include:


- Current FCI: a variable investment amount based on renewing expired systems to maintain the current FCI for the building
- 2% Investment: an annual investment of 2% of the replacement value of the building, escalated for inflation
- 4% Investment: an annual investment of 4% of the replacement value of the building, escalated for inflation

Facility Investment vs. FCI Forecast

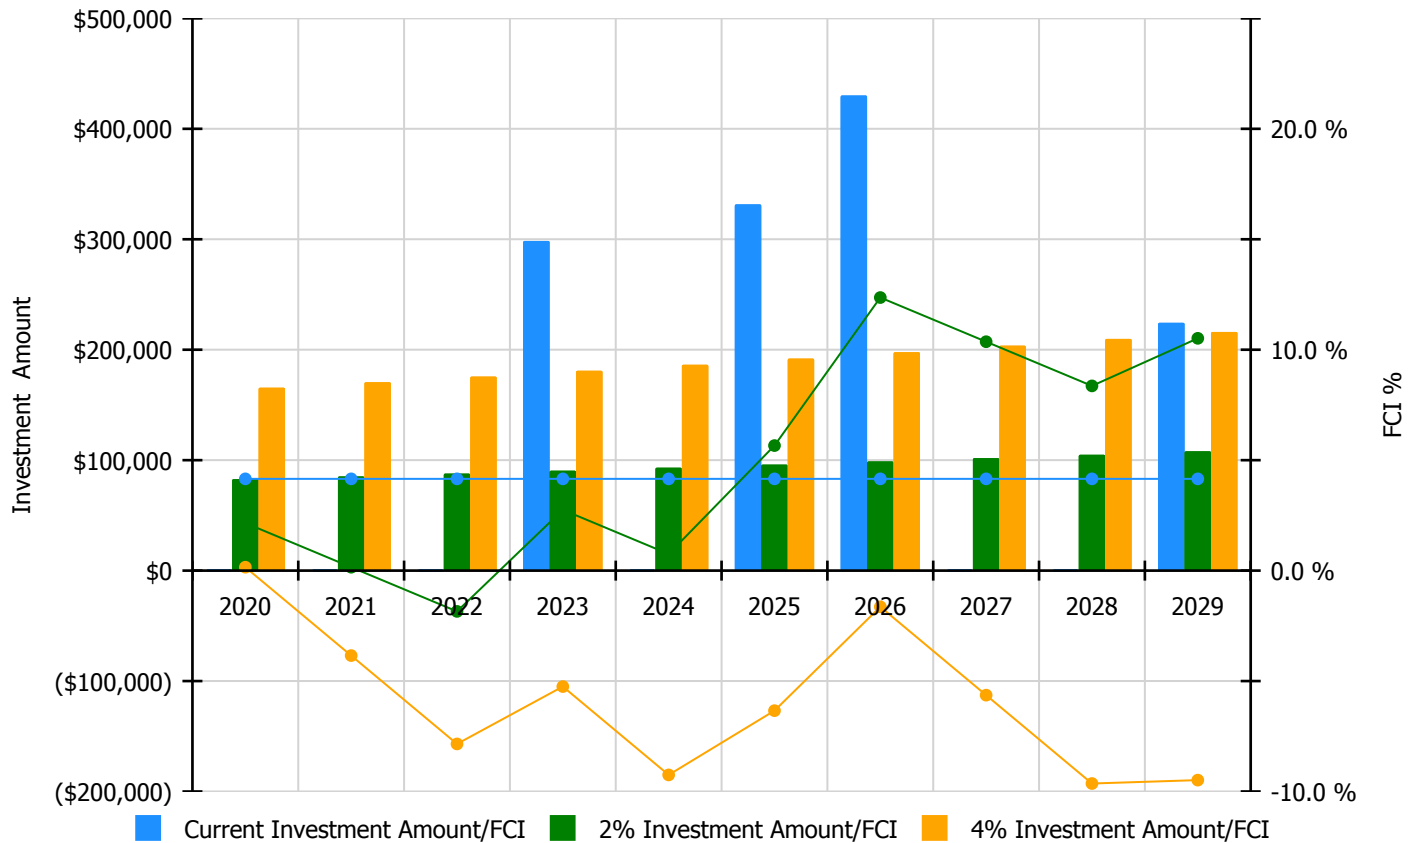

Deficiency Summary by System


Current deficiencies included assemblies that have reached or exceeded their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Useful Life'. The following chart lists all current deficiencies associated with this facility.

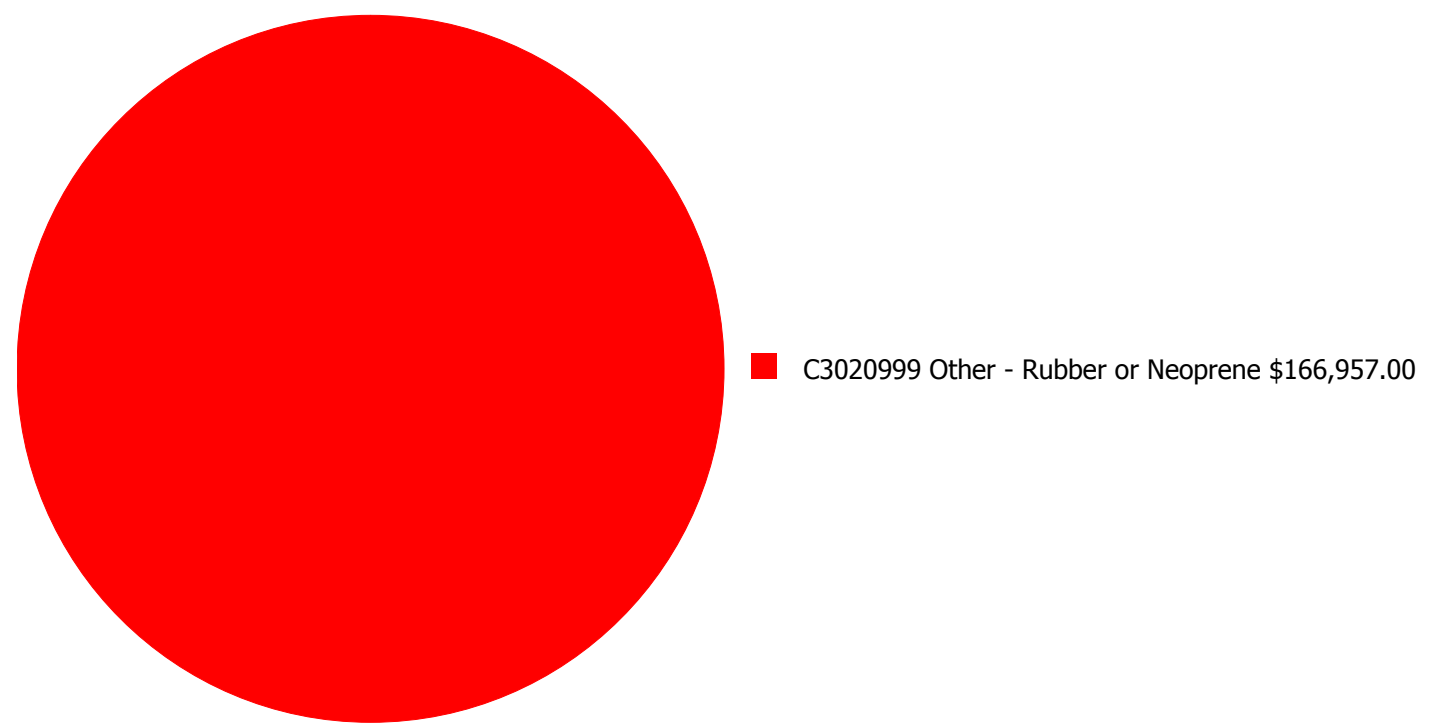

Budget Estimate Total: \$166,957.00

Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

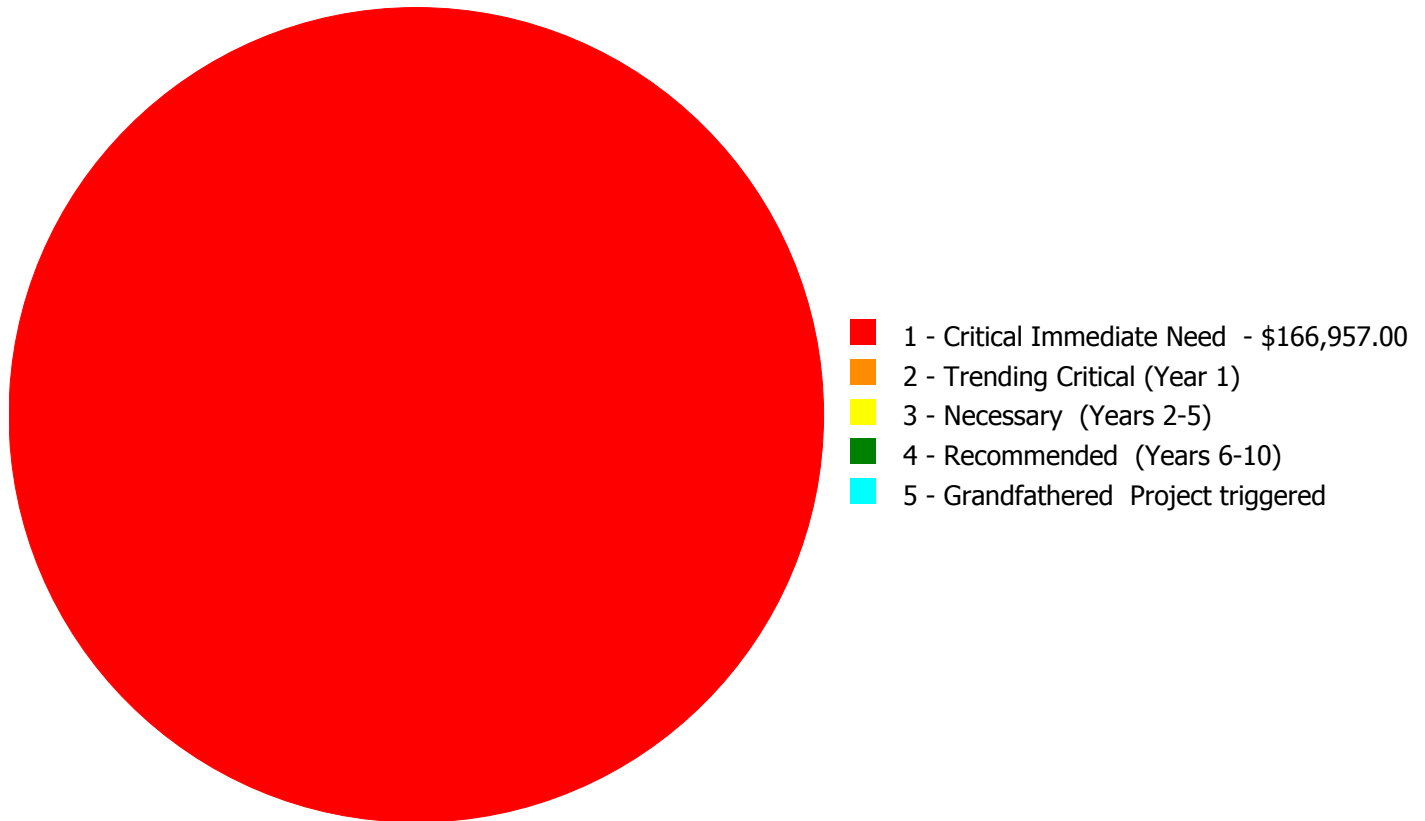

Budget Estimate Total: \$166,957.00


Deficiency By Priority Investment Table

The table below shows the current investment cost grouped by deficiency priority and building system.

System Code	System Description	1 - Critical Immediate Need	2 - Trending Critical (Year 1)	3 - Necessary (Years 2-5)	4 - Recommended (Years 6-10)	5 - Grandfathered Project triggered	Total
C3020999	Other - Rubber or Neoprene	\$166,957.00	\$0.00	\$0.00	\$0.00	\$0.00	\$166,957.00
	Total:	\$166,957.00	\$0.00	\$0.00	\$0.00	\$0.00	\$166,957.00

Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

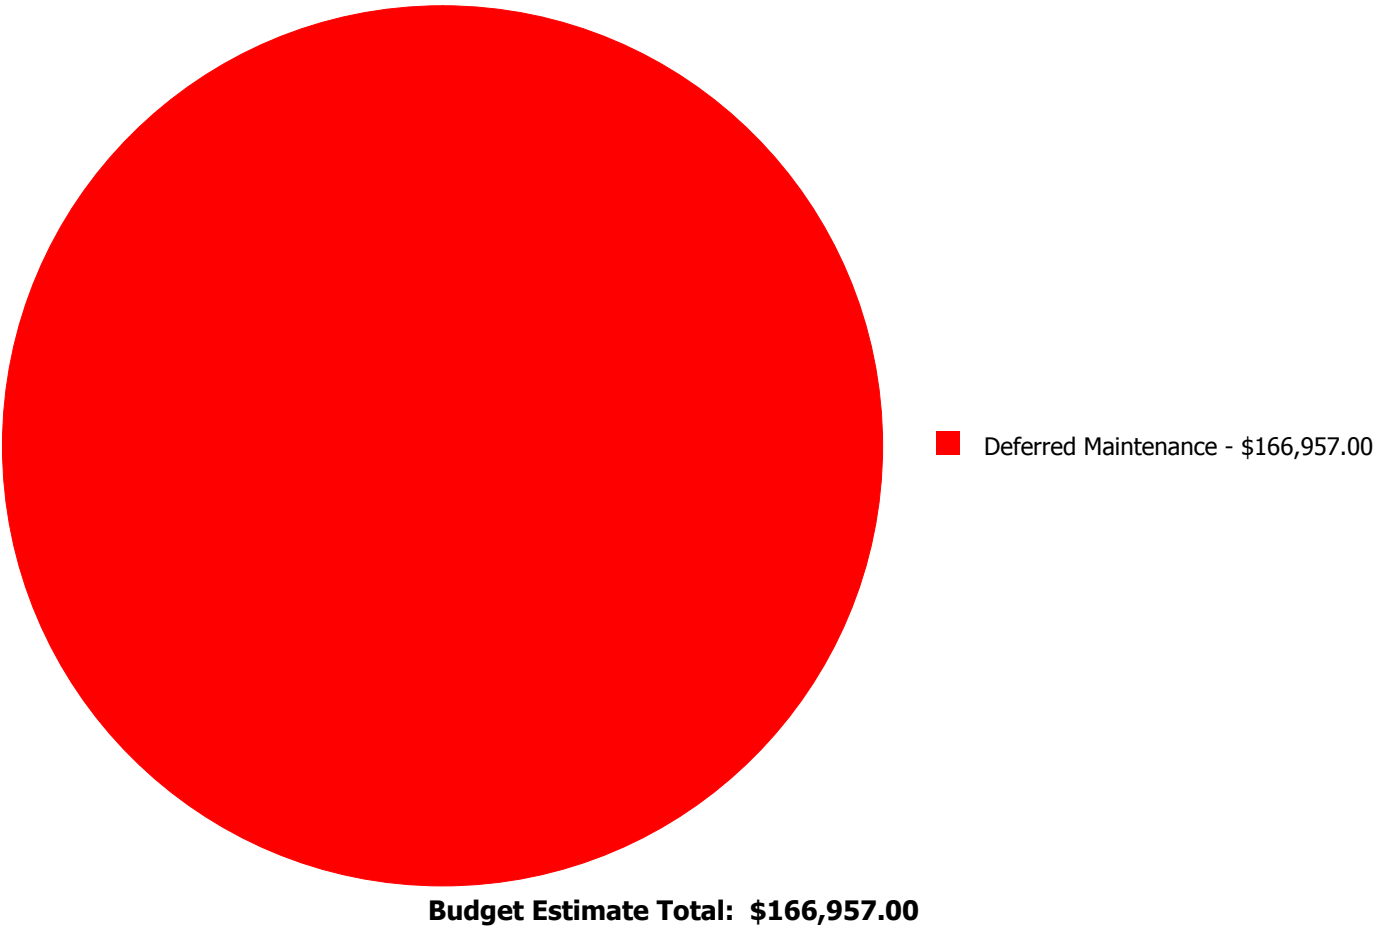

Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

Priority 1 - Critical Immediate Need:

System: C3020999 - Other - Rubber or Neoprene



Location: Gym
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 1 - Critical Immediate Need
Correction: Renew System
Qty: 5,691.00
Unit of Measure: S.F.
Estimate: \$166,957.00
Assessor Name: Jejuan Hall
Date Created: 02/07/2020

Notes: The Neoprene/Rubber floor finish is beyond its expected service life, worn and damaged, and is recommended for replacement.

Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as $100 - \text{Total FCI}$ (without the %) where 100 is best and 0 is worst condition.

Function:

Gross Area (SF):	117,384
Year Built:	1963
Last Renovation:	2011
Replacement Value:	\$3,664,729
Repair Cost:	\$0.00
Total FCI:	0.00 %
Total RSLI:	66.21 %
FCA Score:	100.00



Description:

The narrative for this site is included in the Executive Summary Description at the front of this report.

Attributes: This asset has no attributes.

Dashboard Summary


Function:		Gross Area:	117,384
Year Built:	1963	Last Renovation:	2011
Repair Cost:	\$0	Replacement Value:	\$3,664,729
FCI:	0.00 %	RSLI%:	66.21 %

No data found for this asset

No data found for this asset

No data found for this asset

10 Year Investment Forecast

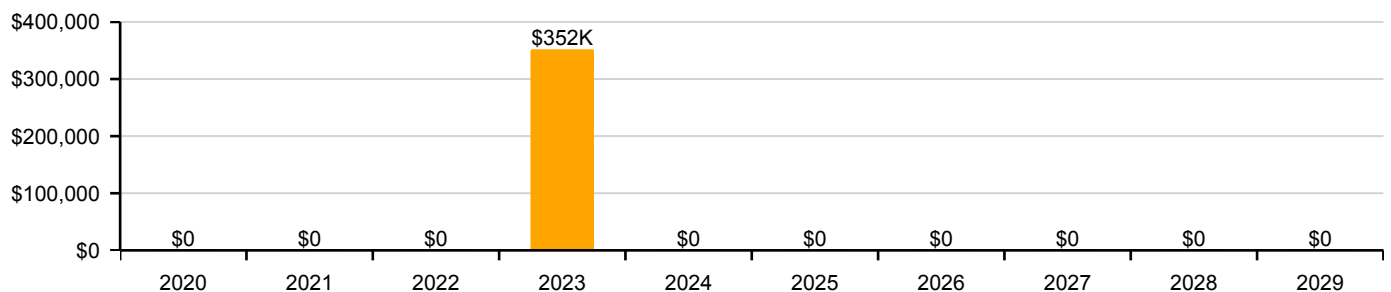


Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

UNIFORMAT Classification	RSLI %	FCI %	Current Repair Cost
G20 - Site Improvements	74.93 %	0.00 %	\$0.00
G30 - Site Mechanical Utilities	48.00 %	0.00 %	\$0.00
G40 - Site Electrical Utilities	52.29 %	0.00 %	\$0.00
Totals:	66.21 %	0.00 %	\$0.00

Photo Album

The photo album consists of the various cardinal compass directions of the building..

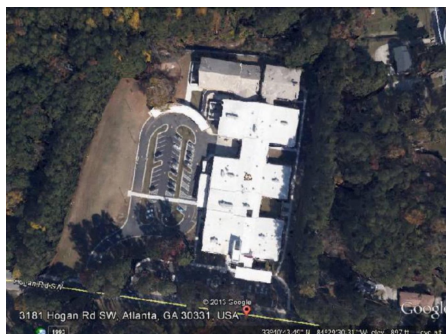

Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment)
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system as new construction.

System Listing

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
G2010	Roadways	\$2.24	S.F.	117,384	35	2011	2046		77.14 %	0.00 %	27			\$262,940
G2020	Parking Lots	\$7.57	S.F.	117,384	35	2011	2046		77.14 %	0.00 %	27			\$888,597
G2030	Pedestrian Paving	\$2.19	S.F.	117,384	35	2011	2046		77.14 %	0.00 %	27			\$257,071
G2040105	Fence & Guardrails	\$1.15	S.F.	117,384	30	2011	2041		73.33 %	0.00 %	22			\$134,992
G2040950	Covered Walkways	\$1.44	S.F.	117,384	25	2011	2036		68.00 %	0.00 %	17			\$169,033
G2040950	Playing Field	\$4.28	S.F.	117,384	30	2011	2041		73.33 %	0.00 %	22			\$502,404
G2050	Landscaping	\$1.14	S.F.	117,384	25	2011	2036		68.00 %	0.00 %	17			\$133,818
G3010	Water Supply	\$1.02	S.F.	117,384	50	1993	2043		48.00 %	0.00 %	24			\$119,732
G3020	Sanitary Sewer	\$2.10	S.F.	117,384	50	1993	2043		48.00 %	0.00 %	24			\$246,506
G3030	Storm Sewer	\$1.19	S.F.	117,384	50	1993	2043		48.00 %	0.00 %	24			\$139,687
G4010	Electrical Distribution	\$2.42	S.F.	117,384	30	1993	2023		13.33 %	0.00 %	4			\$284,069
G4020	Site Lighting	\$2.85	S.F.	117,384	30	2011	2041		73.33 %	0.00 %	22			\$334,544
G4030	Site Communication and Security	\$1.20	S.F.	117,384	30	2011	2041		73.33 %	0.00 %	22			\$140,861
G4040	Other Site Electrical Utilities	\$0.43	S.F.	117,384	30	2011	2041		73.33 %	0.00 %	22			\$50,475
Total									66.21 %					\$3,664,729

System Notes

The facility description in the executive summary contains an overview of each system. The system notes listed below provide additional information on select systems found within the facility.

System: G2010 - Roadways



Note:

System: G2020 - Parking Lots



Note:

System: G2030 - Pedestrian Paving



Note:

School Assessment Report - Site

System: G2040105 - Fence & Guardrails



Note:

System: G2040950 - Covered Walkways



Note:

System: G2040950 - Playing Field



Note:

School Assessment Report - Site

System: G2050 - Landscaping



Note:

System: G3010 - Water Supply



Note:

System: G3020 - Sanitary Sewer



Note:

School Assessment Report - Site

System: G3030 - Storm Sewer



Note:

System: G4010 - Electrical Distribution



Note:

System: G4020 - Site Lighting



Note:

School Assessment Report - Site

System: G4030 - Site Communication and Security



Note:

System: G4040 - Other Site Electrical Utilities



Note:

Renewal Schedule

eCOMET forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the System Listing table. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.


Inflation Rate: 3%

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
Total:		\$0	\$0	\$0	\$351,694	\$0	\$0	\$0	\$0	\$0	\$0	\$351,694
G - Building Sitework	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G20 - Site Improvements	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2010 - Roadways	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2020 - Parking Lots	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2030 - Pedestrian Paving	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040 - Site Development	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040105 - Fence & Guardrails	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040950 - Covered Walkways	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040950 - Playing Field	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2050 - Landscaping	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G30 - Site Mechanical Utilities	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G3010 - Water Supply	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G3020 - Sanitary Sewer	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G3030 - Storm Sewer	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G40 - Site Electrical Utilities	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G4010 - Electrical Distribution	\$0	\$0	\$0	\$0	\$351,694	\$0	\$0	\$0	\$0	\$0	\$0	\$351,694
G4020 - Site Lighting	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G4030 - Site Communication and Security	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G4040 - Other Site Electrical Utilities	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0

* Indicates non-renewable system

Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and forecasted capital renewal (sustainment) requirements over the next ten years.

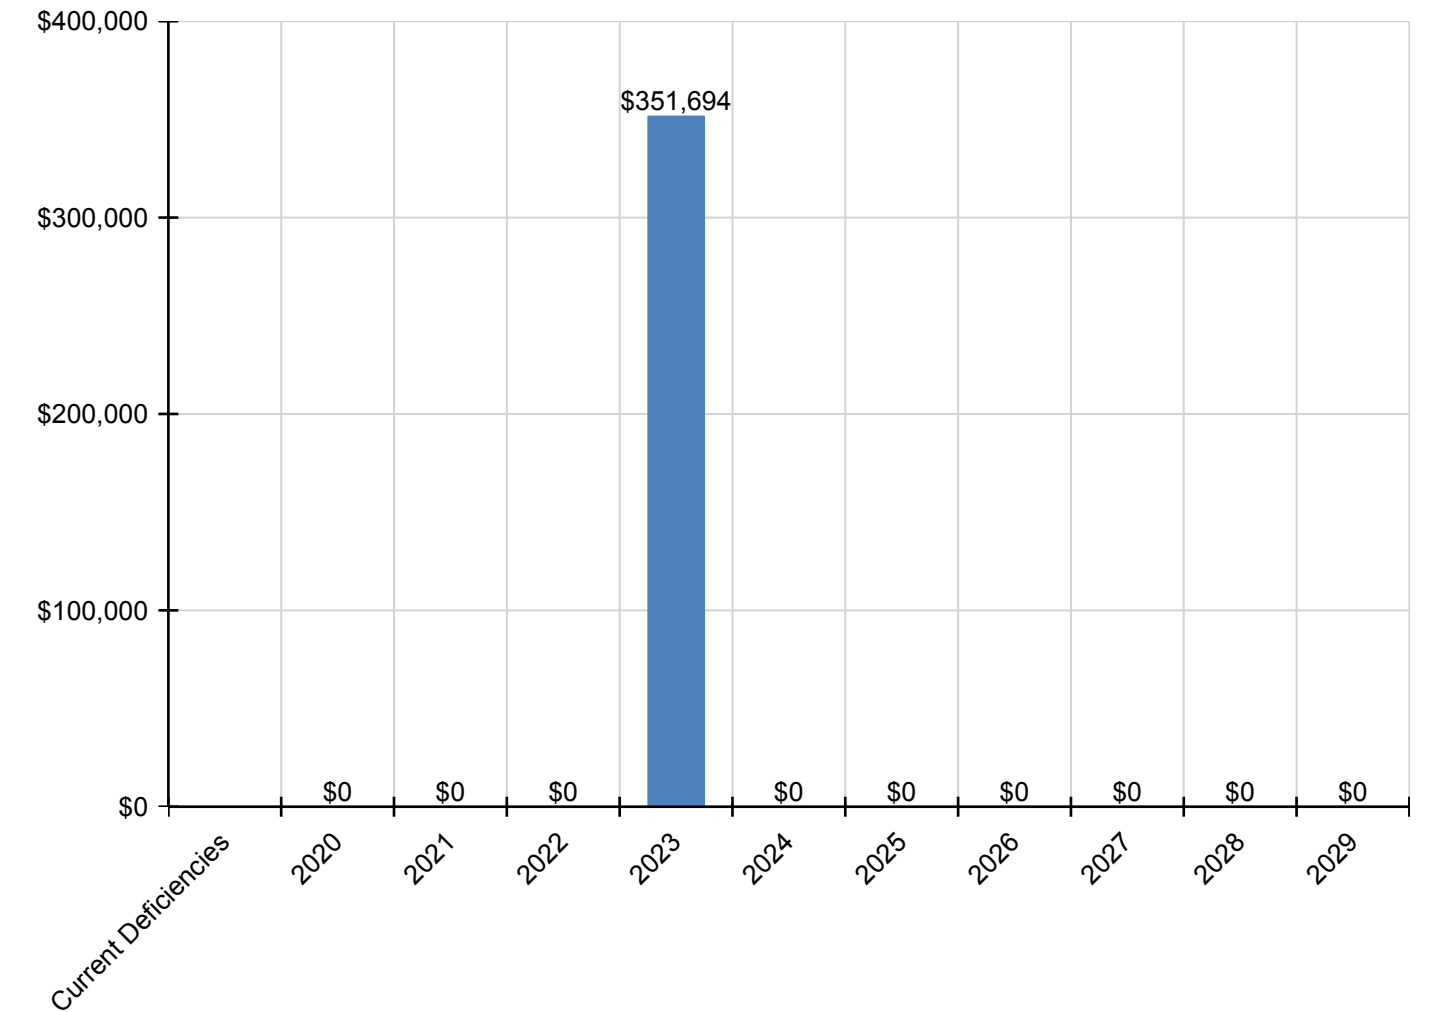


Condition Index Forecast by Investment Scenario

The chart below illustrates the effect of various investment levels on the building FCI for the next 10 years. The levels of investment shown below include:

- Current FCI: a variable investment amount based on renewing expired systems to maintain the current FCI for the building
- 2% Investment: an annual investment of 2% of the replacement value of the building, escalated for inflation
- 4% Investment: an annual investment of 4% of the replacement value of the building, escalated for inflation

Facility Investment vs. FCI Forecast

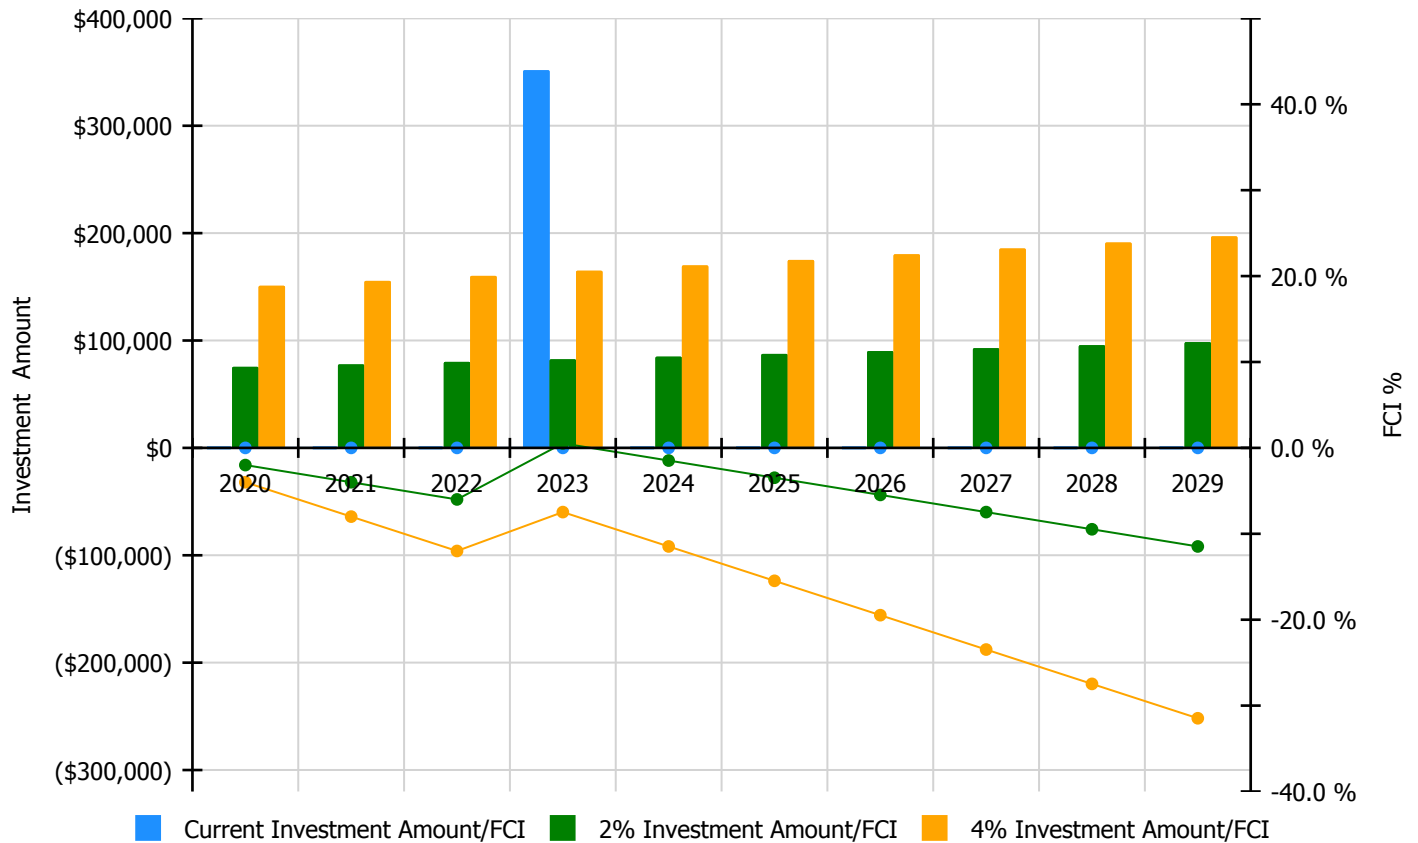

Year	Investment Amount Current FCI - 0%	2% Investment		4% Investment	
		Amount	FCI	Amount	FCI
2020	\$0	\$75,493.00	-2.00 %	\$150,987.00	-4.00 %
2021	\$0	\$77,758.00	-4.00 %	\$155,516.00	-8.00 %
2022	\$0	\$80,091.00	-6.00 %	\$160,182.00	-12.00 %
2023	\$351,694	\$82,494.00	0.53 %	\$164,987.00	-7.47 %
2024	\$0	\$84,969.00	-1.47 %	\$169,937.00	-11.47 %
2025	\$0	\$87,518.00	-3.47 %	\$175,035.00	-15.47 %
2026	\$0	\$90,143.00	-5.47 %	\$180,286.00	-19.47 %
2027	\$0	\$92,847.00	-7.47 %	\$185,695.00	-23.47 %
2028	\$0	\$95,633.00	-9.47 %	\$191,266.00	-27.47 %
2029	\$0	\$98,502.00	-11.47 %	\$197,004.00	-31.47 %
Total:	\$351,694	\$865,448.00		\$1,730,895.00	

Deficiency Summary by System

Current deficiencies included assemblies that have reached or exceeded their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Useful Life'. The following chart lists all current deficiencies associated with this facility.

No data found for this asset

Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

No data found for this asset

Deficiency By Priority Investment Table

The table below shows the current investment cost grouped by deficiency priority and building system.

No data found for this asset

Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

No data found for this asset

Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

No data found for this asset

Glossary

Abandoned	A facility owned by the city that is not occupied and not maintained. See Vacant.
Additional Cost	Total project cost is composed of hard and soft costs. Additional costs or soft expenses are costs that are necessary to accomplish the corrective work but are not directly attributable to the deficient systems direct construction cost, which are often referred to as hard cost. The components included in the soft costs vary by owner but usually include architect and contractor fees, contingencies and other owner-incurred costs necessary to fully develop and build a facility. These soft cost factors can be adjusted anytime within the eCOMET database at the owner's discretion.
Assessment	Visual survey of a facility to determine its condition. It involves looking at the age of systems, reviewing information from local sources and visual evidence of potential problems to assign a condition rating. It does not include destructive testing of materials or testing of systems or equipment for functionality.
ASTM	ASTM International (ASTM): Originally known as the American Society for Testing and Materials, ASTM is an international standards organization that develops and publishes voluntary consensus technical standards for a wide range of materials, products, systems, and services.
BOMA	Building Owners Managers of America (BOMA): National organization of public and private facility owners focused on building management tools and maintenance techniques. eCOMET® reference: Building and component system effective economic life expectancies.
Building	A fully enclosed and roofed structure that can be traversed internally without exiting to the exterior.
Building Addition	An area, space or component of a building added to a building after the original building's year built date. NOTE: As a convention in the database, "Main" was used to designate the original building. Additions built prior to 1987 (30 years) were included in the main building area calculations to reflect their predicted system depreciation characteristics and remaining service life.
Building Systems	eCOMET® uses UNIFORMAT II to organize building data. UNIFORMAT II was originally developed by the federal General Services Administration to delineate building costs by systems rather than by material. UNIFORMAT II was formalized by an NIST standard, NISTIR 6389 in 1999. It has been further quantified and updated by ASTM standard 2005, E1557-05. The Construction Specifications Institute, CSI, has taken over the standard as part of their MasterFormat / MasterSpec system.
Calculated Next Renewal	The year a system or building element would be expected to expire based solely on the date it was installed and the expected useful lifetime for that kind of system.
Capital Renewal	Capital renewal refers to the cyclical replacement of building systems or elements as they become obsolete or beyond their useful life. It is not normally included in an annual operating/maintenance budget. See calculated next renewal and next renewal.
City Cost Index (CCI)	RS Means provides building system, equipment, and construction costs at a national level. The City Cost Index (also provided by RS Means) localizes those costs to a geographic region of the United States. In eCOMET®, each building or site is assigned a City Cost Index, which adjusts all of the associated costs for systems, deficiencies and inventory to the local value.
Condition	Condition refers to the state of physical fitness or readiness of a facility system or system element for its intended use.
Condition Budget	The Condition Budget, also known as Condition Needs, represents the budgeted contractor installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging the work.

School Assessment Report - Continental Colony Elementary School

Condition Index (CI) %	The Condition Index (CI) also known as the Remaining Service Life Index (RSLI) is calculated as the sum of a renewable system's Remaining Service Life (RSL) Value divided by the sum of a system's Replacement Value (both values exclude soft cost to simplify calculation updates) expressed as a percentage ranging from 100.00% (new) to 0.00% (expired - no remaining life).
Correction	Correction refers to an assessor's recommended deficiency repair or replacement action. For any system or element deficiency, there can be multiple and alternative solutions for its repair or replacement. A Correction is user defined and tied to a UNIFORMAT II element, or system it is intended to address. It excludes other peripheral costs that may also be included in the packaging of repair, replacement or renewal improvements that may also be triggered by the deficiency correction.
Cost Model	A cost model is a list of facility systems which could represent the installed systems a given facility. Included in the cost model are standard unit cost estimates, gross areas, life cycles and installed dates. Also represented is the repair cost for deficient systems, replacement values. See eCOMET® cost models.
Criteria	Criteria refer to the set of requirements, guidelines or standards that are assessed and rated to develop a score.
Current Period	The Current Period is the current year plus a user defined number of forward years.
Current Replacement Value (CRV)	The Current Replacement Value (CRV) of a facility, building or system represents the hypothetical cost of rebuilding or replacing an existing facility under today's codes and construction standards, using its current configuration. It is calculated by multiplying the gross area of the facility by a square foot cost developed in that facility's cost model. Replacement cost includes construction costs and owner's additional or soft costs for fees, permits and other expenses to reflect a total project cost.
Deferred Maintenance	Deferred maintenance is condition work deferred on a planned or unplanned basis to a future budget cycle or postponed until funds are available.
Deficiency	A deficiency is a repair item that is damaged, missing, inadequate or insufficient for an intended purpose.
Deficiency Category	Category refers to the type or class of a user defined deficiency grouping with shared or similar characteristics. Category descriptions include, but are not limited to: Accessibility Code Compliance, Appearance, Building Code Compliance, Deferred Maintenance, Energy, Environmental, Life Safety Code Compliance, and Safety.
Deficiency Priority	Priority refers to a deficiency's urgency for repair as determined by the assessment team. Five typical industry priority settings were used for the assessment: Priority 1 – Currently Critical; Priority 2 – Potentially Critical; Priority 3 – Necessary/Not Yet Critical; Priority 4 – Recommended.
Distress	Distress refers to a user-defined root cause of a deficiency. Distress descriptions are: Beyond Service Life, Damaged, Inadequate, Needs Remediation, and Missing.
eCOMET®	Energy and Condition Management Estimation Technology (eCOMET®) is Parsons proprietary facility asset management software developed to provide facility managers with a state of the art, web-based tool to develop and maintain a comprehensive database of FCA data and information used for facility asset management, maintenance and repair, and capital renewal planning. eCOMET® is used by Parsons and its clients as the primary tool for collecting FCA data, preparing cost estimates, generating individual facility reports and cost estimates, and developing the overall capital renewal program.
eCOMET® Cost Models	eCOMET cost models are derived from RS Means Square Foot Cost Data cost models and these models are used to develop the current replacement value (CRV) and assign life cycle costs to the various systems within a building. Cost models are assigned current costs-per-square-foot to establish replacement values. The Cost models are designed to represent a client specific facility that meets local standards cost trends.

School Assessment Report - Continental Colony Elementary School

Element	Elements are the major components that comprise building systems as defined by UNIFORMAT II.
Expected Life	Also referred to as Useful Life. See Useful Life definition.
Facility	A facility refers to site(s) building(s) or building addition(s) or combinations thereof that provide a particular service.
Facility Attributes	Customizable eCOMET fields to identify attributes specific to a facility. These fields are part of the eCOMET database set-up with the owner.
Facility Condition Assessment (FCA)	A facility condition assessment (FCA) is a visual inspection of buildings and grounds at a facility to identify and estimate current and future needed repairs or replacements of major systems for planning and budgeting purposes. It is typically performed for organizations that are tasked with the day to day maintenance, operation, and capital renewal (replacement) of building systems and components of a large inventory of facilities. The primary goal of an FCA is to objectively and quantifiably identify, inspect, and prioritize the repair and replacement needs of the building and ground systems (e.g., roofs, windows, doors, floor finishes, plumbing fixtures, parking lot, and sidewalks) within facilities that have either failed or have surpassed their service life, and to identify and forecast future capital replacement needs for systems that have not yet failed, but planned replacement of those systems is needed to ensure that the facilities will continue to meet the mission of the organization.
Facility Condition Index (FCI%)	FCI is an industry-standard measurement of a facility's condition that is the ratio of the cost to correct a facility's deficiencies to the Current Replacement Value of the facilities. The higher the FCI the poorer the condition of a facility. After an FCI is established for all buildings within a portfolio a building's condition can be ranked relative to other buildings. The FCI may also represent the condition of a portfolio based on the cumulative FCIs of the portfolio's facilities.
Forecast Period	The Forecast Period refers to a user defined number of years forward of the Current Period.
Gen (Generate)	The Cost Model has a Gen box for each system line item. By checking the box, eCOMET will generate life cycle deficiencies based on the Year Installed and the Life for that system. Systems that typically do not re-generate (foundations, floor construction, roof construction, basement walls, etc.) would not have the Gen box checked as those systems would not re-generate at the end of a life cycle. In those instances, it would be more practical and cost effective to demolish the entire facility than re-new those systems.
Gross Square Feet (GSF)	The size of the enclosed floor space of a building in square feet measured to the outside face of the enclosing wall.
Life Cycle	Life cycle refers to the period of time that a building or site system or element can be expected to adequately serve its intended function. Parsons assigns expected life cycles to all building systems based on Building Operators and Managers of America (BOMA) recommended life cycles, manufacturers suggested life, and RS Means cost data, and client-provided historical data. BOMA standards are a nationally recognized source of life cycle data for various components and/or systems associated with facilities. RS Means is a national company specializing in construction estimating and costs.
Next Renewal	Next Renewal refers to a manually-adjusted expected useful life of a system or element based on on-site inspection either by reducing or extending the Calculated Next Renewal to more accurately reflect current conditions.
Order of Magnitude	Order of Magnitude refers to a rough approximation made with a degree of knowledge and confidence that the budgeted, projected or estimated cost falls within a reasonable range of cost values.
Remaining Service Life (RSL)	RSL is the number of years service remaining for a system or equipment item. It is automatically calculated based on the difference between the current year and the 'Calculated Next Renewal' date or the 'Next Renewal' date whichever one is the later date.

School Assessment Report - Continental Colony Elementary School

Remaining Service Life Index (RSLI)	The Remaining Service Life Index (RSLI), also known as the Condition Index (CI), is calculated as the sum of a renewable system's or component's Remaining Service Life (RSL) Value divided by the sum of a system's or component's Replacement Value (both values exclude softcost to simplify calculation updates) expressed as a percentage ranging from 100.00% (new) to 0.00% (expired - no remaining service life).
Remaining Service Life Value	Remaining Service Life Value, also known as the RSL Weight, is a calculated value used to determine the RSLI and is equal to the system Value (Unit Cost * Qty) * RSL (not displayed).
Renewal Factors	Renewal factors represent the difference in cost of renovating or replacing an existing system, rather than new construction of a building system. For example, installing a new built-up roof on an existing building would include removing and disposing of the old roof, a cost not associated with new construction. Using a renewal premium to account for demolition and other difficulty costs, Parsons typically assigns a renewal factor of 110%.
Renewal Schedule	A timeline that provides the items that need repair the year in which the repair is needed and the estimated price of the renewal.
Repair Cost	Repair cost is the sum of all the deficiencies associated with a building or multiple buildings/facilities. It will include any applied soft costs or City Cost Indexes.
Replacement Value	See Current Replacement Value.
Site	A facility's grounds and its utilities, roadways, landscaping, fencing and other typical land improvements needed to support a facility.
Soft Costs	Soft Costs are a construction industry term that refers to expense items that are not considered direct construction costs. Soft costs are user-defined and include architectural, engineering, management, testing, and mitigation fees, and other owner pre- and post-construction expenses.
Sustainability	Sustainability refers to the collection of policies and strategies that meet society's present needs without compromising the ability of future generations to meet their own needs.
System	System refers to building and related site work elements as described by ASTM Uniformat II Classification for Building Elements (E1557-97) a format for classifying major facility elements common to most buildings. Elements usually perform a given function regardless of the design specification construction method or materials used. See also Uniformat II.
System Generated Deficiency	eCOMET automatically generates system deficiencies based on system life cycles using the systems installation dates as the base year. By adjusting the Next Renewal date ahead or behind the predicted or stated life cycle date, a system cost will come due earlier or later than the originally installed life cycle date. This utility accounts for good maintenance conditions and a longer life, or early expiration of a system life due to any number of adverse factors such as poor installation, acts of god, material defects, poor design applications and other factors that may shorten the life of a material or system. It is important to mention that the condition of the systems is not necessarily a reflection of maintenance practices, but a combination of system usage and age.
UNIFORMAT	ASTM UNIFORMAT II, Classification for Building Elements (E1557-97), a publication of the Construction Specification Institute (CSI), is a format used to classify major facility components common to most buildings. The format is based on functional elements or parts of a facility characterized by their functions without regard to the materials and methods used to accomplish them. These elements are often referred to as systems or assemblies.
Unit Price	The Unit Price (Raw) x the Additional Cost Template percentage.
Unit Price (Raw)	The actual \$/sq. ft. cost being used for the building and systems. It will include adjustments for the City Cost Index applied to the facility.

School Assessment Report - Continental Colony Elementary School

Useful Life	Also known as Expected Life, Useful Life refers to the intrinsic period of time a system or element is expected to perform as intended. Useful life is generally provided by manufacturers of materials, systems and elements through their literature, testing and experience. Useful Lives in the database are derived from the Building Owners and Managers (BOMA) organization's guidelines, RSMeans cost data, and from client- defined historical experience.
Vacant	Vacant refers to a facility that is not occupied but is a maintained facility. See Abandoned.
Year Built	The year that a building or addition was originally built based on substantial completion or occupancy.
Year Installed	The year a system or element was built or the most recent major renovation date where a minimum of 70% of the system's Current Replacement Value (CRV) was replaced.



Suitability Report - Full

Project #: 12382	County: Atlanta Public Schools	Site #: 3057
Project: APS Assessments 2019	Region: 761	Site: Continental Colony ES
Grade Config: PK-5	Site Type: Elementary	Site Size: 9.00

Suitability	Rating	Score	Possible Score	Percent Score
Suitability - ES				
Learning Environment				
Learning Style Variety	Excel	5.00	5.00	100.00
Interior Environment	Excel	2.00	2.00	100.00
Exterior Environment	Good	1.20	1.50	80.00
General Classrooms				
Environment	Excel	4.65	4.65	100.00
Size	Excel	11.63	11.63	100.00
Location	Excel	3.49	3.49	100.00
Storage/Fixed Equip	Excel	3.49	3.49	100.00
Kindergarten				
Environment	Excel	0.42	0.42	100.00
Size	Excel	1.04	1.04	100.00
Location	Excel	0.31	0.31	100.00
Storage/Fixed Equip	Excel	0.31	0.31	100.00
ECE				
Environment	Excel	0.50	0.50	100.00
Size	Excel	1.25	1.25	100.00
Location	Excel	0.37	0.37	100.00
Storage/Fixed Equip	Excel	0.37	0.37	100.00
Self-Contained Special Ed				
Environment	(N/A)	0.00	0.00	0.00
Size	(N/A)	0.00	0.00	0.00
Location	(N/A)	0.00	0.00	0.00
Storage/Fixed Equip	(N/A)	0.00	0.00	0.00
Instructional Resource Rooms				
Environment	Excel	0.72	0.72	100.00
Size	Excel	1.80	1.80	100.00
Location	Good	0.43	0.54	80.00
Storage/Fixed Equip	Excel	0.54	0.54	100.00
Science				
Environment	Excel	0.40	0.40	100.00
Size	Excel	1.00	1.00	100.00
Location	Excel	0.30	0.30	100.00
Storage/Fixed Equip	Good	0.24	0.30	80.00
Music				
Environment	Good	0.59	0.74	80.00

Project #: 12382

County: Atlanta Public Schools

Site #: 3057

Project: APS Assessments 2019

Region: 761

Site: Continental Colony ES

Grade Config: PK-5

Site Type: Elementary

Site Size: 9.00

Suitability	Rating	Score	Possible Score	Percent Score
Size	Excel	1.85	1.85	100.00
Location	Good	0.44	0.56	80.00
Storage/Fixed Equip	Good	0.44	0.56	80.00
Art				
Environment	Excel	0.47	0.47	100.00
Size	Excel	1.17	1.17	100.00
Location	Excel	0.35	0.35	100.00
Storage/Fixed Equip	Good	0.28	0.35	80.00
Maker Space				
Environment	(N/A)	0.00	0.00	0.00
Size	(N/A)	0.00	0.00	0.00
Location	(N/A)	0.00	0.00	0.00
Storage/Fixed Equip	(N/A)	0.00	0.00	0.00
Computer Labs				
Environment	Excel	0.34	0.34	100.00
Size	Excel	0.85	0.85	100.00
Location	Excel	0.26	0.26	100.00
Storage/Fixed Equip	Excel	0.26	0.26	100.00
P.E.				
Environment	Excel	1.92	1.92	100.00
Size	Excel	4.80	4.80	100.00
Location	Excel	1.44	1.44	100.00
Storage/Fixed Equip	Fair	0.94	1.44	65.00
Performing Arts				
Environment	Excel	0.60	0.60	100.00
Size	Excel	1.51	1.51	100.00
Location	Excel	0.45	0.45	100.00
Storage/Fixed Equip	Good	0.36	0.45	80.00
Media Center				
Environment	Excel	0.97	0.97	100.00
Size	Excel	2.44	2.44	100.00
Location	Excel	0.73	0.73	100.00
Storage/Fixed Equip	Good	0.58	0.73	80.00
Restrooms (Student)	Good	0.71	0.89	80.00
Administration	Excel	2.56	2.56	100.00
Counseling	Fair	0.19	0.29	65.00
Clinic	Excel	0.58	0.58	100.00
Staff WkRm/Toilets	Excel	1.27	1.27	100.00
Cafeteria	Fair	3.25	5.00	65.00
Food Service and Prep	Excel	6.20	6.20	100.00
Custodial and Maintenance	Excel	0.50	0.50	100.00
Outside				
Vehicular Traffic	Excel	2.00	2.00	100.00
Pedestrian Traffic	Good	0.78	0.97	80.00
Parking	Good	0.65	0.81	80.00
Play Areas	Unsat	0.00	2.34	0.00

Project #: 12382

County: Atlanta Public Schools

Site #: 3057

Project: APS Assessments 2019

Region: 761

Site: Continental Colony ES

Grade Config: PK-5

Site Type: Elementary

Site Size: 9.00

Suitability	Rating	Score	Possible Score	Percent Score
Safety and Security				
Fencing	Fair	0.49	0.75	65.00
Signage & Way Finding	Fair	0.65	1.00	65.00
Ease of Supervision	Good	2.40	3.00	80.00
Controlled Entrances	Poor	0.25	0.50	50.00
Total For Site:		88.01	95.85	91.82

Comments

Suitability - ES

Continental Colony Elementary School is a neighborhood school that serves students in grades PreK through 5. The original building was built in 1963, with an addition in 1994 and additional renovations completed in 2011. The school is starting the International Baccalaureate Programme for the early years.

Suitability - ES->P.E.-->Storage/Fixed Equip

The gym floor is wood, with no rubber surfaces. There are no mats behind the basketball hoops or any other fixed structure.

Suitability - ES->Media Center-->Storage/Fixed Equip

The media center has very few outlets which are needed for larger groups and work on laptop computers.

Suitability - ES->Counseling

The location of the counseling office is far from the front office and from student records. The counseling office has HVAC issues throughout the year. Air circulation and ventilation in this basement office is poor.

Suitability - ES->Cafeteria

This space is very open to other rooms and to the outdoors, with difficult sight lines. The open access to the outside and the parking lot is a safety consideration. There is no flexibility for use of this space and little storage available for tables.

Suitability - ES->Outside-->Parking

There are no parking spaces for visitors and visitor parking is not marked.

Suitability - ES->Outside-->Play Areas

The playground is adjacent to the parking lot with a big open grass area that runs into the street. There is no fence surrounding the play area.

Suitability - ES->Safety and Security-->Fencing

Fence areas surround the indoor courtyards, but not the building or the play area.

Suitability - ES->Safety and Security-->Signage & Way Finding

Several external safety signs are not visible. The traffic signs for buses, cars and visitors are not in place.

Suitability - ES->Safety and Security-->Controlled Entrances

There is no security vestibule in this school. There is a second entrance through the cafeteria that is unmarked and mistaken as the main entrance.