

Atlanta Public Schools/ Therrell Cluster

Kimberly Elementary School

Revised

School Assessment Report

November 10, 2020



Table of Contents

School Executive Summary	4
School Dashboard Summary	7
School Condition Summary	8
<u>1958_1966 Bldg 2010_2011</u>	10
Executive Summary	10
Dashboard Summary	11
Condition Summary	12
Photo Album	13
Condition Detail	14
System Listing	15
System Notes	17
Renewal Schedule	30
Forecasted Sustainment Requirement	33
Condition Index Forecast by Investment Scenario	34
Deficiency Summary By System	35
Deficiency Summary By Priority	36
Deficiency By Priority Investment	37
Deficiency Summary By Category	38
Deficiency Details By Priority	39
<u>1993 Bldg 2020_2030</u>	41
Executive Summary	41
Dashboard Summary	42
Condition Summary	43
Photo Album	44
Condition Detail	45
System Listing	46
System Notes	48
Renewal Schedule	60
Forecasted Sustainment Requirement	63

School Assessment Report

Condition Index Forecast by Investment Scenario	64
Deficiency Summary By System	65
Deficiency Summary By Priority	66
Deficiency By Priority Investment	67
Deficiency Summary By Category	68
Deficiency Details By Priority	69
Site	72
Executive Summary	72
Dashboard Summary	73
Condition Summary	74
Photo Album	75
Condition Detail	76
System Listing	77
System Notes	78
Renewal Schedule	81
Forecasted Sustainment Requirement	82
Condition Index Forecast by Investment Scenario	83
Deficiency Summary By System	84
Deficiency Summary By Priority	85
Deficiency By Priority Investment	86
Deficiency Summary By Category	87
Deficiency Details By Priority	88
Glossary	89

School Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as $100 - \text{Total FCI}$ (without the %) where 100 is best and 0 is worst condition.

Gross Area (SF):	64,509
Year Built:	1958
Last Renovation:	2016
Replacement Value:	\$13,255,301
Repair Cost:	\$1,031,546.00
Total FCI:	7.78 %
Total RSLI:	56.03 %
FCA Score:	92.22



Description:

The Kimberly Elementary School campus consists of (3) main school buildings located at 3090 McMurray Drive S.W., Atlanta, GA. The original 64,509 SF campus was constructed in 1958 and additions to the main school building were constructed in 1966, 1993 and 2015. In 1999, the original 1958 building was renovated; exterior doors and windows, interior finishes, and MEP systems.

This report contains condition and adequacy data collected during the 2019 Facility Condition Assessment (FCA) Update. Detailed condition and deficiency statements are contained in this report for the site and building elements.

SUBSTRUCTURE

The buildings rest on slab-on grade and are assumed to have standard cast-in-place concrete foundations.

SUPERSTRUCTURE

School Assessment Report - Kimberly Elementary School

1958_1966 Building 2010_2011 The superstructure is concrete frame. Floor construction is slab on-grade. Roof construction is metal pan deck with lightweight fill. The exterior enclosure is comprised of walls of brick veneer over CMU. Exterior windows are aluminum frame mostly with fixed panes. Exterior doors are hollow metal steel mostly with glazing. Roofing is typically low slope with built-up system.

1993 Building 2020_2030 The superstructure is steel frame. Floor construction is slab on-grade. Roof construction is metal pan deck with lightweight fill. The exterior enclosure is comprised of walls of brick veneer over CMU. Exterior windows are aluminum frame with fixed panes. Exterior doors are hollow metal steel mostly with glazing. Roofing is typically low slope with single ply membrane (2020) or pitched with standing seam metal over the Multi-Purpose space (2030).

Roof openings include a roof hatch with fixed ladder access. Most building entrances appear to comply with ADA requirements.

INTERIORS

Interior partitions are typically CMU. Interior doors are generally solid core wood with metal frames and mostly with glazing. Interior fittings include the following items: white boards, graphics and identifying devices, lockers, toilet accessories, storage shelving, handrails, fabricated toilet partitions. The interior wall finishes are typically painted CMU. Floor finishes in common areas are typically vinyl composition tile. Floor finishes in consist of vinyl composition tile, epoxy for restrooms, neoprene for multipurpose facilities, and carpet for the administration and Media Center. Ceiling finishes in common areas are typically suspended acoustical tile. Ceiling finishes in assignable areas are typically painted drywall.

SERVICES CONVEYING:

The school has an elevator in the main building.

PLUMBING:

Plumbing fixtures are typically low-flow water fixtures with manual control valves. Domestic water distribution is combination of copper and galvanized steel with electric hot water heating. Sanitary waste system is cast iron. Rainwater drainage system on most buildings is a combination of internal and external roof drains.

HVAC:

Ground level and rooftop package DX units are utilized for heating and cooling. The heating/cooling distribution system is a ductwork system utilizing air handling units. Ceiling mounted exhaust fans are installed in bathrooms and other required areas. Controls and instrumentation are digital and are centrally controlled by an energy management system. This building has a remote Building Automation System.

FIRE PROTECTION:

The buildings do have a fire sprinkler system. Fire extinguishers and cabinets are distributed near fire exits and corridors.

ELECTRICAL:

The main electrical service is fed from a pad mounted transformer to the main switchboard/distribution panel located in the building. Lighting is lay-in type, fluorescent light fixtures. Branch circuit wiring is typically copper serving electrical switches and receptacles. Emergency and life safety egress lighting systems are installed and exit signs are present at exit doors and are typically illuminated.

COMMUNICATIONS AND SECURITY:

The fire alarm system consists of audible/visual strobe annunciators in common spaces, and interior corridors. The system is activated by manual pull stations and smoke detectors and the system is centrally monitored. The telephone and data systems are segregated and include dedicated equipment closets. This building does have a local area network (LAN). The building includes an internal security system that is actuated by the following items: contacts, infrared, optical or a combination of all devices. The building has controlled entry doors access provided by card readers; entry doors are secured with magnetic door locks. The security system has CCTV cameras and is centrally monitored; this building has a public address and paging system combined with the telephone system.

OTHER ELECTRICAL SYSTEMS:

School Assessment Report - Kimberly Elementary School

This school does have a natural gas emergency generator on-site.

EQUIPMENT & FURNISHINGS

This school includes the following items and equipment: fixed food service, library equipment, audio-visual equipment, athletic equipment, fixed furnishings, and computers.

SITE

Campus site features include paved driveways and parking lots, pedestrian pavement, landscaping, playground equipment, and fencing. Site mechanical and electrical features include water, sewer, natural gas, and site lighting.

CODE REVIEW

ACCESSIBILITY:

The buildings are generally in compliance with applicable ADA requirements with respect to path of travel, interior and exterior doors, interior signage, and toilet room dimensions, fixtures, and fittings. Most building entrances appear to comply with ADA requirements.

LIFE-SAFETY SYSTEMS:

The buildings are covered with a wet sprinkler system. Fire extinguishers are located throughout the buildings. Power outlets in wet areas are GFIC protected. The fire alarm system includes detection devices, audio/visual alarms, and pull stations. Emergency/egress lighting is a combination of battery and special circuit systems. Illuminated exit signage is present in corridors and at exit doors.

Attributes:

General Attributes:

Arch Condition Assessor:	Jejuan Hall	MEP Condition Assessor:	Hayden Collins
School Grades:	01, 02, 03, 04, 05, KK, PK	DOE Drawing Total GSF:	63379
DOE Facility Number:	1064	Total # of Modular/Portables:	0
DOE Interior Site SF:	63379	Total GSF of Modular/Portables:	0
Approx. Acres:	7.2	Status:	Active


School Assessment Report - Kimberly Elementary School

School Dashboard Summary


Gross Area: 64,509
 Year Built: 1958
 Repair Cost: \$1,031,546
 FCI: 7.78 %

Last Renovation: 2016
 Replacement Value: \$13,255,301
 RSLI%: 56.03 %


Deficiency By Category

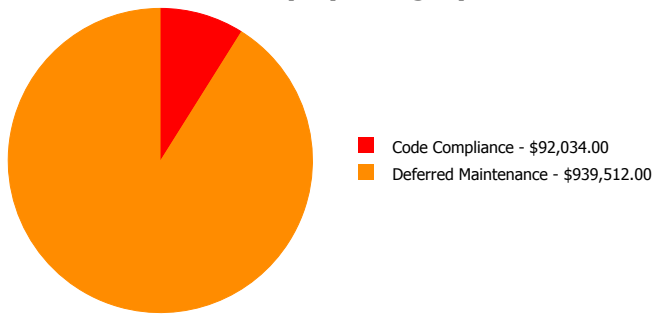


Deficiency By Priority

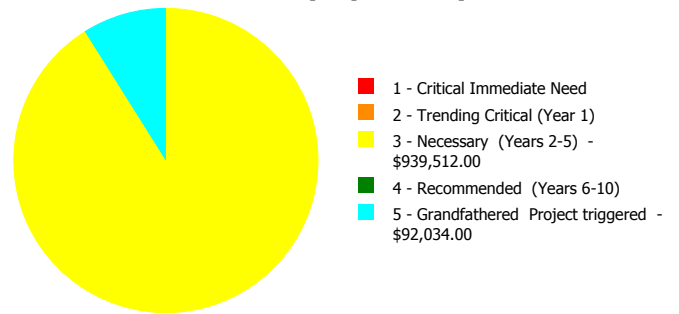

Deficiency By System

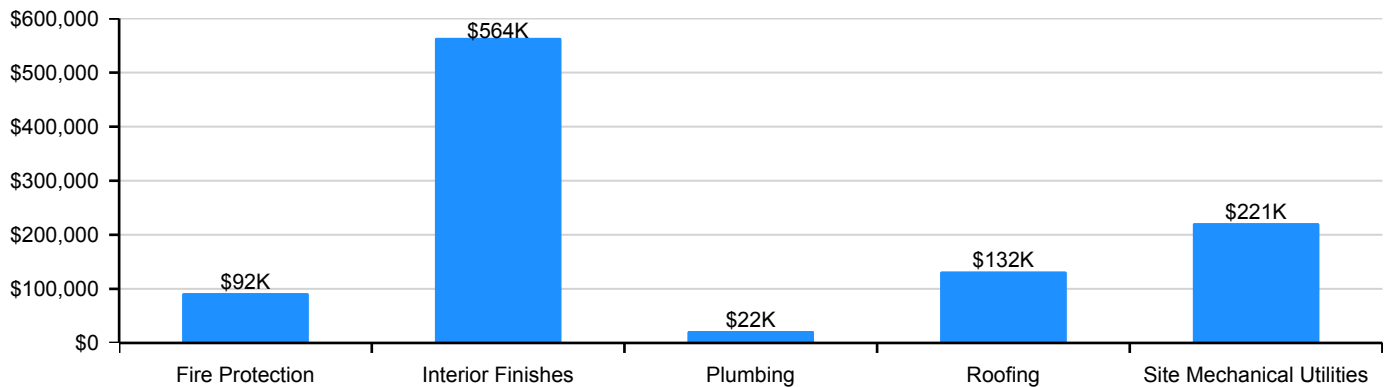

10 Year Investment Forecast

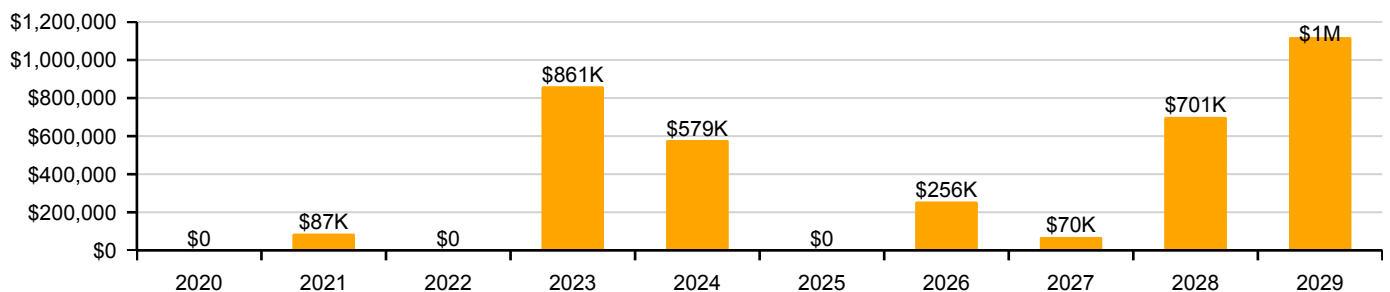

School Condition Summary

The Table below shows the RSLI and FCI for each major system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.


Current Investment Requirement and Condition by Unifomat Classification

UNIFORMAT Classification	RSLI%	FCI %	Current Repair
A10 - Foundations	49.91 %	0.00 %	\$0.00
B10 - Superstructure	44.29 %	0.00 %	\$0.00
B20 - Exterior Enclosure	40.63 %	0.00 %	\$0.00
B30 - Roofing	17.99 %	26.88 %	\$131,934.00
C10 - Interior Construction	68.89 %	0.00 %	\$0.00
C20 - Stairs	89.16 %	0.00 %	\$0.00
C30 - Interior Finishes	41.22 %	50.93 %	\$564,159.00
D10 - Conveying	80.00 %	0.00 %	\$0.00
D20 - Plumbing	72.19 %	3.68 %	\$22,024.00
D30 - HVAC	76.92 %	0.00 %	\$0.00
D40 - Fire Protection	77.95 %	26.22 %	\$92,034.00
D50 - Electrical	67.11 %	0.00 %	\$0.00
E10 - Equipment	80.00 %	0.00 %	\$0.00
E20 - Furnishings	80.00 %	0.00 %	\$0.00
G20 - Site Improvements	60.16 %	0.00 %	\$0.00
G30 - Site Mechanical Utilities	25.40 %	79.63 %	\$221,395.00
G40 - Site Electrical Utilities	13.33 %	0.00 %	\$0.00
Totals:	56.03 %	7.78 %	\$1,031,546.00

Condition Deficiency Priority

Facility Name	Gross Area (S.F.)	FCI %	1 - Critical Immediate Need	2 - Trending Critical (Year 1)	3 - Necessary (Years 2-5)	4 - Recommended (Years 6-10)	5 - Grandfathered Project triggered
1958_1966 Bldg 2010_2011	44,493	3.94	\$0.00	\$0.00	\$311,269.00	\$0.00	\$0.00
1993 Bldg 2020_2030	20,016	14.37	\$0.00	\$0.00	\$406,848.00	\$0.00	\$92,034.00
Site	64,509	11.69	\$0.00	\$0.00	\$221,395.00	\$0.00	\$0.00
Total:		7.78	\$0.00	\$0.00	\$939,512.00	\$0.00	\$92,034.00

Deficiencies By Priority

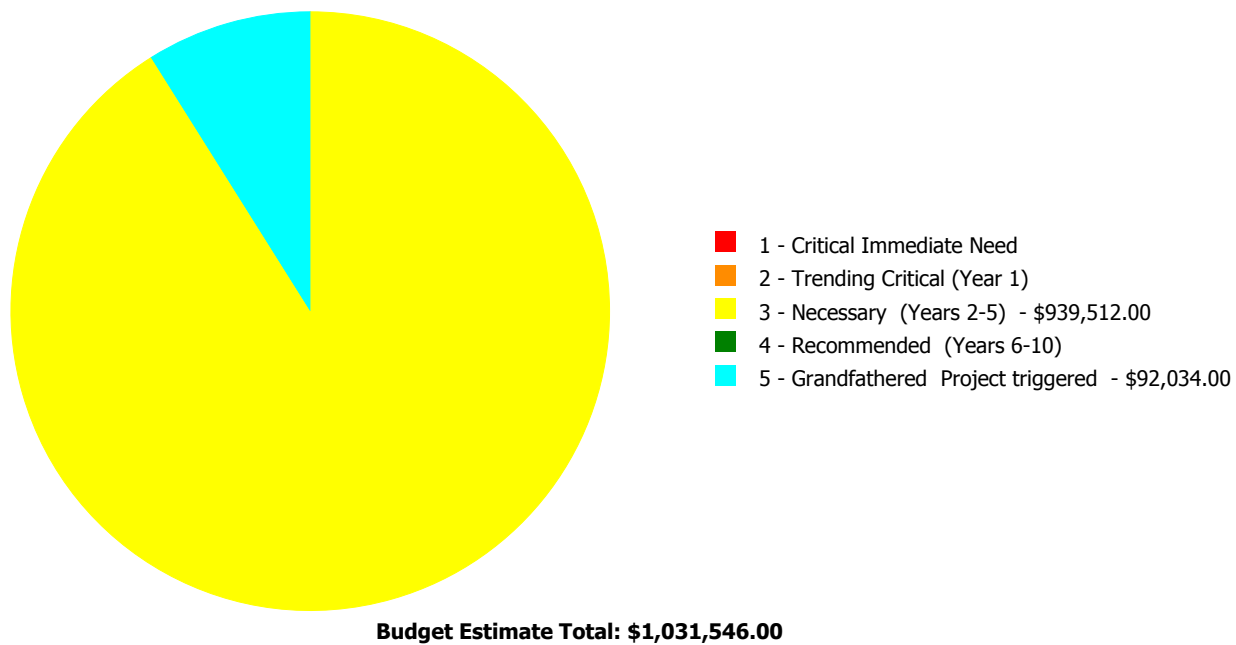

Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as $100 - \text{Total FCI}$ (without the %) where 100 is best and 0 is worst condition.

Function:	Elementary
Gross Area (SF):	44,493
Year Built:	1958
Last Renovation:	2016
Replacement Value:	\$7,891,107
Repair Cost:	\$311,269.00
Total FCI:	3.94 %
Total RSLI:	54.62 %
FCA Score:	96.06



Description:


The narrative for this building is included in the Executive Summary Description at the front of this report.

Attributes: This asset has no attributes.


Dashboard Summary

Function:	Elementary	Gross Area:	44,493
Year Built:	1958	Last Renovation:	2016
Repair Cost:	\$311,269	Replacement Value:	\$7,891,107
FCI:	3.94 %	RSLI%:	54.62 %


Deficiency By Category

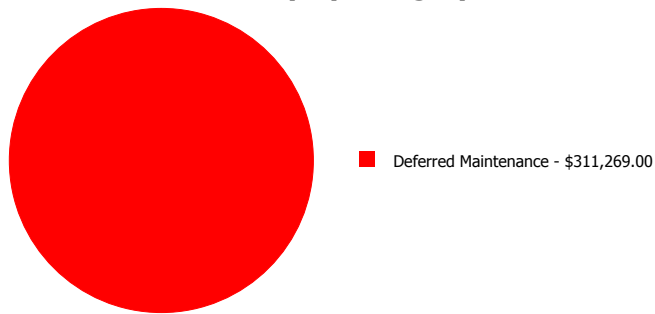


Deficiency By Priority

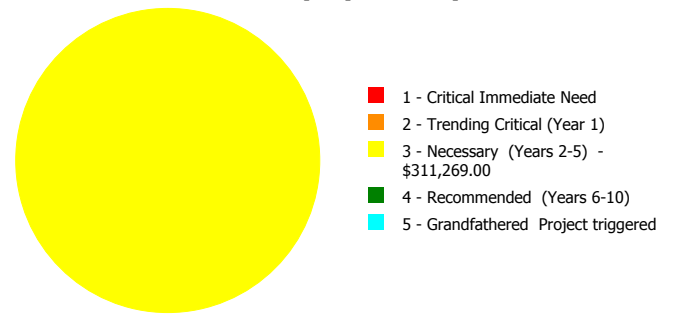

Deficiency By System

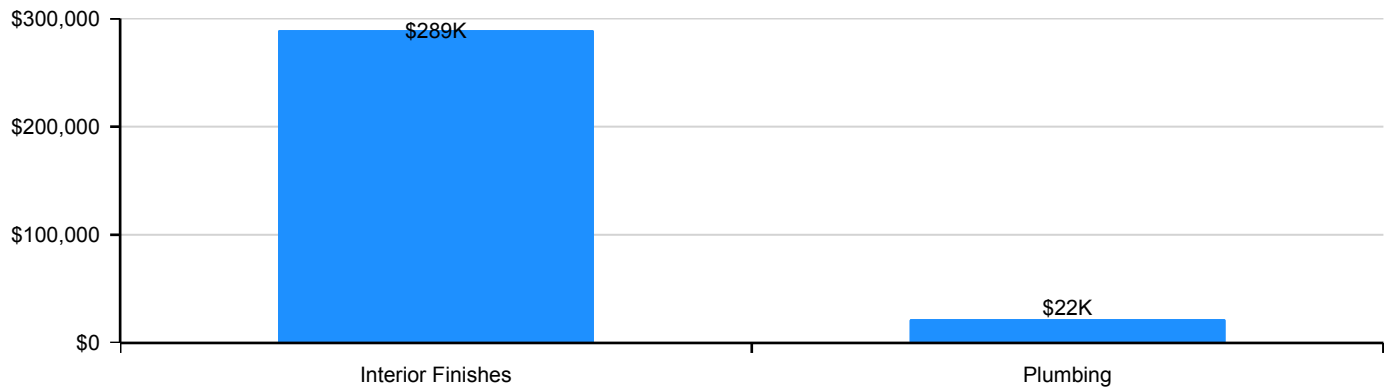

10 Year Investment Forecast

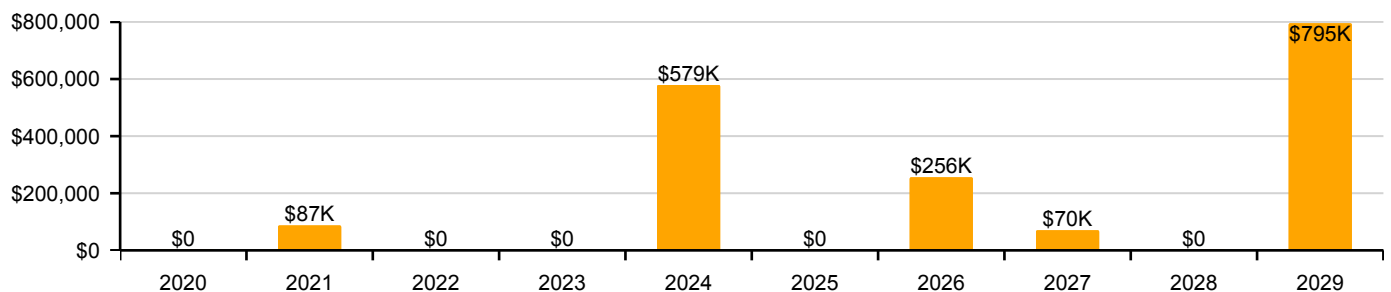

Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

UNIFORMAT Classification	RSLI %	FCI %	Current Repair Cost
A10 - Foundations	39.00 %	0.00 %	\$0.00
B10 - Superstructure	39.00 %	0.00 %	\$0.00
B20 - Exterior Enclosure	36.69 %	0.00 %	\$0.00
B30 - Roofing	22.34 %	0.00 %	\$0.00
C10 - Interior Construction	63.76 %	0.00 %	\$0.00
C20 - Stairs	96.00 %	0.00 %	\$0.00
C30 - Interior Finishes	47.02 %	43.37 %	\$289,245.00
D10 - Conveying	80.00 %	0.00 %	\$0.00
D20 - Plumbing	68.00 %	5.27 %	\$22,024.00
D30 - HVAC	77.45 %	0.00 %	\$0.00
D40 - Fire Protection	75.31 %	0.00 %	\$0.00
D50 - Electrical	60.30 %	0.00 %	\$0.00
E10 - Equipment	80.00 %	0.00 %	\$0.00
E20 - Furnishings	80.00 %	0.00 %	\$0.00
Totals:	54.62 %	3.94 %	\$311,269.00

Photo Album

The photo album consists of the various cardinal compass directions of the building..

1). North Elevation - Feb 07, 2020



2). West Elevation - Feb 07, 2020



3). South Elevation - Feb 07, 2020



4). East Elevation - Feb 07, 2020



Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment)
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system as new construction.

System Listing

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
A1010	Standard Foundations	\$7.65	S.F.	44,493	100	1958	2058		39.00 %	0.00 %	39			\$340,371
A1030	Slab on Grade	\$6.46	S.F.	44,493	100	1958	2058		39.00 %	0.00 %	39			\$287,425
B1010	Floor Construction	\$18.86	S.F.	44,493	100	1958	2058		39.00 %	0.00 %	39			\$839,138
B1020	Roof Construction	\$12.19	S.F.	44,493	100	1958	2058		39.00 %	0.00 %	39			\$542,370
B2010	Exterior Walls	\$12.93	S.F.	44,493	100	1958	2058		39.00 %	0.00 %	39			\$575,294
B2020	Exterior Windows	\$8.07	S.F.	44,493	30	1999	2029		33.33 %	0.00 %	10			\$359,059
B2030	Exterior Doors	\$0.80	S.F.	44,493	30	1999	2029		33.33 %	0.00 %	10			\$35,594
B3010105	Built-Up	\$7.15	S.F.	44,493	25	1999	2024		20.00 %	0.00 %	5			\$318,125
B3020	Roof Openings	\$0.50	S.F.	22,000	30	2016	2046		90.00 %	0.00 %	27			\$11,000
C1010	Partitions	\$5.49	S.F.	44,493	100	1958	2058		39.00 %	0.00 %	39			\$244,267
C1020	Interior Doors	\$3.57	S.F.	44,493	40	2015	2055		90.00 %	0.00 %	36			\$158,840
C1030	Fittings	\$2.60	S.F.	44,493	20	2015	2035		80.00 %	0.00 %	16			\$115,682
C2010	Stair Construction	\$2.81	S.F.	44,493	100	2015	2115		96.00 %	0.00 %	96			\$125,025
C3010230	Paint & Covering	\$1.47	S.F.	44,493	10	1999	2009		0.00 %	0.00 %	-10			\$65,405
C3020405	Epoxy	\$17.30	S.F.	2,000	15	1999	2014		0.00 %	118.00 %	-5		\$40,828.00	\$34,600
C3020901	Carpet	\$7.50	S.F.	6,726	8	1999	2007		0.00 %	110.00 %	-12		\$55,490.00	\$50,445
C3020903	VCT	\$3.48	S.F.	35,767	15	1999	2014		0.00 %	155.00 %	-5		\$192,927.00	\$124,469
C3030	Ceiling Finishes	\$8.81	S.F.	44,493	20	2015	2035		80.00 %	0.00 %	16			\$391,983
D1010	Elevators and Lifts	\$1.40	S.F.	44,493	20	2015	2035		80.00 %	0.00 %	16			\$62,290
D2010	Plumbing Fixtures	\$6.44	S.F.	44,493	20	2015	2035		80.00 %	0.00 %	16			\$286,535
D2020	Domestic Water Distribution	\$0.75	S.F.	44,493	30	2015	2045		86.67 %	0.00 %	26			\$33,370
D2030	Sanitary Waste	\$1.75	S.F.	44,493	30	1999	2029		33.33 %	0.00 %	10			\$77,863
D2040	Rain Water Drainage	\$0.45	S.F.	44,493	20	1999	2019		0.00 %	110.00 %	0		\$22,024.00	\$20,022
D3010	Energy Supply	\$0.61	S.F.	44,493	30	2015	2045		86.67 %	0.00 %	26			\$27,141
D3040	Distribution Systems	\$18.95	S.F.	44,493	20	2015	2035		80.00 %	0.00 %	16			\$843,142
D3050	Terminal & Package Units	\$10.82	S.F.	44,493	15	2015	2030		73.33 %	0.00 %	11			\$481,414
D3060	Controls & Instrumentation	\$2.25	S.F.	44,493	15	2015	2030		73.33 %	0.00 %	11			\$100,109
D4010	Sprinklers	\$4.14	S.F.	44,493	30	2015	2045		86.67 %	0.00 %	26			\$184,201
D4020	Standpipes	\$0.34	S.F.	44,493	30	2015	2045		86.67 %	0.00 %	26			\$15,128
D4030	Fire Protection Specialties	\$0.66	S.F.	44,493	0	2015			0.00 %	0.00 %				\$29,365
D4090	Other Fire Protection Systems	\$0.60	S.F.	44,493	15	2015	2030		73.33 %	0.00 %	11			\$26,696
D5010	Electrical Service/Distribution	\$2.29	S.F.	44,493	20	2015	2035		80.00 %	0.00 %	16			\$101,889

School Assessment Report - 1958_1966 Bldg 2010_2011

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
D5020	Branch Wiring	\$5.69	S.F.	44,493	20	2015	2035		80.00 %	0.00 %	16			\$253,165
D5020	Lighting	\$3.71	S.F.	44,493	20	2015	2035		80.00 %	0.00 %	16			\$165,069
D5030810	Security & Detection Systems	\$1.51	S.F.	44,493	20	2006	2026		35.00 %	0.00 %	7			\$67,184
D5030910	Fire Alarm Systems	\$2.74	S.F.	44,493	20	2006	2026		35.00 %	0.00 %	7			\$121,911
D5030920	Data Communication	\$3.56	S.F.	44,493	25	2006	2031		48.00 %	0.00 %	12			\$158,395
D5090	Other Electrical Systems	\$1.68	S.F.	44,493	15	2006	2021		13.33 %	0.00 %	2			\$74,748
E1020	Institutional Equipment	\$0.10	S.F.	44,493	20	2015	2035		80.00 %	0.00 %	16			\$4,449
E1090	Other Equipment	\$0.91	S.F.	44,493	20	2015	2035		80.00 %	0.00 %	16			\$40,489
E2010	Fixed Furnishings	\$2.19	S.F.	44,493	20	2015	2035		80.00 %	0.00 %	16			\$97,440
Total									54.62 %	3.94 %			\$311,269.00	\$7,891,107

System Notes

The facility description in the executive summary contains an overview of each system. The system notes listed below provide additional information on select systems found within the facility.

System: B2010 - Exterior Walls



Note:

System: B2020 - Exterior Windows



Note:

System: B2030 - Exterior Doors



Note:


School Assessment Report - 1958_1966 Bldg 2010_2011

System: B3010105 - Built-Up



Note:

System: B3020 - Roof Openings

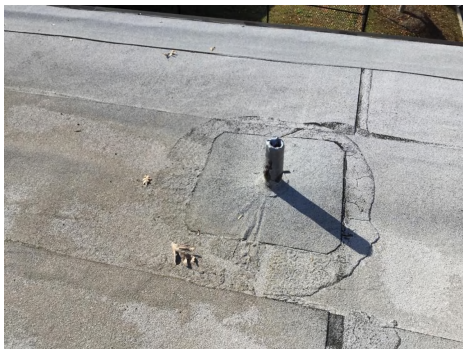

Note:

System: C1010 - Partitions



Note:


School Assessment Report - 1958_1966 Bldg 2010_2011

System: C1020 - Interior Doors





Note:

System: C1030 - Fittings

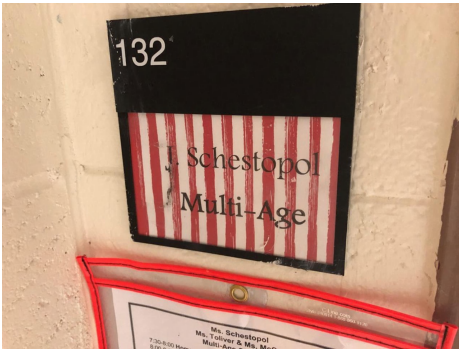

Note:


System: C2010 - Stair Construction

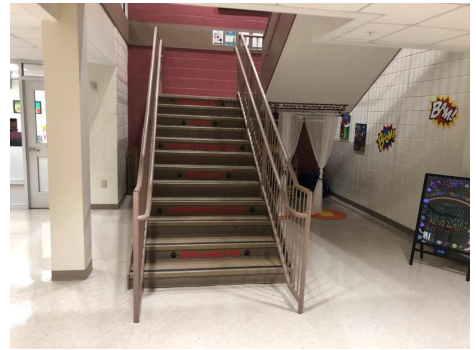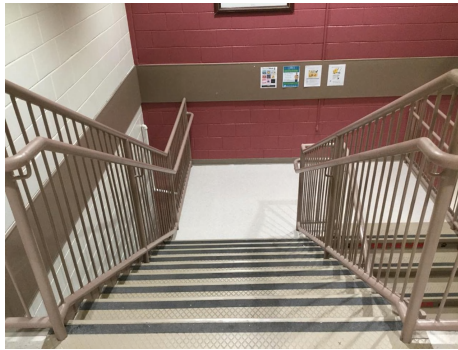

Note:


School Assessment Report - 1958_1966 Bldg 2010_2011

System: C3010230 - Paint & Covering

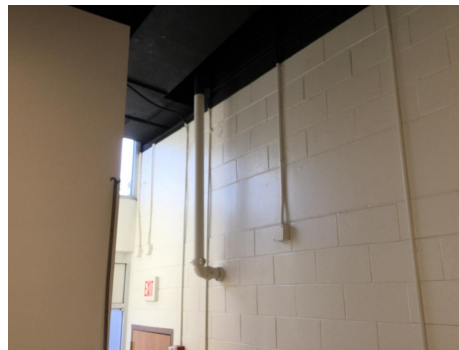

Note:

System: C3020405 - Epoxy

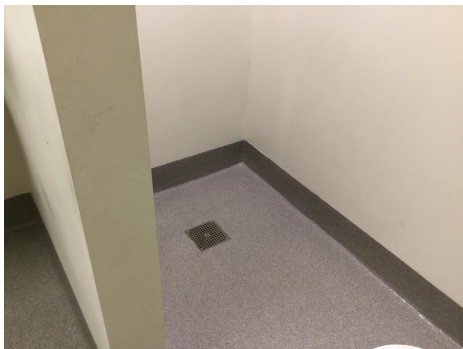

Note:

System: C3020901 - Carpet



Note:

School Assessment Report - 1958_1966 Bldg 2010_2011

System: C3020903 - VCT




Note:

System: C3030 - Ceiling Finishes



Note:


System: D1010 - Elevators and Lifts

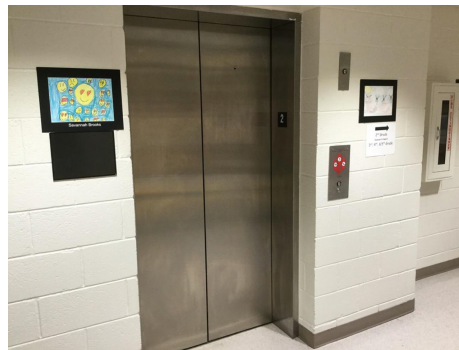

Note:

School Assessment Report - 1958_1966 Bldg 2010_2011

System: D2010 - Plumbing Fixtures




Note:

System: D2020 - Domestic Water Distribution



Note:

System: D2030 - Sanitary Waste

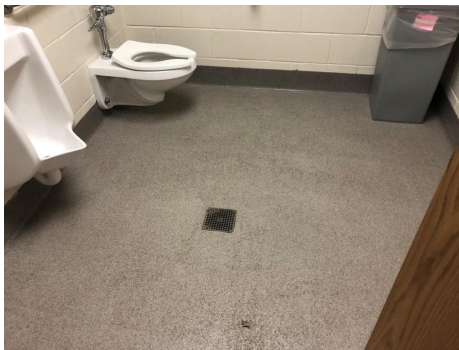

Note:

System: D2040 - Rain Water Drainage



System: D3010 - Energy Supply



System: D3040 - Distribution Systems



Note:


School Assessment Report - 1958_1966 Bldg 2010_2011

System: D3050 - Terminal & Package Units



Note:

System: D3060 - Controls & Instrumentation

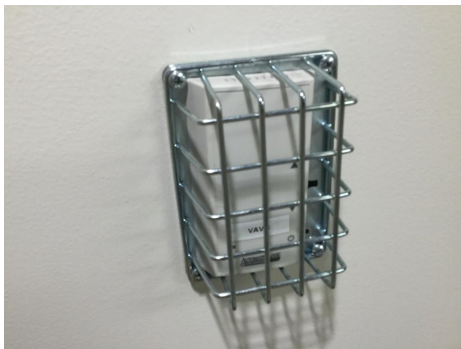

Note:

System: D4010 - Sprinklers



Note:

School Assessment Report - 1958_1966 Bldg 2010_2011

System: D4020 - Standpipes



Note:

System: D4030 - Fire Protection Specialties



Note:

System: D4090 - Other Fire Protection Systems



Note:

School Assessment Report - 1958_1966 Bldg 2010_2011

System: D5010 - Electrical Service/Distribution



Note:

System: D5020 - Branch Wiring



Note:


System: D5020 - Lighting



Note:

School Assessment Report - 1958_1966 Bldg 2010_2011

System: D5030810 - Security & Detection Systems




Note:

System: D5030910 - Fire Alarm Systems



Note:

System: D5030920 - Data Communication



Note:


School Assessment Report - 1958_1966 Bldg 2010_2011

System: D5090 - Other Electrical Systems



Note:

System: E1020 - Institutional Equipment

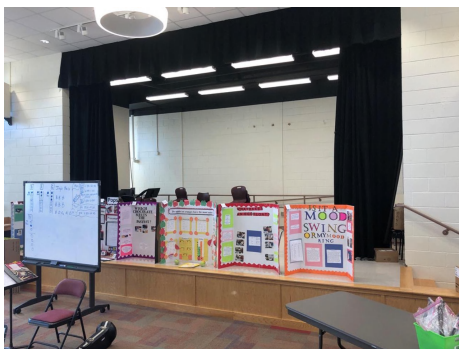

Note:

System: E1090 - Other Equipment



Note:

School Assessment Report - 1958_1966 Bldg 2010_2011

System: E2010 - Fixed Furnishings



Note:

Renewal Schedule

eCOMET forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the System Listing table. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.

Inflation Rate: 3%

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
Total:	\$311,269	\$0	\$87,230	\$0	\$0	\$579,006	\$0	\$255,820	\$70,293	\$0	\$795,211	\$2,098,830
* A - Substructure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A10 - Foundations	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A1010 - Standard Foundations	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A1030 - Slab on Grade	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B - Shell	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B10 - Superstructure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B1010 - Floor Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B1020 - Roof Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B20 - Exterior Enclosure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B2010 - Exterior Walls	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B2020 - Exterior Windows	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$530,799	\$530,799
B2030 - Exterior Doors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$52,620	\$52,620
B30 - Roofing	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B3010 - Roof Coverings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B3010105 - Built-Up	\$0	\$0	\$0	\$0	\$0	\$579,006	\$0	\$0	\$0	\$0	\$0	\$579,006
B3020 - Roof Openings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C - Interiors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C10 - Interior Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1010 - Partitions	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1020 - Interior Doors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1030 - Fittings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C20 - Stairs	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* C2010 - Stair Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C30 - Interior Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3010 - Wall Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0

School Assessment Report - 1958_1966 Bldg 2010_2011

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
C3010230 - Paint & Covering	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$96,688	\$96,688
C3020 - Floor Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020405 - Epoxy	\$40,828	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$40,828
C3020901 - Carpet	\$55,490	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$70,293	\$0	\$0	\$125,783
C3020903 - VCT	\$192,927	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$192,927
C3030 - Ceiling Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D - Services	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D10 - Conveying	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D1010 - Elevators and Lifts	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D20 - Plumbing	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2010 - Plumbing Fixtures	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2020 - Domestic Water Distribution	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2030 - Sanitary Waste	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$115,105	\$115,105
D2040 - Rain Water Drainage	\$22,024	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$22,024
D30 - HVAC	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3010 - Energy Supply	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3040 - Distribution Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3050 - Terminal & Package Units	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3060 - Controls & Instrumentation	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D40 - Fire Protection	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D4010 - Sprinklers	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D4020 - Standpipes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D4030 - Fire Protection Specialties	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D4090 - Other Fire Protection Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D50 - Electrical	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5010 - Electrical Service/Distribution	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5020 - Branch Wiring	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5020 - Lighting	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030 - Communications and Security	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030810 - Security & Detection Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$90,891	\$0	\$0	\$0	\$90,891
D5030910 - Fire Alarm Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$164,929	\$0	\$0	\$0	\$164,929
D5030920 - Data Communication	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0


School Assessment Report - 1958_1966 Bldg 2010_2011

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
D5090 - Other Electrical Systems	\$0	\$0	\$87,230	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$87,230
E - Equipment & Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E10 - Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E1020 - Institutional Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E1090 - Other Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E20 - Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E2010 - Fixed Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0

* Indicates non-renewable system

Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and forecasted capital renewal (sustainment) requirements over the next ten years.

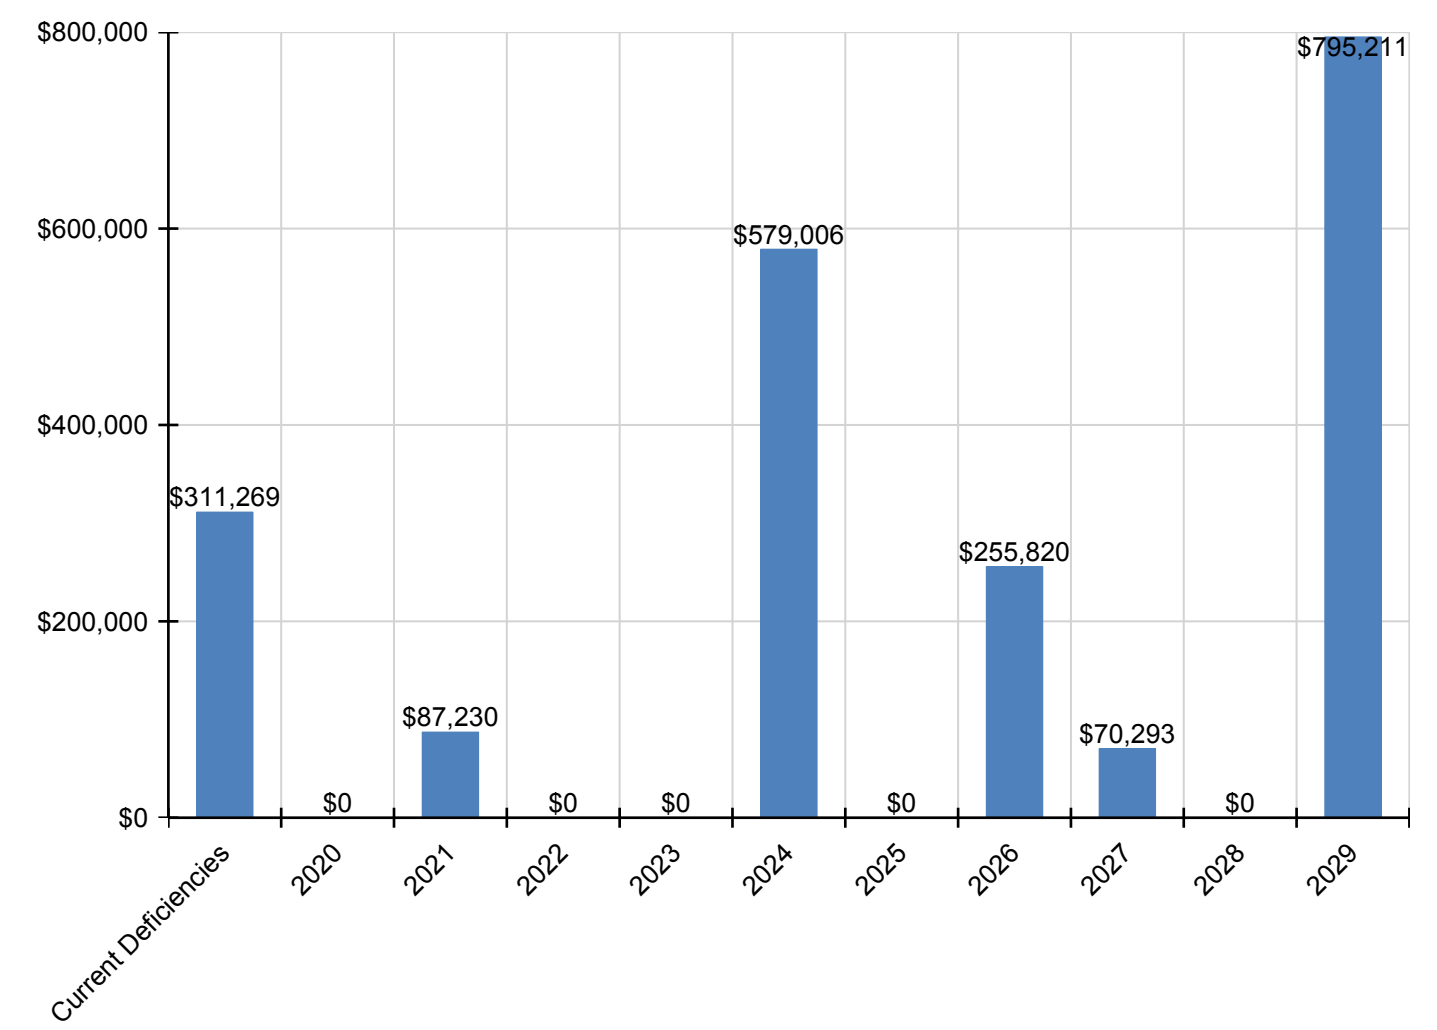


Condition Index Forecast by Investment Scenario

The chart below illustrates the effect of various investment levels on the building FCI for the next 10 years. The levels of investment shown below include:

- Current FCI: a variable investment amount based on renewing expired systems to maintain the current FCI for the building
- 2% Investment: an annual investment of 2% of the replacement value of the building, escalated for inflation
- 4% Investment: an annual investment of 4% of the replacement value of the building, escalated for inflation


Facility Investment vs. FCI Forecast

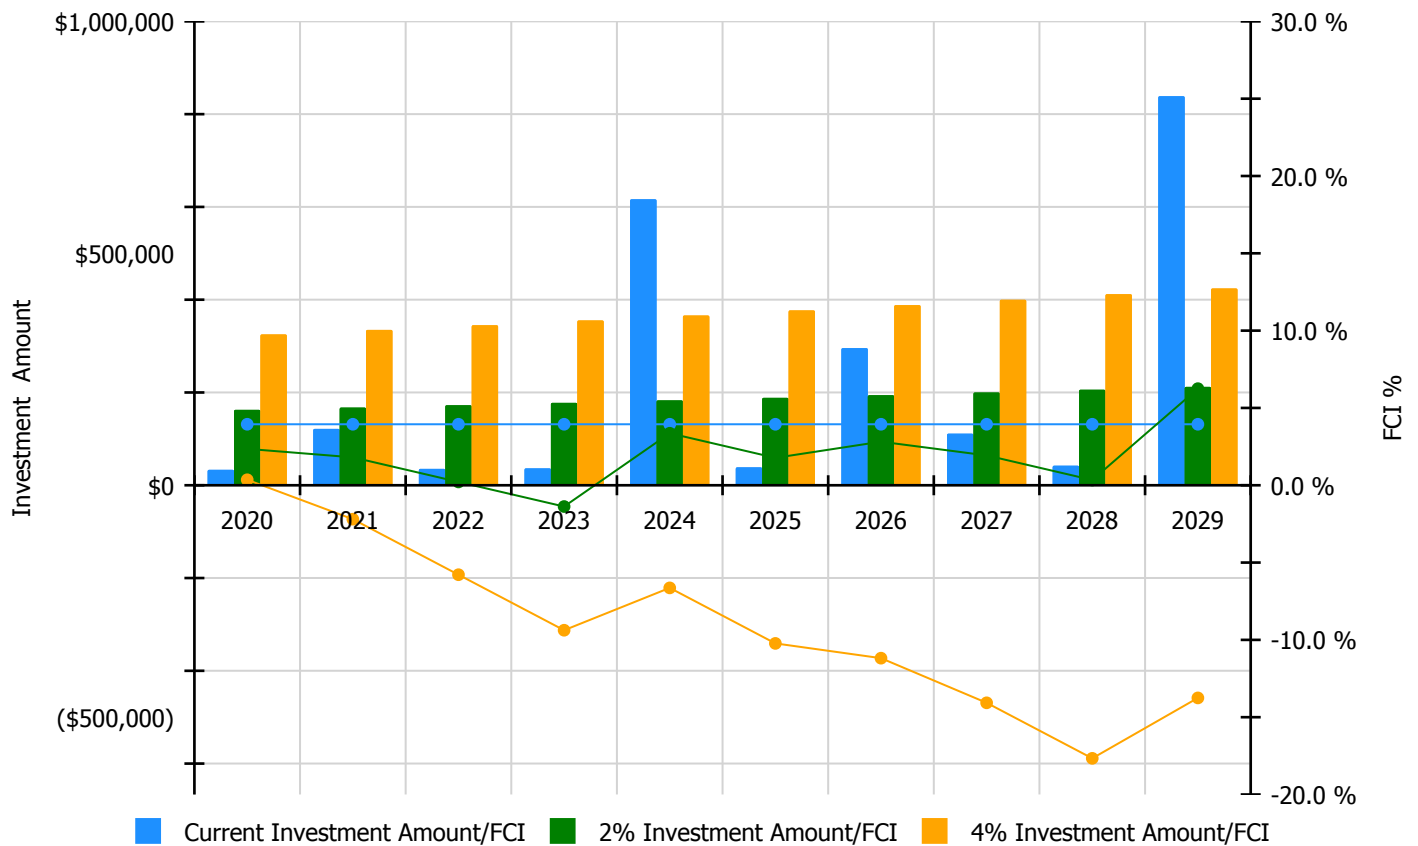

Year	Investment Amount Current FCI - 3.94%	2% Investment		4% Investment	
		Amount	FCI	Amount	FCI
2020	\$33,271	\$162,557.00	2.35 %	\$325,114.00	0.35 %
2021	\$121,500	\$167,434.00	1.81 %	\$334,867.00	-2.19 %
2022	\$35,297	\$172,457.00	0.21 %	\$344,913.00	-5.79 %
2023	\$36,356	\$177,630.00	-1.38 %	\$355,260.00	-9.38 %
2024	\$616,453	\$182,959.00	3.36 %	\$365,918.00	-6.64 %
2025	\$38,570	\$188,448.00	1.77 %	\$376,896.00	-10.23 %
2026	\$295,547	\$194,101.00	2.82 %	\$388,203.00	-11.18 %
2027	\$111,212	\$199,924.00	1.93 %	\$399,849.00	-14.07 %
2028	\$42,147	\$205,922.00	0.34 %	\$411,844.00	-17.66 %
2029	\$838,623	\$212,100.00	6.25 %	\$424,200.00	-13.75 %
Total:	\$2,168,977	\$1,863,532.00		\$3,727,064.00	


Deficiency Summary by System

Current deficiencies included assemblies that have reached or exceeded their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Useful Life'. The following chart lists all current deficiencies associated with this facility.

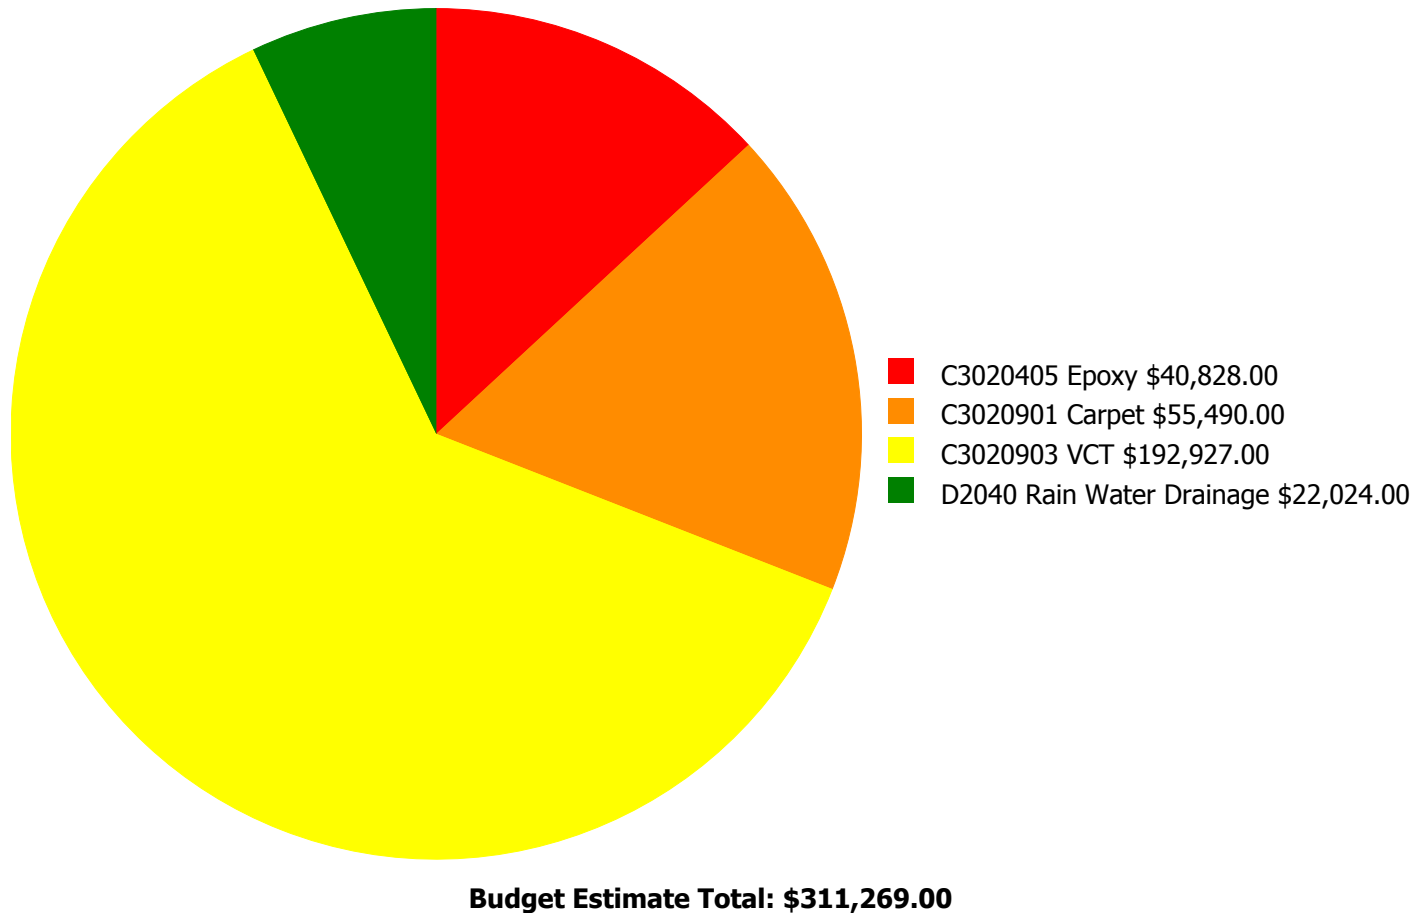

Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

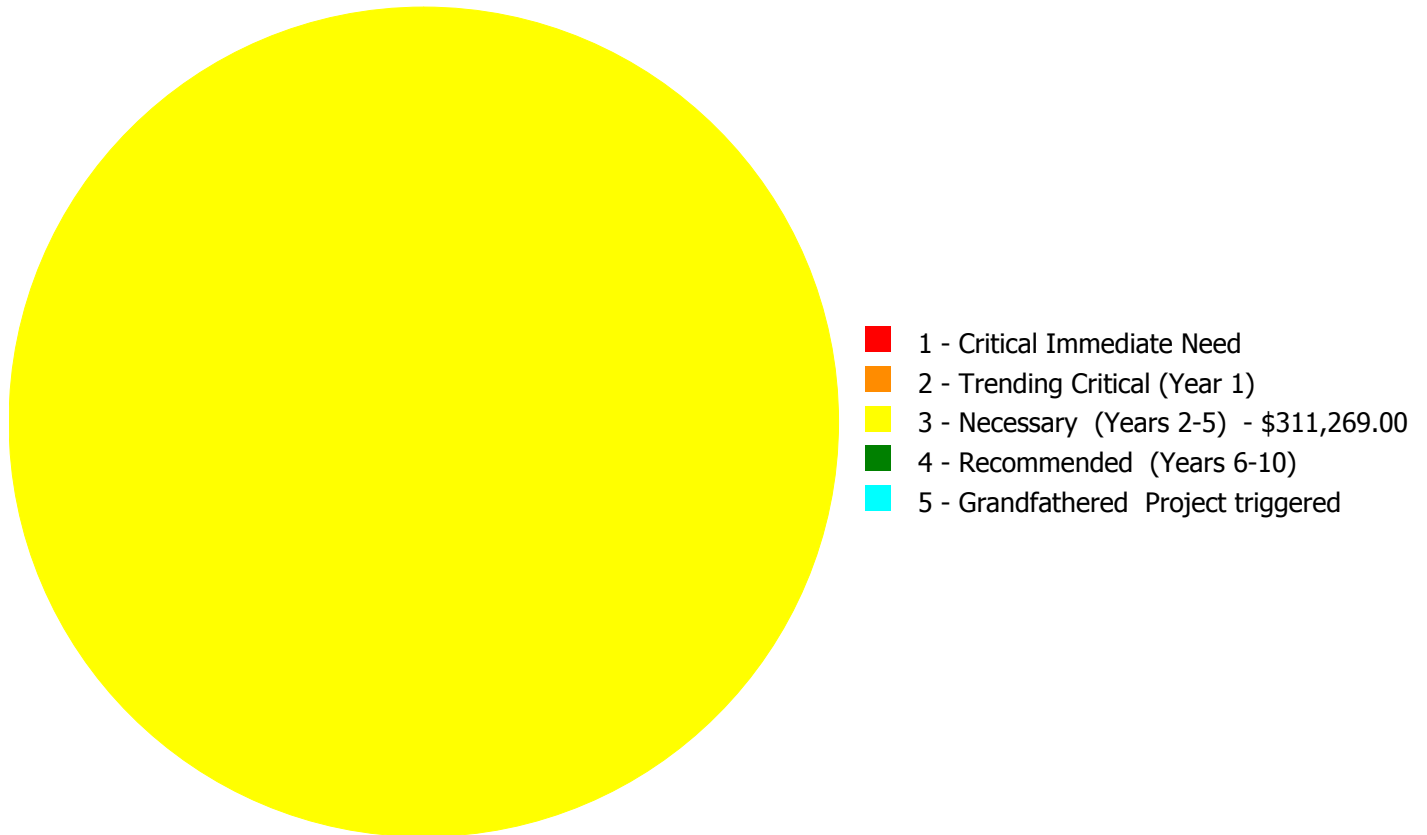

Budget Estimate Total: \$311,269.00


Deficiency By Priority Investment Table

The table below shows the current investment cost grouped by deficiency priority and building system.

System Code	System Description	1 - Critical Immediate Need	2 - Trending Critical (Year 1)	3 - Necessary (Years 2-5)	4 - Recommended (Years 6-10)	5 - Grandfathered Project triggered	Total
C3020405	Epoxy	\$0.00	\$0.00	\$40,828.00	\$0.00	\$0.00	\$40,828.00
C3020901	Carpet	\$0.00	\$0.00	\$55,490.00	\$0.00	\$0.00	\$55,490.00
C3020903	VCT	\$0.00	\$0.00	\$192,927.00	\$0.00	\$0.00	\$192,927.00
D2040	Rain Water Drainage	\$0.00	\$0.00	\$22,024.00	\$0.00	\$0.00	\$22,024.00
	Total:	\$0.00	\$0.00	\$311,269.00	\$0.00	\$0.00	\$311,269.00

Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

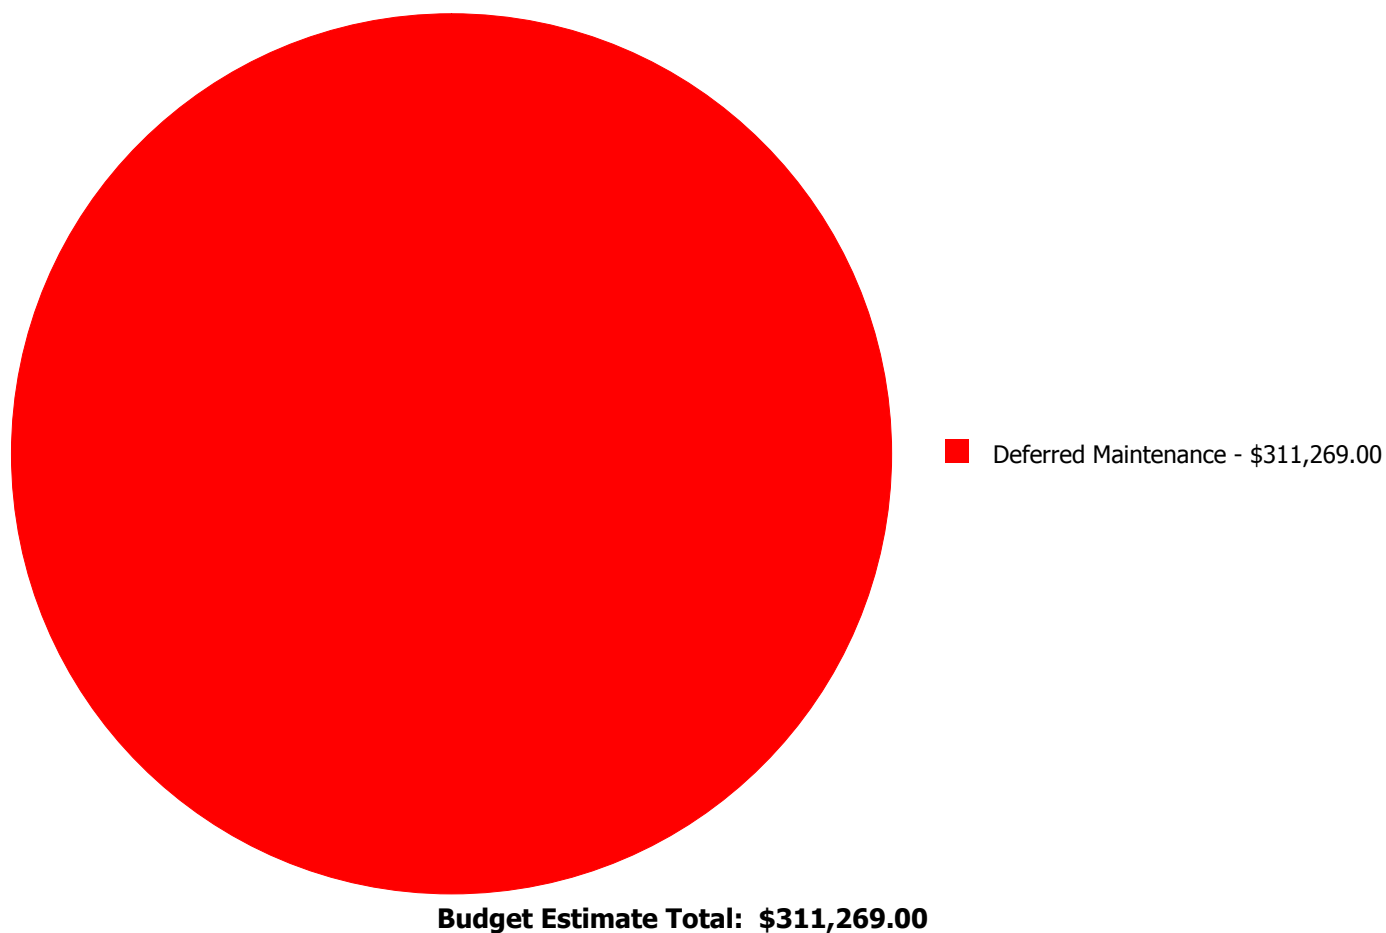


Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

Priority 3 - Necessary (Years 2-5):

System: C3020405 - Epoxy

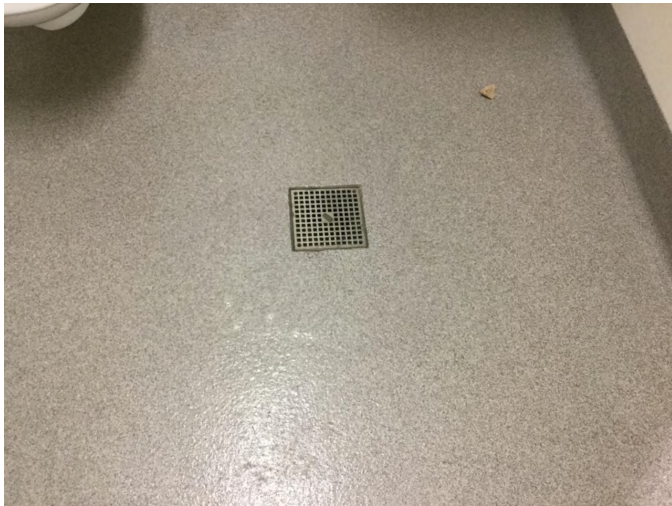

Location: Restrooms and kitchen
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 2,000.00
Unit of Measure: S.F.
Estimate: \$40,828.00
Assessor Name: Eduardo Lopez
Date Created: 02/07/2020

Notes: The epoxy floor finish is worn and deteriorating and should be replaced.

System: C3020901 - Carpet



Location: Media Center and Main office
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 6,726.00
Unit of Measure: S.F.
Estimate: \$55,490.00
Assessor Name: Eduardo Lopez
Date Created: 02/07/2020

Notes: The carpet is aged beyond its expected life and should be replaced.

System: C3020903 - VCT



Location: Throughout Building
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 35,767.00
Unit of Measure: S.F.
Estimate: \$192,927.00
Assessor Name: Eduardo Lopez
Date Created: 02/07/2020

Notes: The VCT floor finish is beyond its expected service life, worn and damaged, and is recommended for replacement.

System: D2040 - Rain Water Drainage



Location: Rooftop
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 44,493.00
Unit of Measure: S.F.
Estimate: \$22,024.00
Assessor Name: Eduardo Lopez
Date Created: 02/07/2020

Notes: The rainwater drains that support the water runoff from the roof are functional, However, the drains have exceeded their expected life cycle and should be replaced.

Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as $100 - \text{Total FCI}$ (without the %) where 100 is best and 0 is worst condition.

Function:	Elementary
Gross Area (SF):	20,016
Year Built:	1993
Last Renovation:	
Replacement Value:	\$3,470,854
Repair Cost:	\$498,882.00
Total FCI:	14.37 %
Total RSLI:	65.39 %
FCA Score:	85.63



Description:


The narrative for this building is included in the Executive Summary Description at the front of this report.

Attributes: This asset has no attributes.


Dashboard Summary

Function:	Elementary	Gross Area:	20,016
Year Built:	1993	Last Renovation:	
Repair Cost:	\$498,882	Replacement Value:	\$3,470,854
FCI:	14.37 %	RSLI%:	65.39 %


Deficiency By Category

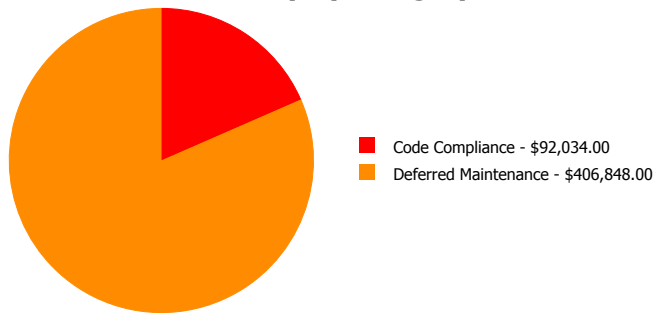


Deficiency By Priority

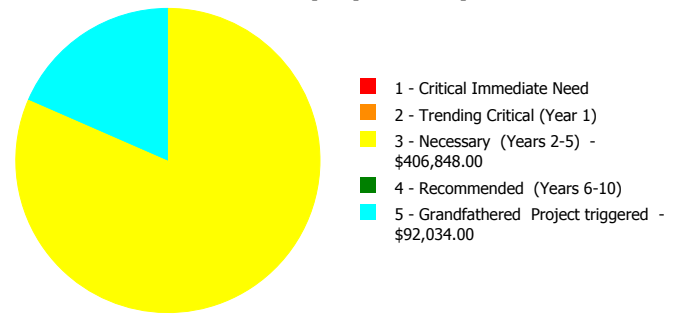

Deficiency By System

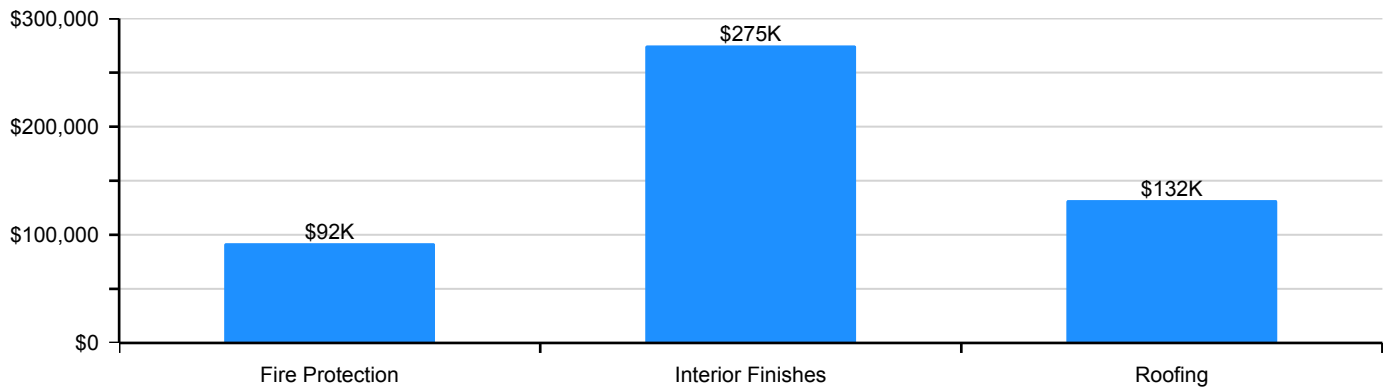

10 Year Investment Forecast

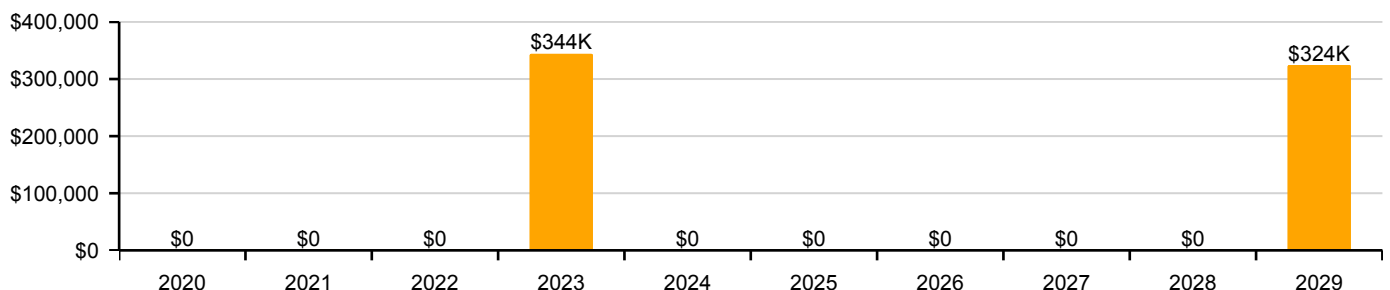

Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

UNIFORMAT Classification	RSLI %	FCI %	Current Repair Cost
A10 - Foundations	74.00 %	0.00 %	\$0.00
B10 - Superstructure	74.00 %	0.00 %	\$0.00
B20 - Exterior Enclosure	49.30 %	0.00 %	\$0.00
B30 - Roofing	9.14 %	81.62 %	\$131,934.00
C10 - Interior Construction	80.22 %	0.00 %	\$0.00
C20 - Stairs	74.00 %	0.00 %	\$0.00
C30 - Interior Finishes	32.45 %	62.38 %	\$274,914.00
D20 - Plumbing	81.86 %	0.00 %	\$0.00
D30 - HVAC	75.40 %	0.00 %	\$0.00
D40 - Fire Protection	84.99 %	96.19 %	\$92,034.00
D50 - Electrical	80.50 %	0.00 %	\$0.00
E10 - Equipment	80.00 %	0.00 %	\$0.00
E20 - Furnishings	80.00 %	0.00 %	\$0.00
Totals:	65.39 %	14.37 %	\$498,882.00

Photo Album

The photo album consists of the various cardinal compass directions of the building..

1). North Elevation - Feb 07, 2020



2). East Elevation - Feb 07, 2020



3). South Elevation - Feb 07, 2020



4). West Elevation - Feb 07, 2020



Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment)
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system as new construction.

System Listing

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

School Assessment Report - 1993 Bldg 2020_2030

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
A1010	Standard Foundations	\$7.70	S.F.	20,016	100	1993	2093		74.00 %	0.00 %	74			\$154,123
A1030	Slab on Grade	\$6.51	S.F.	20,016	100	1993	2093		74.00 %	0.00 %	74			\$130,304
B1020	Roof Construction	\$12.30	S.F.	20,016	100	1993	2093		74.00 %	0.00 %	74			\$246,197
B2010	Exterior Walls	\$13.05	S.F.	20,016	100	1993	2093		74.00 %	0.00 %	74			\$261,209
B2020	Exterior Windows	\$8.14	S.F.	20,016	30	1993	2023		13.33 %	0.00 %	4			\$162,930
B2030	Exterior Doors	\$0.82	S.F.	20,016	30	1993	2023		13.33 %	0.00 %	4			\$16,413
B3010120	Single Ply Membrane	\$5.37	S.F.	14,120	20	1993	2013		0.00 %	174.00 %	-6		\$131,934.00	\$75,824
B3010130	Preformed Metal Roofing	\$8.50	S.F.	8,920	30	1993	2023		13.33 %	0.00 %	4			\$75,820
B3020	Roof Openings	\$0.50	S.F.	20,016	30	2003	2033		46.67 %	0.00 %	14			\$10,008
C1010	Partitions	\$5.54	S.F.	20,016	100	1993	2093		74.00 %	0.00 %	74			\$110,889
C1020	Interior Doors	\$3.58	S.F.	20,016	40	2015	2055		90.00 %	0.00 %	36			\$71,657
C1030	Fittings	\$2.63	S.F.	20,016	20	2015	2035		80.00 %	0.00 %	16			\$52,642
C2010	Stair Construction	\$2.82	S.F.	20,016	100	1993	2093		74.00 %	0.00 %	74			\$56,445
C3010230	Paint & Covering	\$1.47	S.F.	20,016	10	1993	2003		0.00 %	0.00 %	-16			\$29,424
C3020903	VCT	\$3.48	S.F.	12,206	15	1993	2008		0.00 %	155.00 %	-11		\$65,839.00	\$42,477
C3020999	Epoxy	\$17.30	S.F.	1,057	10	1993	2003		0.00 %	110.00 %	-16		\$20,115.00	\$18,286
C3020999	Other - Rubber or Neoprene	\$26.67	S.F.	6,441	10	1993	2003		0.00 %	110.00 %	-16		\$188,960.00	\$171,781
C3030	Ceiling Finishes	\$8.93	S.F.	20,016	20	2015	2035		80.00 %	0.00 %	16			\$178,743
D2010	Plumbing Fixtures	\$6.52	S.F.	20,016	20	2015	2035		80.00 %	0.00 %	16			\$130,504
D2020	Domestic Water Distribution	\$0.76	S.F.	20,016	30	2015	2045		86.67 %	0.00 %	26			\$15,212
D2030	Sanitary Waste	\$1.76	S.F.	20,016	30	2015	2045		86.67 %	0.00 %	26			\$35,228
D3010	Energy Supply	\$0.61	S.F.	20,016	30	2015	2045		86.67 %	0.00 %	26			\$12,210
D3040	Distribution Systems	\$6.75	S.F.	20,016	20	2015	2035		80.00 %	0.00 %	16			\$135,108
D3050	Terminal & Package Units	\$16.09	S.F.	20,016	15	2015	2030		73.33 %	0.00 %	11			\$322,057
D3060	Controls & Instrumentation	\$2.28	S.F.	20,016	15	2015	2030		73.33 %	0.00 %	11			\$45,636
D4010	Sprinklers	\$4.18	S.F.	20,016	30	2015	2045		86.67 %	110.00 %	26		\$92,034.00	\$83,667
D4090	Other Fire Protection Systems	\$0.60	S.F.	20,016	15	2015	2030		73.33 %	0.00 %	11			\$12,010
D5010	Electrical Service/Distribution	\$2.30	S.F.	20,016	20	2015	2035		80.00 %	0.00 %	16			\$46,037
D5020	Branch Wiring	\$5.33	S.F.	20,016	20	2015	2035		80.00 %	0.00 %	16			\$106,685
D5020	Lighting	\$8.13	S.F.	20,016	20	2015	2035		80.00 %	0.00 %	16			\$162,730
D5030810	Security & Detection Systems	\$1.51	S.F.	20,016	20	2015	2035		80.00 %	0.00 %	16			\$30,224
D5030910	Fire Alarm Systems	\$2.74	S.F.	20,016	20	2015	2035		80.00 %	0.00 %	16			\$54,844
D5030920	Data Communication	\$3.56	S.F.	20,016	25	2015	2040		84.00 %	0.00 %	21			\$71,257
D5090	Other Electrical Systems	\$0.34	S.F.	20,016	15	2015	2030		73.33 %	0.00 %	11			\$6,805
E1020	Institutional Equipment	\$13.65	S.F.	20,016	20	2015	2035		80.00 %	0.00 %	16			\$273,218
E1090	Other Equipment	\$0.91	S.F.	20,016	20	2015	2035		80.00 %	0.00 %	16			\$18,215
E2010	Fixed Furnishings	\$2.20	S.F.	20,016	20	2015	2035		80.00 %	0.00 %	16			\$44,035
Total									65.39 %	14.37 %			\$498,882.00	\$3,470,854

System Notes

The facility description in the executive summary contains an overview of each system. The system notes listed below provide additional information on select systems found within the facility.

System: B2010 - Exterior Walls



Note:

System: B2020 - Exterior Windows



Note:

System: B2030 - Exterior Doors



Note:

School Assessment Report - 1993 Bldg 2020_2030

System: B3010120 - Single Ply Membrane



Note:

System: B3010130 - Preformed Metal Roofing



Note:


System: B3020 - Roof Openings



Note:


School Assessment Report - 1993 Bldg 2020_2030

System: C1010 - Partitions





Note:

System: C1020 - Interior Doors

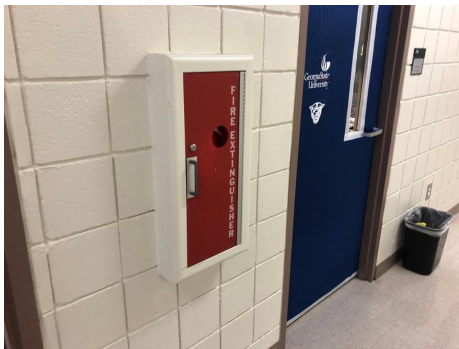

Note:



System: C1030 - Fittings



Note:

School Assessment Report - 1993 Bldg 2020_2030

System: C2010 - Stair Construction

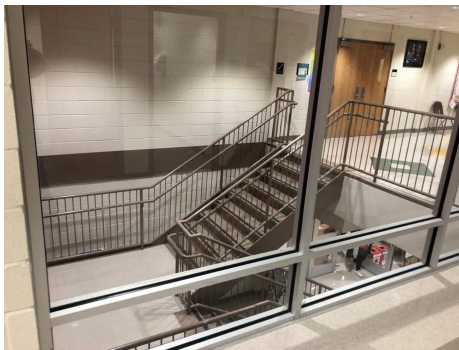



Note:

System: C3010230 - Paint & Covering



Note:



System: C3020903 - VCT

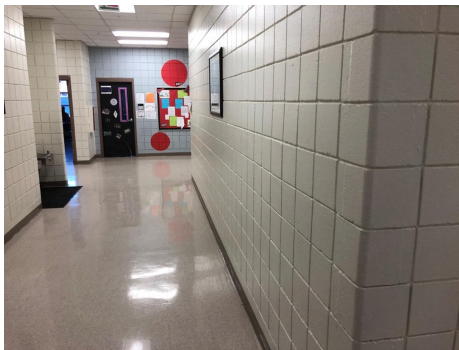

Note:


School Assessment Report - 1993 Bldg 2020_2030

System: C3020999 - Epoxy

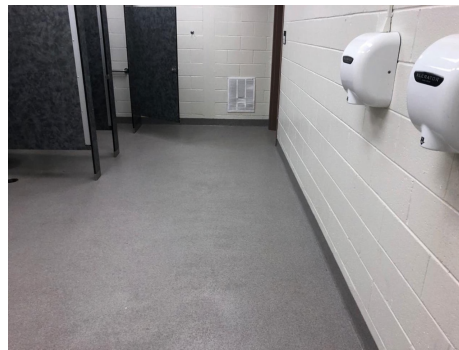



Note:

System: C3020999 - Other - Rubber or Neoprene

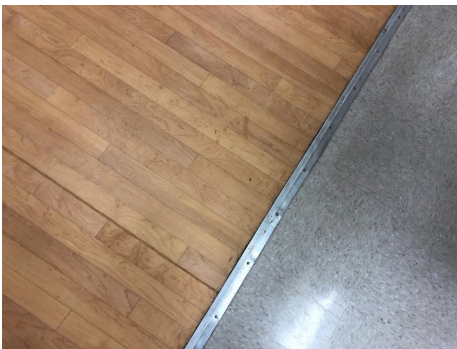

Note:


System: C3030 - Ceiling Finishes

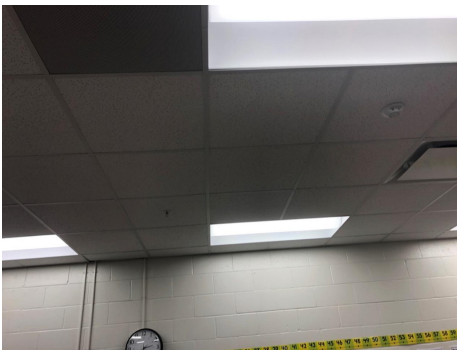

Note:



School Assessment Report - 1993 Bldg 2020_2030

System: D2010 - Plumbing Fixtures




Note:

System: D2020 - Domestic Water Distribution

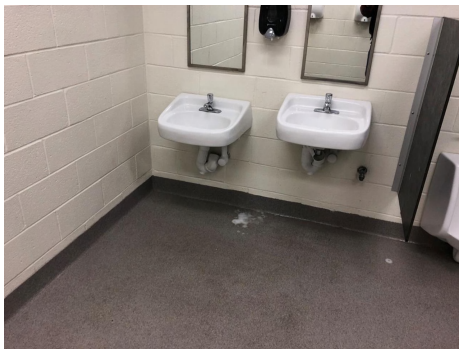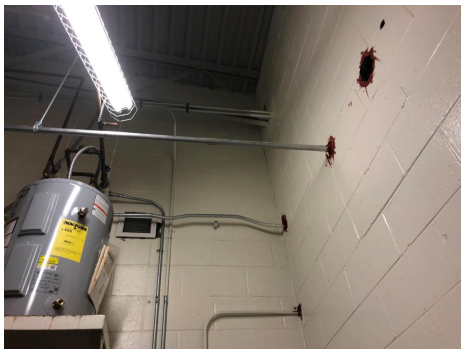

Note:

System: D2030 - Sanitary Waste



Note:

School Assessment Report - 1993 Bldg 2020_2030

System: D3010 - Energy Supply



Note:

System: D3040 - Distribution Systems



Note:

System: D3050 - Terminal & Package Units



Note:


School Assessment Report - 1993 Bldg 2020_2030

System: D3060 - Controls & Instrumentation




Note:

System: D4010 - Sprinklers

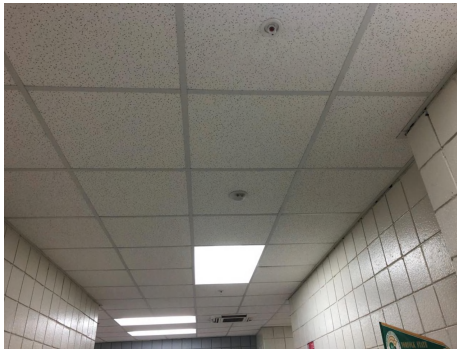

Note:

System: D4090 - Other Fire Protection Systems

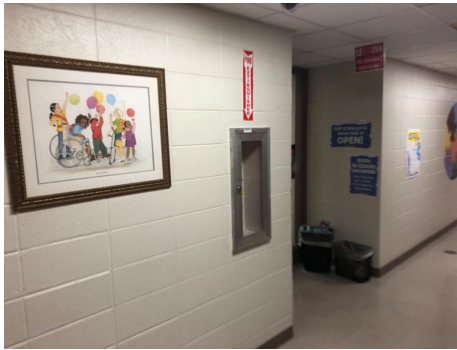

Note:


School Assessment Report - 1993 Bldg 2020_2030

System: D5010 - Electrical Service/Distribution





Note:

System: D5020 - Branch Wiring

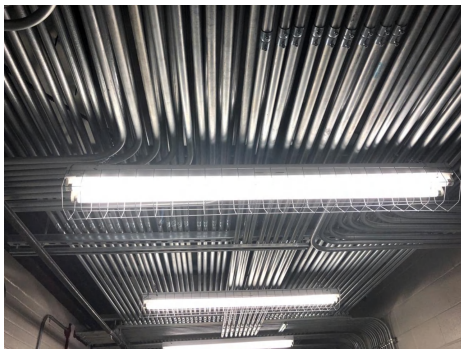

Note:

System: D5020 - Lighting

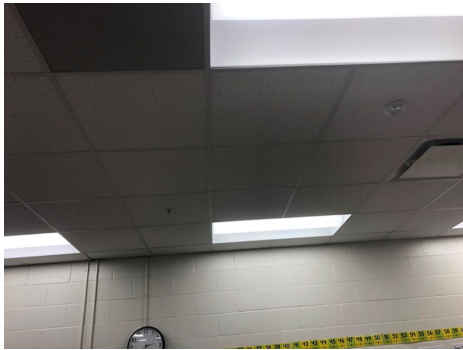

Note:


School Assessment Report - 1993 Bldg 2020_2030

System: D5030810 - Security & Detection Systems



Note:

System: D5030910 - Fire Alarm Systems

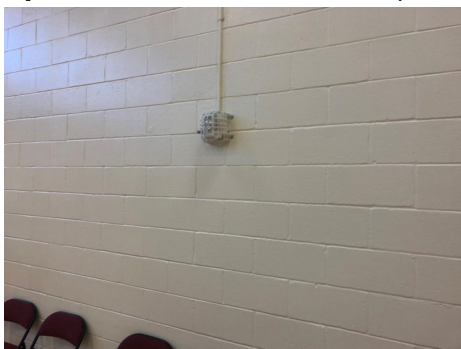

Note:

System: D5030920 - Data Communication



Note:

School Assessment Report - 1993 Bldg 2020_2030

System: D5090 - Other Electrical Systems




Note:

System: E1020 - Institutional Equipment



Note:

System: E1090 - Other Equipment



Note:

School Assessment Report - 1993 Bldg 2020_2030

System: E2010 - Fixed Furnishings



Note:

Renewal Schedule

eCOMET forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the System Listing table. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.

Inflation Rate: 3%

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
Total:	\$498,882	\$0	\$0	\$0	\$344,068	\$0	\$0	\$0	\$0	\$0	\$324,477	\$1,167,427
* A - Substructure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A10 - Foundations	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A1010 - Standard Foundations	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A1030 - Slab on Grade	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B - Shell	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B10 - Superstructure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B1020 - Roof Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B20 - Exterior Enclosure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B2010 - Exterior Walls	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B2020 - Exterior Windows	\$0	\$0	\$0	\$0	\$201,717	\$0	\$0	\$0	\$0	\$0	\$0	\$201,717
B2030 - Exterior Doors	\$0	\$0	\$0	\$0	\$20,320	\$0	\$0	\$0	\$0	\$0	\$0	\$20,320
B30 - Roofing	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B3010 - Roof Coverings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B3010120 - Single Ply Membrane	\$131,934	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$131,934
B3010130 - Preformed Metal Roofing	\$0	\$0	\$0	\$0	\$122,031	\$0	\$0	\$0	\$0	\$0	\$0	\$122,031
B3020 - Roof Openings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C - Interiors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C10 - Interior Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1010 - Partitions	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1020 - Interior Doors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1030 - Fittings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C20 - Stairs	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* C2010 - Stair Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C30 - Interior Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3010 - Wall Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0

School Assessment Report - 1993 Bldg 2020_2030

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
C3010230 - Paint & Covering	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$43,497	\$43,497
C3020 - Floor Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020903 - VCT	\$65,839	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$65,839
C3020999 - Epoxy	\$20,115	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$27,033	\$47,148
C3020999 - Other - Rubber or Neoprene	\$188,960	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$253,946	\$442,906
C3030 - Ceiling Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D - Services	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D20 - Plumbing	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2010 - Plumbing Fixtures	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2020 - Domestic Water Distribution	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2030 - Sanitary Waste	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D30 - HVAC	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3010 - Energy Supply	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3040 - Distribution Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3050 - Terminal & Package Units	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3060 - Controls & Instrumentation	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D40 - Fire Protection	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D4010 - Sprinklers	\$92,034	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$92,034
D4090 - Other Fire Protection Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D50 - Electrical	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5010 - Electrical Service/Distribution	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5020 - Branch Wiring	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5020 - Lighting	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030 - Communications and Security	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030810 - Security & Detection Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030910 - Fire Alarm Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030920 - Data Communication	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5090 - Other Electrical Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E - Equipment & Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E10 - Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E1020 - Institutional Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E1090 - Other Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0


School Assessment Report - 1993 Bldg 2020_2030

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
E20 - Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E2010 - Fixed Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0

* Indicates non-renewable system

Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and forecasted capital renewal (sustainment) requirements over the next ten years.

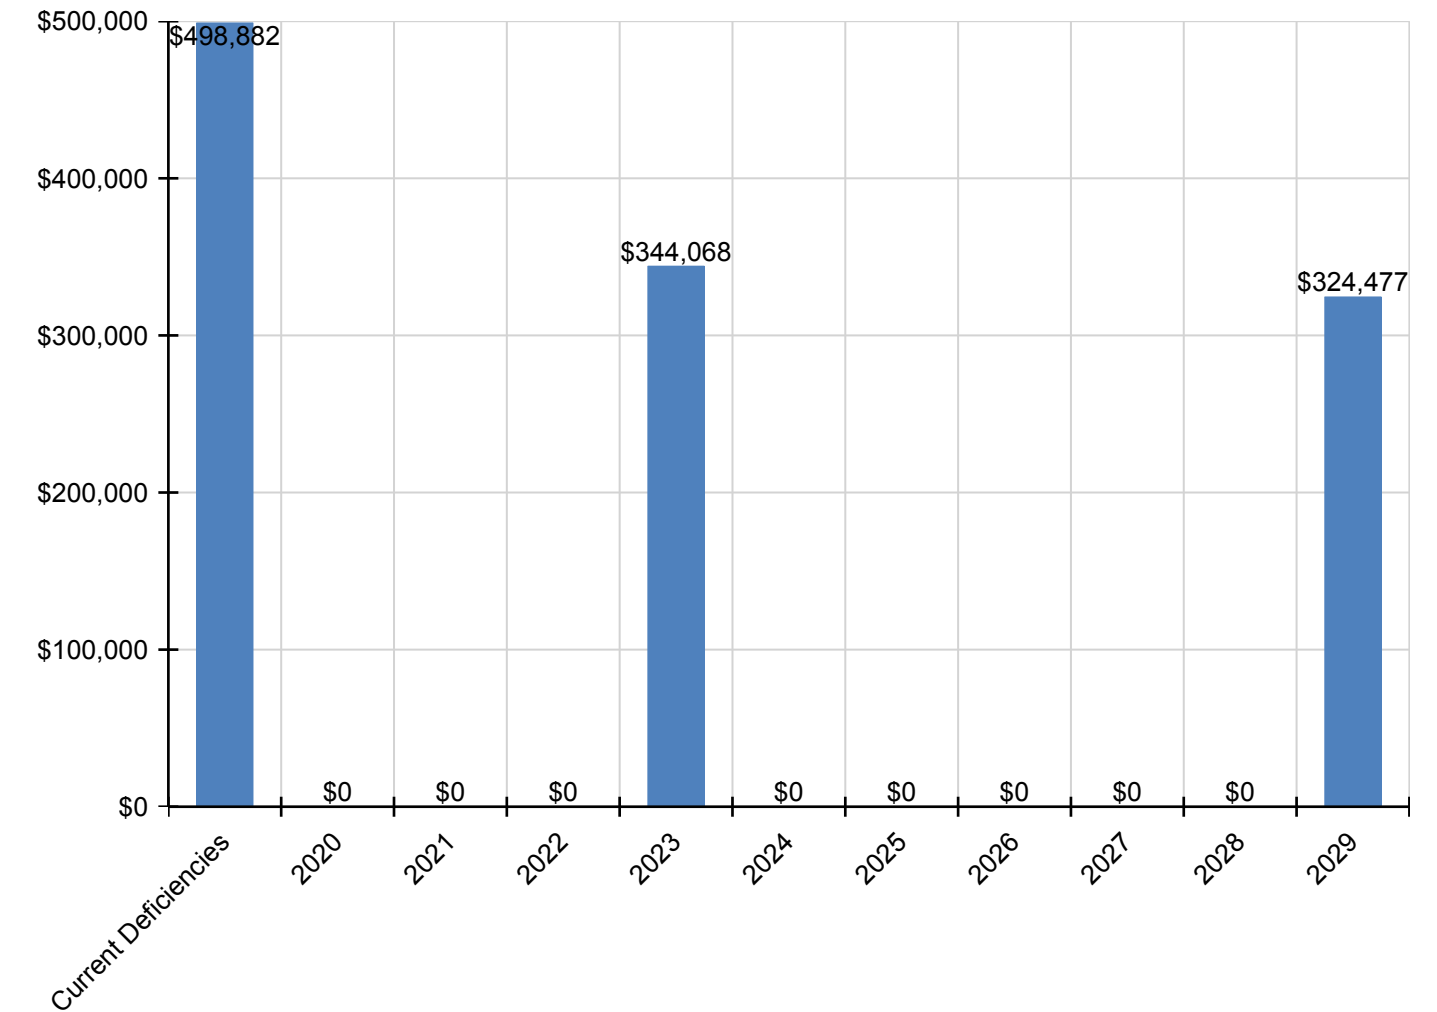


Condition Index Forecast by Investment Scenario

The chart below illustrates the effect of various investment levels on the building FCI for the next 10 years. The levels of investment shown below include:

- Current FCI: a variable investment amount based on renewing expired systems to maintain the current FCI for the building
- 2% Investment: an annual investment of 2% of the replacement value of the building, escalated for inflation
- 4% Investment: an annual investment of 4% of the replacement value of the building, escalated for inflation


Facility Investment vs. FCI Forecast

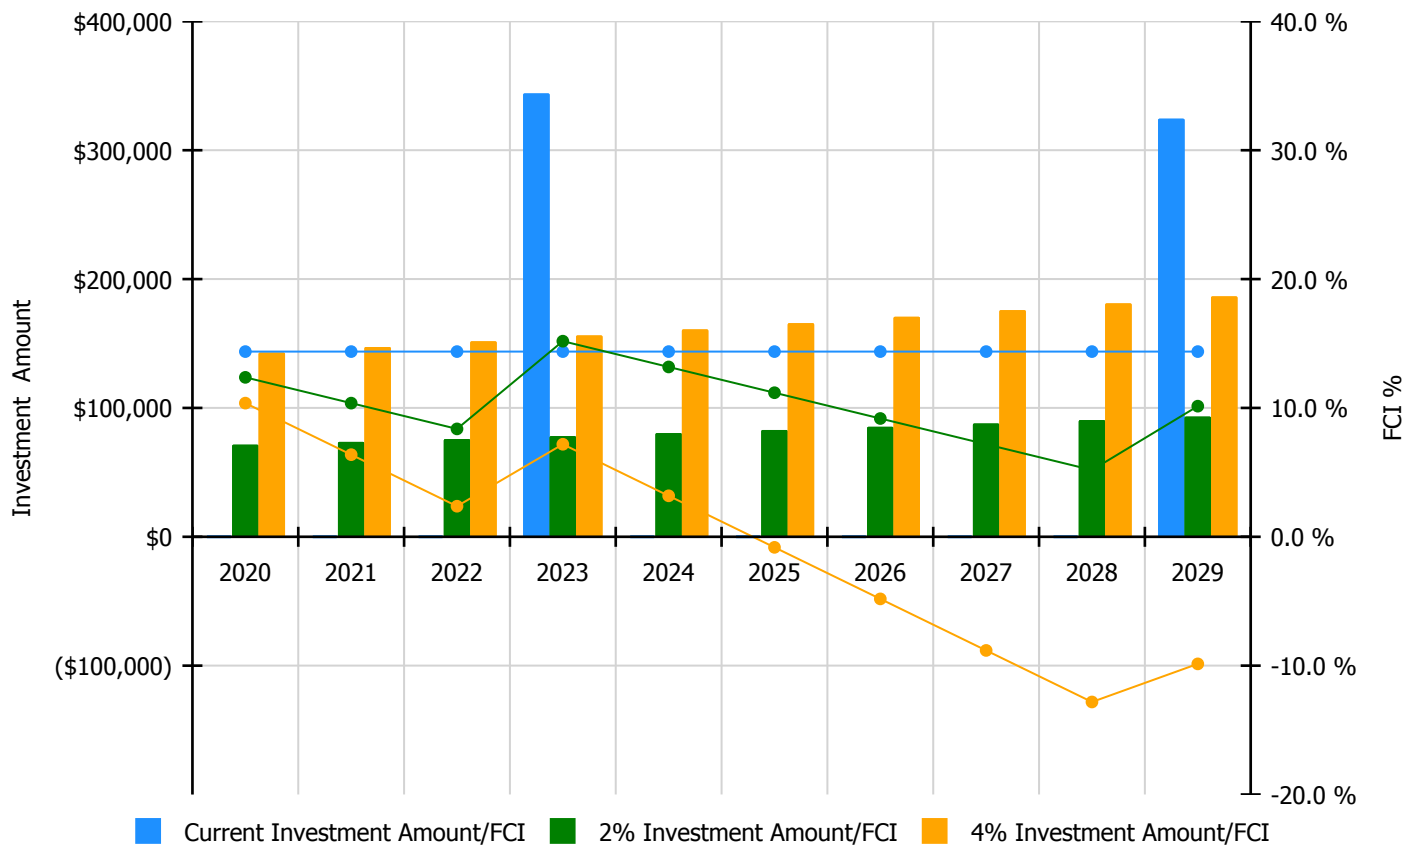

Year	Investment Amount Current FCI - 14.37%	2% Investment		4% Investment	
		Amount	FCI	Amount	FCI
2020	\$0	\$71,500.00	12.37 %	\$142,999.00	10.37 %
2021	\$0	\$73,645.00	10.37 %	\$147,289.00	6.37 %
2022	\$0	\$75,854.00	8.37 %	\$151,708.00	2.37 %
2023	\$344,068	\$78,130.00	15.18 %	\$156,259.00	7.18 %
2024	\$0	\$80,473.00	13.18 %	\$160,947.00	3.18 %
2025	\$0	\$82,888.00	11.18 %	\$165,775.00	-0.82 %
2026	\$0	\$85,374.00	9.18 %	\$170,749.00	-4.82 %
2027	\$0	\$87,935.00	7.18 %	\$175,871.00	-8.82 %
2028	\$0	\$90,574.00	5.18 %	\$181,147.00	-12.82 %
2029	\$324,477	\$93,291.00	10.14 %	\$186,582.00	-9.86 %
Total:	\$668,545	\$819,664.00		\$1,639,326.00	

Deficiency Summary by System


Current deficiencies included assemblies that have reached or exceeded their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Useful Life'. The following chart lists all current deficiencies associated with this facility.

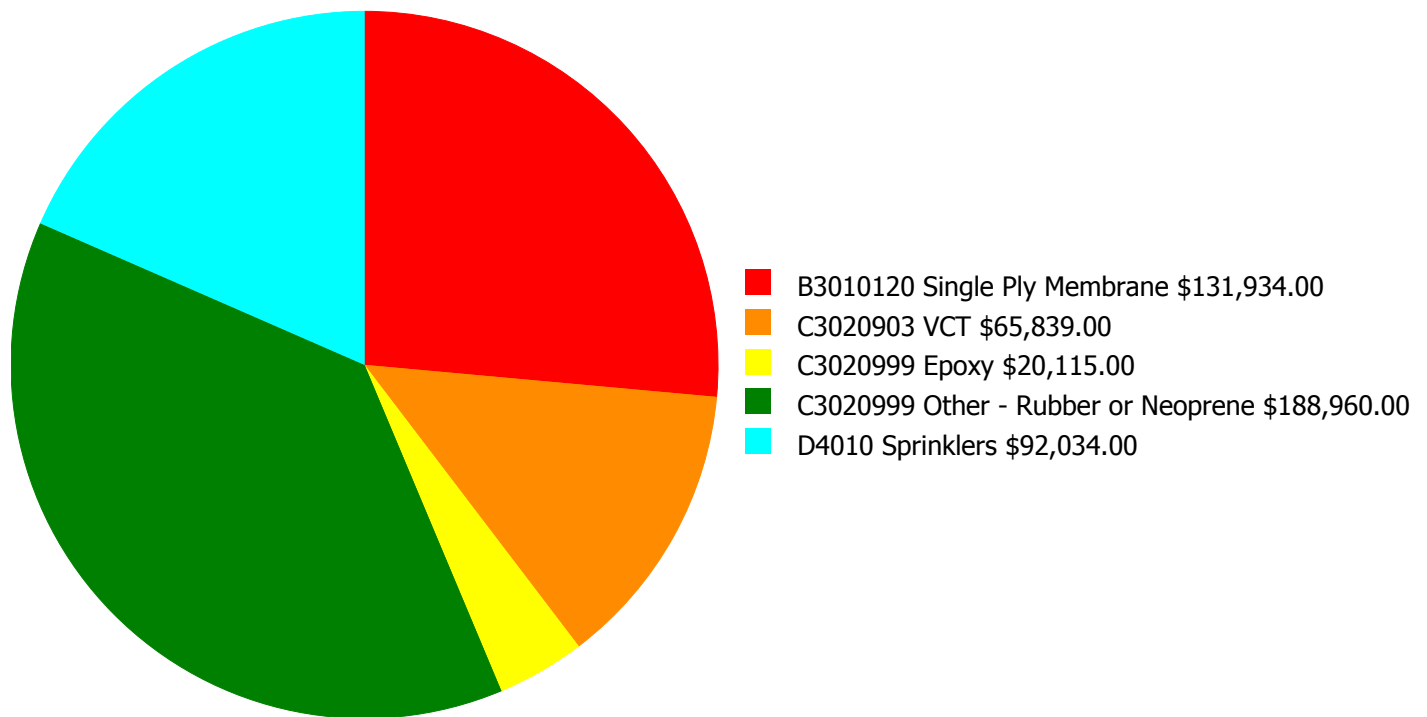

Budget Estimate Total: \$498,882.00

Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

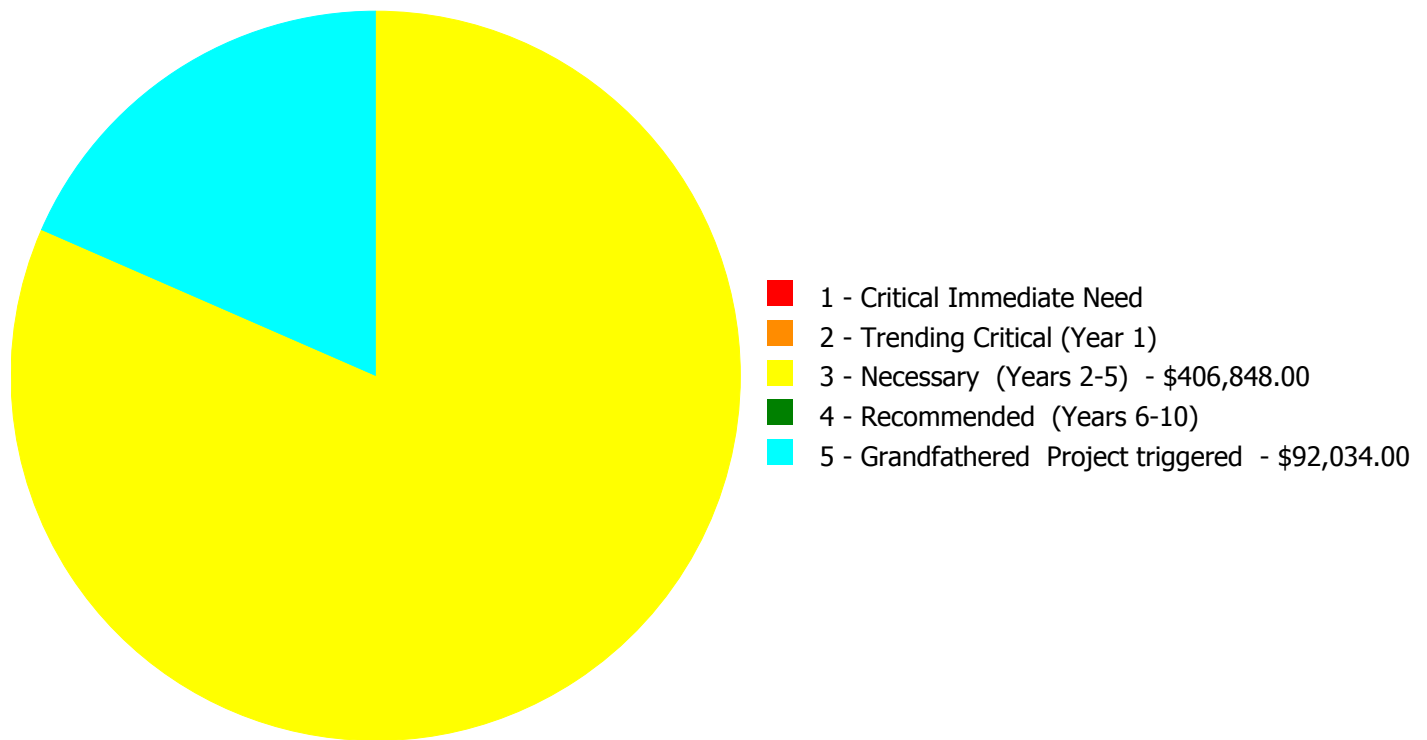

Budget Estimate Total: \$498,882.00


Deficiency By Priority Investment Table

The table below shows the current investment cost grouped by deficiency priority and building system.

System Code	System Description	1 - Critical Immediate Need	2 - Trending Critical (Year 1)	3 - Necessary (Years 2-5)	4 - Recommended (Years 6-10)	5 - Grandfathered Project triggered	Total
B3010120	Single Ply Membrane	\$0.00	\$0.00	\$131,934.00	\$0.00	\$0.00	\$131,934.00
C3020903	VCT	\$0.00	\$0.00	\$65,839.00	\$0.00	\$0.00	\$65,839.00
C3020999	Epoxy	\$0.00	\$0.00	\$20,115.00	\$0.00	\$0.00	\$20,115.00
C3020999	Other - Rubber or Neoprene	\$0.00	\$0.00	\$188,960.00	\$0.00	\$0.00	\$188,960.00
D4010	Sprinklers	\$0.00	\$0.00	\$0.00	\$0.00	\$92,034.00	\$92,034.00
	Total:	\$0.00	\$0.00	\$406,848.00	\$0.00	\$92,034.00	\$498,882.00

Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

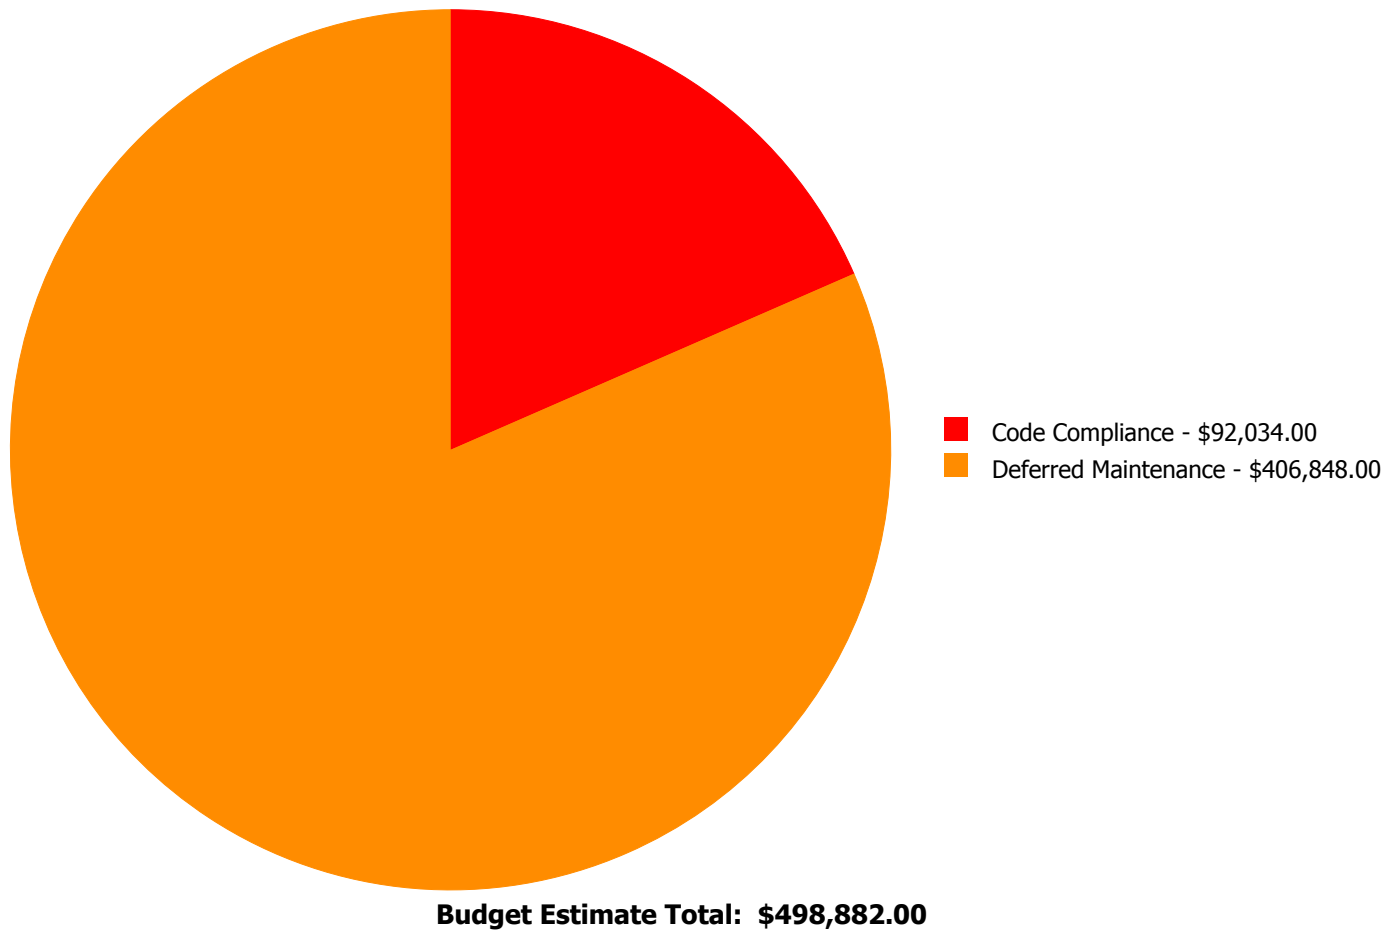

Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

Priority 3 - Necessary (Years 2-5):

System: B3010120 - Single Ply Membrane



Location: Rooftop
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 14,120.00
Unit of Measure: S.F.
Estimate: \$131,934.00
Assessor Name: Jejuan Hall
Date Created: 02/07/2020

Notes: The single ply membrane covering is original and beyond its service life and should be scheduled for replacement.

System: C3020903 - VCT



Location: Throughout Building
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 12,206.00
Unit of Measure: S.F.
Estimate: \$65,839.00
Assessor Name: Jejuan Hall
Date Created: 02/07/2020

Notes: The VCT floor finish is beyond its expected service life, worn and damaged, and is recommended for replacement.

System: C3020999 - Epoxy



Location: Restrooms
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 1,057.00
Unit of Measure: S.F.
Estimate: \$20,115.00
Assessor Name: Jejuan Hall
Date Created: 02/07/2020

Notes: The epoxy floor finish is worn and deteriorating and should be replaced.

System: C3020999 - Other - Rubber or Neoprene



Location: Multi-purpose room
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 6,441.00
Unit of Measure: S.F.
Estimate: \$188,960.00
Assessor Name: Jejuan Hall
Date Created: 02/07/2020

Notes: The Neoprene/Rubber floor finish is beyond its expected service life, worn and damaged, and is recommended for replacement.

Priority 5 - Grandfathered Project triggered:

System: D4010 - Sprinklers

This deficiency has no image.

Location: Throughout building

Distress: Missing

Category: Code Compliance

Priority: 5 - Grandfathered Project triggered

Correction: Renew System

Qty: 20,016.00

Unit of Measure: S.F.

Estimate: \$92,034.00

Assessor Name: Jejuan Hall

Date Created: 07/30/2013

Notes: No sprinkler system installed

Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as 100-Total FCI (without the %) where 100 is best and 0 is worst condition.

Function:

Gross Area (SF): 64,509

Year Built: 1958

Last Renovation:

Replacement Value: \$1,893,340

Repair Cost: \$221,395.00

Total FCI: 11.69 %

Total RSLI: 44.73 %

FCA Score: 88.31



Description:


The narrative for this site is included in the Executive Summary Description at the front of this report.

Attributes: This asset has no attributes.


Dashboard Summary

Function:		Gross Area:	64,509
Year Built:	1958	Last Renovation:	
Repair Cost:	\$221,395	Replacement Value:	\$1,893,340
FCI:	11.69 %	RSLI%:	44.73 %


Deficiency By Category

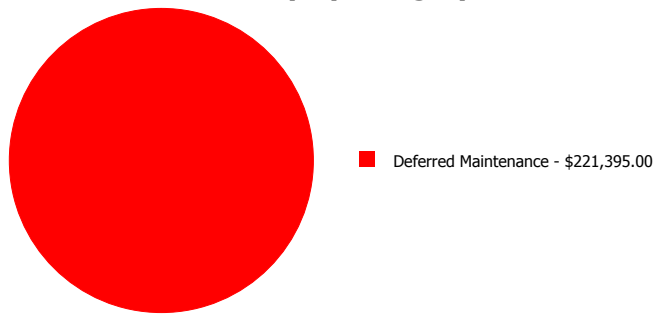


Deficiency By Priority

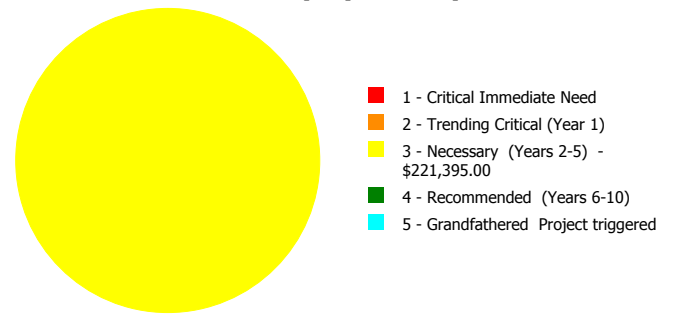

Deficiency By System

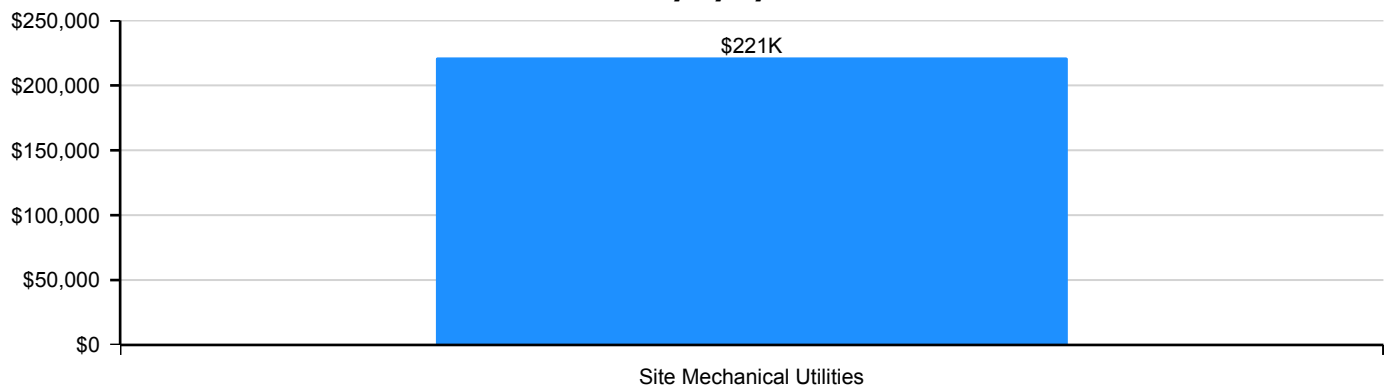

10 Year Investment Forecast

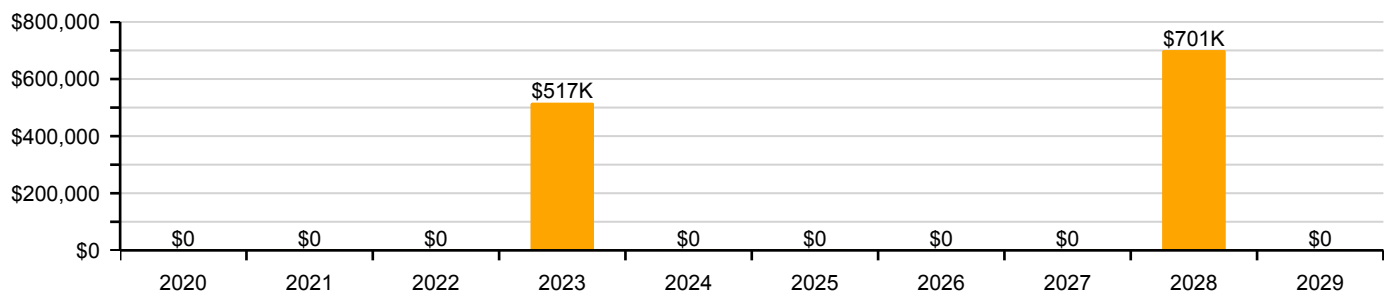

Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

UNIFORMAT Classification	RSLI %	FCI %	Current Repair Cost
G20 - Site Improvements	60.16 %	0.00 %	\$0.00
G30 - Site Mechanical Utilities	25.40 %	79.63 %	\$221,395.00
G40 - Site Electrical Utilities	13.33 %	0.00 %	\$0.00
Totals:	44.73 %	11.69 %	\$221,395.00

Photo Album

The photo album consists of the various cardinal compass directions of the building..



Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment)
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system as new construction.

System Listing

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
G2010	Roadways	\$2.24	S.F.	64,509	35	2015	2050		88.57 %	0.00 %	31			\$144,500
G2020	Parking Lots	\$7.57	S.F.	64,509	35	1993	2028		25.71 %	0.00 %	9			\$488,333
G2030	Pedestrian Paving	\$2.19	S.F.	64,509	35	2015	2050		88.57 %	0.00 %	31			\$141,275
G2040105	Fence & Guardrails	\$1.15	S.F.	64,509	20	2015	2035		80.00 %	0.00 %	16			\$74,185
G2040950	Play Field	\$4.28	S.F.	64,509	20	2015	2035		80.00 %	0.00 %	16			\$276,099
G2050	Landscaping	\$1.14	S.F.	64,509	25	2015	2040		84.00 %	0.00 %	21			\$73,540
G3010	Water Supply	\$1.02	S.F.	64,509	50	1958	2008		0.00 %	110.00 %	-11		\$72,379.00	\$65,799
G3020	Sanitary Sewer	\$2.10	S.F.	64,509	50	1958	2008		0.00 %	110.00 %	-11		\$149,016.00	\$135,469
G3030	Storm Sewer	\$1.19	S.F.	64,509	50	2015	2065		92.00 %	0.00 %	46			\$76,766
G4010	Electrical Distribution	\$2.42	S.F.	64,509	30	1993	2023		13.33 %	0.00 %	4			\$156,112
G4020	Site Lighting	\$2.85	S.F.	64,509	30	1993	2023		13.33 %	0.00 %	4			\$183,851
G4030	Site Communication and Security	\$1.20	S.F.	64,509	30	1993	2023		13.33 %	0.00 %	4			\$77,411
Total									44.73 %	11.69 %			\$221,395.00	\$1,893,340

System Notes

The facility description in the executive summary contains an overview of each system. The system notes listed below provide additional information on select systems found within the facility.

System: G2010 - Roadways

Note: new asphalt paving, new grass crete fire lane (2015)

System: G2020 - Parking Lots

Note:

System: G2030 - Pedestrian Paving

Note:

School Assessment Report - Site

System: G2040105 - Fence & Guardrails



Note:

System: G2040950 - Play Field



Note:

System: G2050 - Landscaping



Note:

School Assessment Report - Site

System: G3010 - Water Supply



Note:

Renewal Schedule

eCOMET forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the System Listing table. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.


Inflation Rate: 3%

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
Total:	\$221,395	\$0	\$0	\$0	\$516,733	\$0	\$0	\$0	\$0	\$700,880	\$0	\$1,439,008
G - Building Sitework	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G20 - Site Improvements	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2010 - Roadways	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2020 - Parking Lots	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$700,880	\$0	\$700,880
G2030 - Pedestrian Paving	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040 - Site Development	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040105 - Fence & Guardrails	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040950 - Play Field	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2050 - Landscaping	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G30 - Site Mechanical Utilities	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G3010 - Water Supply	\$72,379	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$72,379
G3020 - Sanitary Sewer	\$149,016	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$149,016
G3030 - Storm Sewer	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G40 - Site Electrical Utilities	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G4010 - Electrical Distribution	\$0	\$0	\$0	\$0	\$193,276	\$0	\$0	\$0	\$0	\$0	\$0	\$193,276
G4020 - Site Lighting	\$0	\$0	\$0	\$0	\$227,618	\$0	\$0	\$0	\$0	\$0	\$0	\$227,618
G4030 - Site Communication and Security	\$0	\$0	\$0	\$0	\$95,839	\$0	\$0	\$0	\$0	\$0	\$0	\$95,839

** Indicates non-renewable system*

Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and forecasted capital renewal (sustainment) requirements over the next ten years.

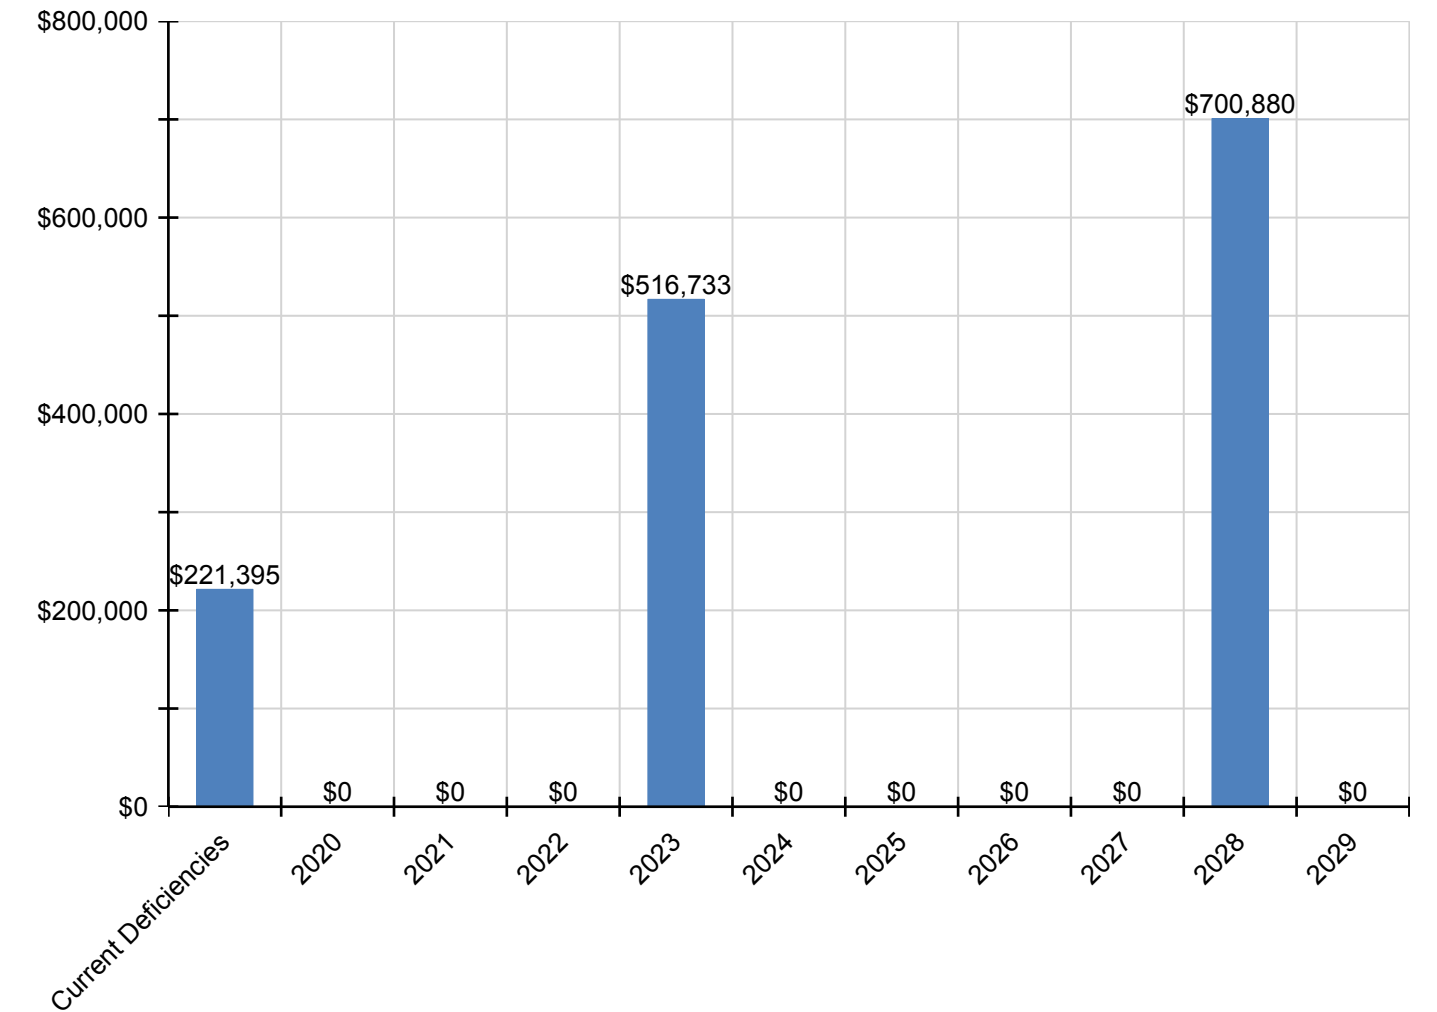


Condition Index Forecast by Investment Scenario

The chart below illustrates the effect of various investment levels on the building FCI for the next 10 years. The levels of investment shown below include:

- Current FCI: a variable investment amount based on renewing expired systems to maintain the current FCI for the building
- 2% Investment: an annual investment of 2% of the replacement value of the building, escalated for inflation
- 4% Investment: an annual investment of 4% of the replacement value of the building, escalated for inflation


Facility Investment vs. FCI Forecast

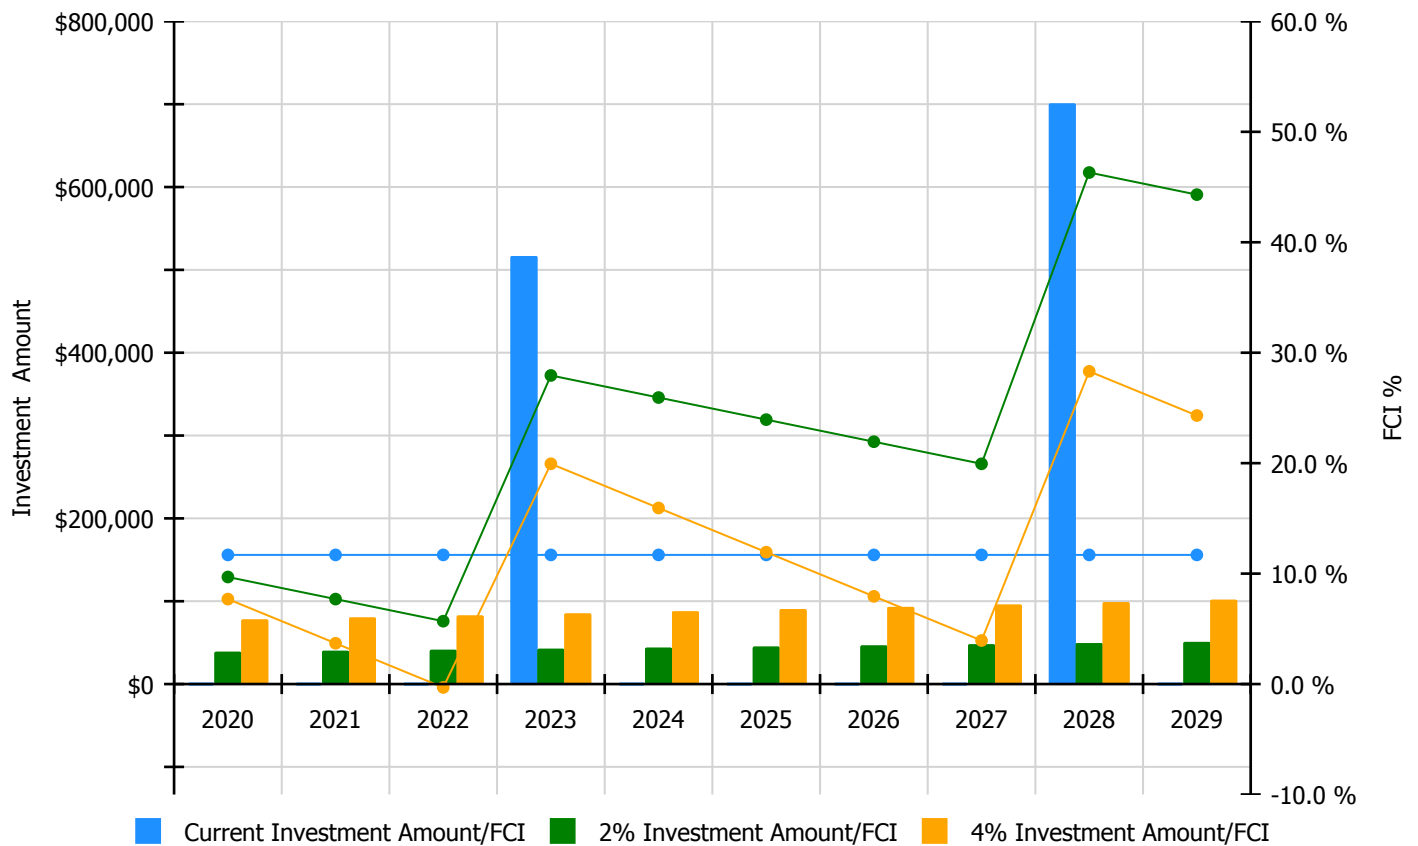

Year	Investment Amount Current FCI - 11.69%	2% Investment		4% Investment	
		Amount	FCI	Amount	FCI
2020	\$0	\$39,003.00	9.69 %	\$78,006.00	7.69 %
2021	\$0	\$40,173.00	7.69 %	\$80,346.00	3.69 %
2022	\$0	\$41,378.00	5.69 %	\$82,756.00	-0.31 %
2023	\$516,733	\$42,619.00	27.94 %	\$85,239.00	19.94 %
2024	\$0	\$43,898.00	25.94 %	\$87,796.00	15.94 %
2025	\$0	\$45,215.00	23.94 %	\$90,430.00	11.94 %
2026	\$0	\$46,571.00	21.94 %	\$93,143.00	7.94 %
2027	\$0	\$47,969.00	19.94 %	\$95,937.00	3.94 %
2028	\$700,880	\$49,408.00	46.31 %	\$98,815.00	28.31 %
2029	\$0	\$50,890.00	44.31 %	\$101,780.00	24.31 %
Total:	\$1,217,613	\$447,124.00		\$894,248.00	


Deficiency Summary by System

Current deficiencies included assemblies that have reached or exceeded their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Useful Life'. The following chart lists all current deficiencies associated with this facility.

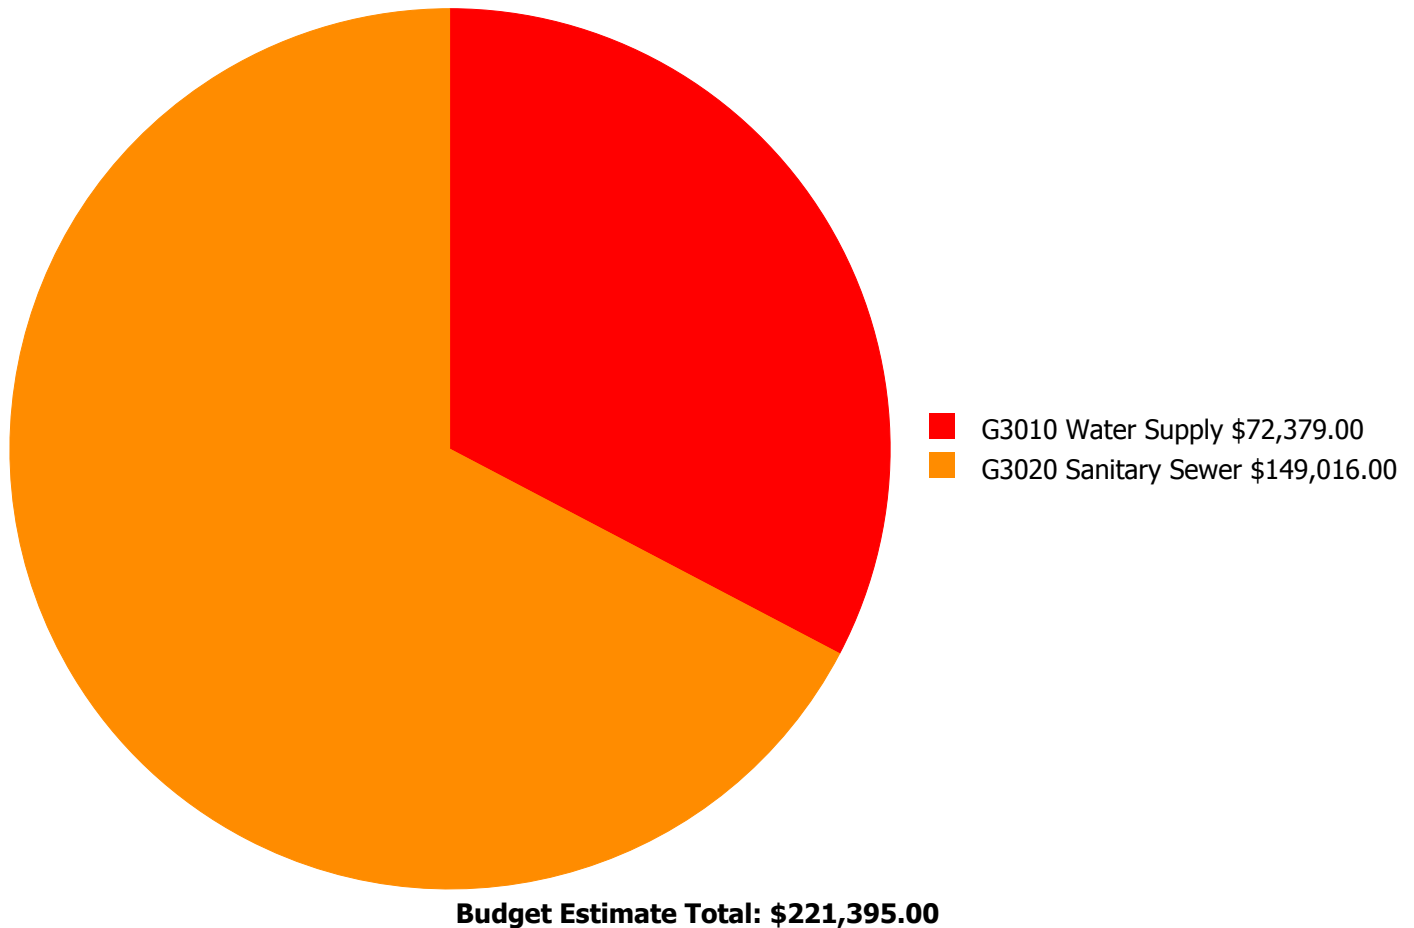

Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

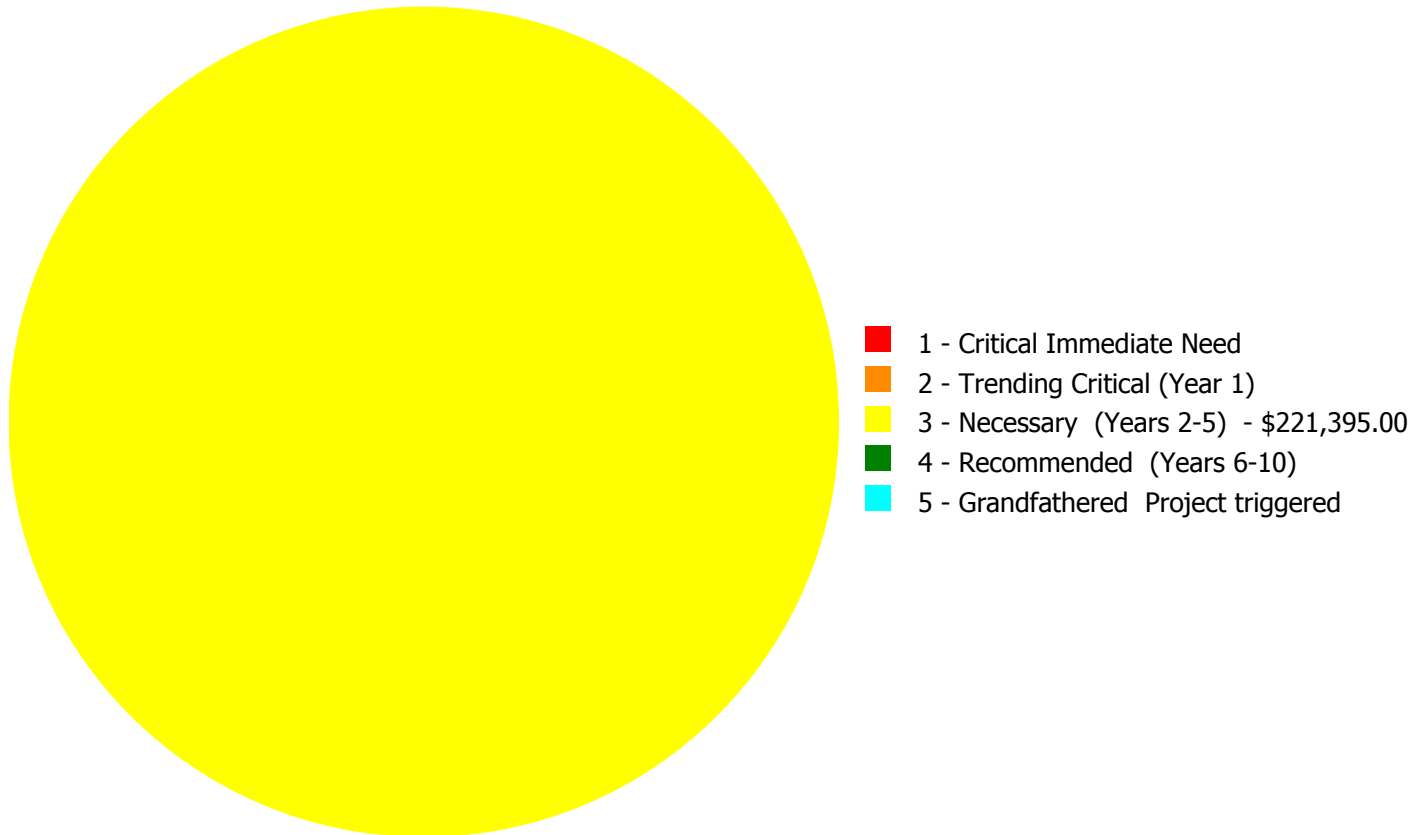

Budget Estimate Total: \$221,395.00


Deficiency By Priority Investment Table

The table below shows the current investment cost grouped by deficiency priority and building system.

System Code	System Description	1 - Critical Immediate Need	2 - Trending Critical (Year 1)	3 - Necessary (Years 2-5)	4 - Recommended (Years 6-10)	5 - Grandfathered Project triggered	Total
G3010	Water Supply	\$0.00	\$0.00	\$72,379.00	\$0.00	\$0.00	\$72,379.00
G3020	Sanitary Sewer	\$0.00	\$0.00	\$149,016.00	\$0.00	\$0.00	\$149,016.00
	Total:	\$0.00	\$0.00	\$221,395.00	\$0.00	\$0.00	\$221,395.00

Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

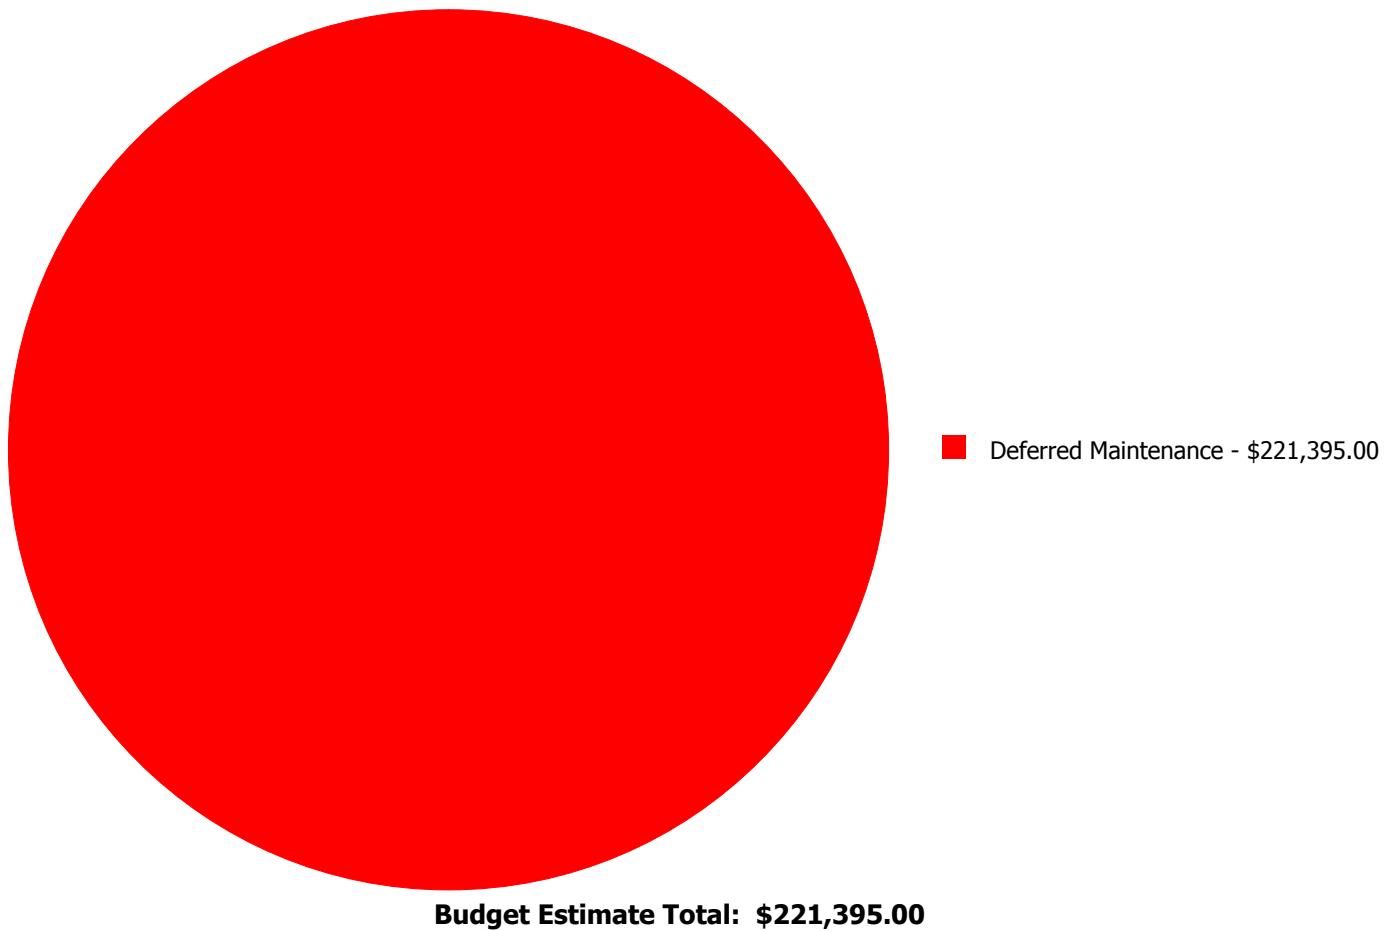

Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

Priority 3 - Necessary (Years 2-5):

System: G3010 - Water Supply



Location: Site
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 64,509.00
Unit of Measure: S.F.
Estimate: \$72,379.00
Assessor Name: Jejuan Hall
Date Created: 07/26/2013

Notes: Replace original domestic water supply system.

System: G3020 - Sanitary Sewer



Location: Site
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 64,509.00
Unit of Measure: S.F.
Estimate: \$149,016.00
Assessor Name: Jejuan Hall
Date Created: 07/26/2013

Notes: Replace original sanitary sewer system.

Glossary

Abandoned	A facility owned by the city that is not occupied and not maintained. See Vacant.
Additional Cost	Total project cost is composed of hard and soft costs. Additional costs or soft expenses are costs that are necessary to accomplish the corrective work but are not directly attributable to the deficient systems direct construction cost, which are often referred to as hard cost. The components included in the soft costs vary by owner but usually include architect and contractor fees, contingencies and other owner-incurred costs necessary to fully develop and build a facility. These soft cost factors can be adjusted anytime within the eCOMET database at the owner's discretion.
Assessment	Visual survey of a facility to determine its condition. It involves looking at the age of systems, reviewing information from local sources and visual evidence of potential problems to assign a condition rating. It does not include destructive testing of materials or testing of systems or equipment for functionality.
ASTM	ASTM International (ASTM): Originally known as the American Society for Testing and Materials, ASTM is an international standards organization that develops and publishes voluntary consensus technical standards for a wide range of materials, products, systems, and services.
BOMA	Building Owners Managers of America (BOMA): National organization of public and private facility owners focused on building management tools and maintenance techniques. eCOMET® reference: Building and component system effective economic life expectancies.
Building	A fully enclosed and roofed structure that can be traversed internally without exiting to the exterior.
Building Addition	An area, space or component of a building added to a building after the original building's year built date. NOTE: As a convention in the database, "Main" was used to designate the original building. Additions built prior to 1987 (30 years) were included in the main building area calculations to reflect their predicted system depreciation characteristics and remaining service life.
Building Systems	eCOMET® uses UNIFORMAT II to organize building data. UNIFORMAT II was originally developed by the federal General Services Administration to delineate building costs by systems rather than by material. UNIFORMAT II was formalized by an NIST standard, NISTIR 6389 in 1999. It has been further quantified and updated by ASTM standard 2005, E1557-05. The Construction Specifications Institute, CSI, has taken over the standard as part of their MasterFormat / MasterSpec system.
Calculated Next Renewal	The year a system or building element would be expected to expire based solely on the date it was installed and the expected useful lifetime for that kind of system.
Capital Renewal	Capital renewal refers to the cyclical replacement of building systems or elements as they become obsolete or beyond their useful life. It is not normally included in an annual operating/maintenance budget. See calculated next renewal and next renewal.
City Cost Index (CCI)	RS Means provides building system, equipment, and construction costs at a national level. The City Cost Index (also provided by RS Means) localizes those costs to a geographic region of the United States. In eCOMET®, each building or site is assigned a City Cost Index, which adjusts all of the associated costs for systems, deficiencies and inventory to the local value.
Condition	Condition refers to the state of physical fitness or readiness of a facility system or system element for its intended use.
Condition Budget	The Condition Budget, also known as Condition Needs, represents the budgeted contractor installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging the work.

School Assessment Report - Kimberly Elementary School

Condition Index (CI) %	The Condition Index (CI) also known as the Remaining Service Life Index (RSLI) is calculated as the sum of a renewable system's Remaining Service Life (RSL) Value divided by the sum of a system's Replacement Value (both values exclude soft cost to simplify calculation updates) expressed as a percentage ranging from 100.00% (new) to 0.00% (expired - no remaining life).
Correction	Correction refers to an assessor's recommended deficiency repair or replacement action. For any system or element deficiency, there can be multiple and alternative solutions for its repair or replacement. A Correction is user defined and tied to a UNIFORMAT II element, or system it is intended to address. It excludes other peripheral costs that may also be included in the packaging of repair, replacement or renewal improvements that may also be triggered by the deficiency correction.
Cost Model	A cost model is a list of facility systems which could represent the installed systems a given facility. Included in the cost model are standard unit cost estimates, gross areas, life cycles and installed dates. Also represented is the repair cost for deficient systems, replacement values. See eCOMET® cost models.
Criteria	Criteria refer to the set of requirements, guidelines or standards that are assessed and rated to develop a score.
Current Period	The Current Period is the current year plus a user defined number of forward years.
Current Replacement Value (CRV)	The Current Replacement Value (CRV) of a facility, building or system represents the hypothetical cost of rebuilding or replacing an existing facility under today's codes and construction standards, using its current configuration. It is calculated by multiplying the gross area of the facility by a square foot cost developed in that facility's cost model. Replacement cost includes construction costs and owner's additional or soft costs for fees, permits and other expenses to reflect a total project cost.
Deferred Maintenance	Deferred maintenance is condition work deferred on a planned or unplanned basis to a future budget cycle or postponed until funds are available.
Deficiency	A deficiency is a repair item that is damaged, missing, inadequate or insufficient for an intended purpose.
Deficiency Category	Category refers to the type or class of a user defined deficiency grouping with shared or similar characteristics. Category descriptions include, but are not limited to: Accessibility Code Compliance, Appearance, Building Code Compliance, Deferred Maintenance, Energy, Environmental, Life Safety Code Compliance, and Safety.
Deficiency Priority	Priority refers to a deficiency's urgency for repair as determined by the assessment team. Five typical industry priority settings were used for the assessment: Priority 1 – Currently Critical; Priority 2 – Potentially Critical; Priority 3 – Necessary/Not Yet Critical; Priority 4 – Recommended.
Distress	Distress refers to a user-defined root cause of a deficiency. Distress descriptions are: Beyond Service Life, Damaged, Inadequate, Needs Remediation, and Missing.
eCOMET®	Energy and Condition Management Estimation Technology (eCOMET®) is Parsons proprietary facility asset management software developed to provide facility managers with a state of the art, web-based tool to develop and maintain a comprehensive database of FCA data and information used for facility asset management, maintenance and repair, and capital renewal planning. eCOMET® is used by Parsons and its clients as the primary tool for collecting FCA data, preparing cost estimates, generating individual facility reports and cost estimates, and developing the overall capital renewal program.
eCOMET® Cost Models	eCOMET cost models are derived from RS Means Square Foot Cost Data cost models and these models are used to develop the current replacement value (CRV) and assign life cycle costs to the various systems within a building. Cost models are assigned current costs-per-square-foot to establish replacement values. The Cost models are designed to represent a client specific facility that meets local standards cost trends.

School Assessment Report - Kimberly Elementary School

Element	Elements are the major components that comprise building systems as defined by UNIFORMAT II.
Expected Life	Also referred to as Useful Life. See Useful Life definition.
Facility	A facility refers to site(s) building(s) or building addition(s) or combinations thereof that provide a particular service.
Facility Attributes	Customizable eCOMET fields to identify attributes specific to a facility. These fields are part of the eCOMET database set-up with the owner.
Facility Condition Assessment (FCA)	A facility condition assessment (FCA) is a visual inspection of buildings and grounds at a facility to identify and estimate current and future needed repairs or replacements of major systems for planning and budgeting purposes. It is typically performed for organizations that are tasked with the day to day maintenance, operation, and capital renewal (replacement) of building systems and components of a large inventory of facilities. The primary goal of an FCA is to objectively and quantifiably identify, inspect, and prioritize the repair and replacement needs of the building and ground systems (e.g., roofs, windows, doors, floor finishes, plumbing fixtures, parking lot, and sidewalks) within facilities that have either failed or have surpassed their service life, and to identify and forecast future capital replacement needs for systems that have not yet failed, but planned replacement of those systems is needed to ensure that the facilities will continue to meet the mission of the organization.
Facility Condition Index (FCI%)	FCI is an industry-standard measurement of a facility's condition that is the ratio of the cost to correct a facility's deficiencies to the Current Replacement Value of the facilities. The higher the FCI the poorer the condition of a facility. After an FCI is established for all buildings within a portfolio a building's condition can be ranked relative to other buildings. The FCI may also represent the condition of a portfolio based on the cumulative FCIs of the portfolio's facilities.
Forecast Period	The Forecast Period refers to a user defined number of years forward of the Current Period.
Gen (Generate)	The Cost Model has a Gen box for each system line item. By checking the box, eCOMET will generate life cycle deficiencies based on the Year Installed and the Life for that system. Systems that typically do not re-generate (foundations, floor construction, roof construction, basement walls, etc.) would not have the Gen box checked as those systems would not re-generate at the end of a life cycle. In those instances, it would be more practical and cost effective to demolish the entire facility than re-new those systems.
Gross Square Feet (GSF)	The size of the enclosed floor space of a building in square feet measured to the outside face of the enclosing wall.
Life Cycle	Life cycle refers to the period of time that a building or site system or element can be expected to adequately serve its intended function. Parsons assigns expected life cycles to all building systems based on Building Operators and Managers of America (BOMA) recommended life cycles, manufacturers suggested life, and RS Means cost data, and client-provided historical data. BOMA standards are a nationally recognized source of life cycle data for various components and/or systems associated with facilities. RS Means is a national company specializing in construction estimating and costs.
Next Renewal	Next Renewal refers to a manually-adjusted expected useful life of a system or element based on on-site inspection either by reducing or extending the Calculated Next Renewal to more accurately reflect current conditions.
Order of Magnitude	Order of Magnitude refers to a rough approximation made with a degree of knowledge and confidence that the budgeted, projected or estimated cost falls within a reasonable range of cost values.
Remaining Service Life (RSL)	RSL is the number of years service remaining for a system or equipment item. It is automatically calculated based on the difference between the current year and the 'Calculated Next Renewal' date or the 'Next Renewal' date whichever one is the later date.

School Assessment Report - Kimberly Elementary School

Remaining Service Life Index (RSLI)	The Remaining Service Life Index (RSLI), also known as the Condition Index (CI), is calculated as the sum of a renewable system's or component's Remaining Service Life (RSL) Value divided by the sum of a system's or component's Replacement Value (both values exclude softcost to simplify calculation updates) expressed as a percentage ranging from 100.00% (new) to 0.00% (expired - no remaining service life).
Remaining Service Life Value	Remaining Service Life Value, also known as the RSL Weight, is a calculated value used to determine the RSLI and is equal to the system Value (Unit Cost * Qty) * RSL (not displayed).
Renewal Factors	Renewal factors represent the difference in cost of renovating or replacing an existing system, rather than new construction of a building system. For example, installing a new built-up roof on an existing building would include removing and disposing of the old roof, a cost not associated with new construction. Using a renewal premium to account for demolition and other difficulty costs, Parsons typically assigns a renewal factor of 110%.
Renewal Schedule	A timeline that provides the items that need repair the year in which the repair is needed and the estimated price of the renewal.
Repair Cost	Repair cost is the sum of all the deficiencies associated with a building or multiple buildings/facilities. It will include any applied soft costs or City Cost Indexes.
Replacement Value	See Current Replacement Value.
Site	A facility's grounds and its utilities, roadways, landscaping, fencing and other typical land improvements needed to support a facility.
Soft Costs	Soft Costs are a construction industry term that refers to expense items that are not considered direct construction costs. Soft costs are user-defined and include architectural, engineering, management, testing, and mitigation fees, and other owner pre- and post-construction expenses.
Sustainability	Sustainability refers to the collection of policies and strategies that meet society's present needs without compromising the ability of future generations to meet their own needs.
System	System refers to building and related site work elements as described by ASTM Uniformat II Classification for Building Elements (E1557-97) a format for classifying major facility elements common to most buildings. Elements usually perform a given function regardless of the design specification construction method or materials used. See also Uniformat II.
System Generated Deficiency	eCOMET automatically generates system deficiencies based on system life cycles using the systems installation dates as the base year. By adjusting the Next Renewal date ahead or behind the predicted or stated life cycle date, a system cost will come due earlier or later than the originally installed life cycle date. This utility accounts for good maintenance conditions and a longer life, or early expiration of a system life due to any number of adverse factors such as poor installation, acts of god, material defects, poor design applications and other factors that may shorten the life of a material or system. It is important to mention that the condition of the systems is not necessarily a reflection of maintenance practices, but a combination of system usage and age.
UNIFORMAT	ASTM UNIFORMAT II, Classification for Building Elements (E1557-97), a publication of the Construction Specification Institute (CSI), is a format used to classify major facility components common to most buildings. The format is based on functional elements or parts of a facility characterized by their functions without regard to the materials and methods used to accomplish them. These elements are often referred to as systems or assemblies.
Unit Price	The Unit Price (Raw) x the Additional Cost Template percentage.
Unit Price (Raw)	The actual \$/sq. ft. cost being used for the building and systems. It will include adjustments for the City Cost Index applied to the facility.

School Assessment Report - Kimberly Elementary School

Useful Life	Also known as Expected Life, Useful Life refers to the intrinsic period of time a system or element is expected to perform as intended. Useful life is generally provided by manufacturers of materials, systems and elements through their literature, testing and experience. Useful Lives in the database are derived from the Building Owners and Managers (BOMA) organization's guidelines, RSMeans cost data, and from client- defined historical experience.
Vacant	Vacant refers to a facility that is not occupied but is a maintained facility. See Abandoned.
Year Built	The year that a building or addition was originally built based on substantial completion or occupancy.
Year Installed	The year a system or element was built or the most recent major renovation date where a minimum of 70% of the system's Current Replacement Value (CRV) was replaced.



Suitability Report - Full

Project #: 12382	County: Atlanta Public Schools	Site #: 1064
Project: APS Assessments 2019	Region: 761	Site: Kimberly ES
Grade Config: PK-5	Site Type: Elementary	Site Size: 7.00

Suitability	Rating	Score	Possible Score	Percent Score
Suitability - ES				
Learning Environment				
Learning Style Variety	Good	4.00	5.00	80.00
Interior Environment	Good	1.60	2.00	80.00
Exterior Environment	Unsat	0.00	1.50	0.00
General Classrooms				
Environment	Good	3.72	4.65	80.00
Size	Excel	11.63	11.63	100.00
Location	Excel	3.49	3.49	100.00
Storage/Fixed Equip	Fair	2.27	3.49	65.00
Kindergarten				
Environment	Good	0.33	0.42	80.00
Size	Excel	1.04	1.04	100.00
Location	Excel	0.31	0.31	100.00
Storage/Fixed Equip	Fair	0.20	0.31	65.00
ECE				
Environment	Good	0.40	0.50	80.00
Size	Excel	1.25	1.25	100.00
Location	Poor	0.19	0.37	50.00
Storage/Fixed Equip	Fair	0.24	0.37	65.00
Self-Contained Special Ed				
Environment	Excel	0.48	0.48	100.00
Size	Good	0.96	1.20	80.00
Location	Excel	0.36	0.36	100.00
Storage/Fixed Equip	Good	0.29	0.36	80.00
Instructional Resource Rooms				
Environment	Excel	0.72	0.72	100.00
Size	Good	1.44	1.80	80.00
Location	Excel	0.54	0.54	100.00
Storage/Fixed Equip	Good	0.43	0.54	80.00
Science				
Environment	Unsat	0.00	0.40	0.00
Size	Unsat	0.00	1.00	0.00
Location	Unsat	0.00	0.30	0.00
Storage/Fixed Equip	Unsat	0.00	0.30	0.00
Music				
Environment	Good	0.59	0.74	80.00

Project #: 12382

County: Atlanta Public Schools

Site #: 1064

Project: APS Assessments 2019

Region: 761

Site: Kimberly ES

Grade Config: PK-5

Site Type: Elementary

Site Size: 7.00

Suitability	Rating	Score	Possible Score	Percent Score
Size	Excel	1.85	1.85	100.00
Location	Excel	0.56	0.56	100.00
Storage/Fixed Equip	Good	0.44	0.56	80.00
Art				
Environment	Good	0.37	0.47	80.00
Size	Fair	0.76	1.17	65.00
Location	Excel	0.35	0.35	100.00
Storage/Fixed Equip	Fair	0.23	0.35	65.00
Maker Space				
Environment	(N/A)	0.00	0.00	0.00
Size	(N/A)	0.00	0.00	0.00
Location	(N/A)	0.00	0.00	0.00
Storage/Fixed Equip	(N/A)	0.00	0.00	0.00
Computer Labs				
Environment	Excel	0.34	0.34	100.00
Size	Fair	0.55	0.85	65.00
Location	Excel	0.26	0.26	100.00
Storage/Fixed Equip	Fair	0.17	0.26	65.00
P.E.				
Environment	Good	1.54	1.92	80.00
Size	Excel	4.80	4.80	100.00
Location	Fair	0.94	1.44	65.00
Storage/Fixed Equip	Excel	1.44	1.44	100.00
Performing Arts				
Environment	Excel	0.60	0.60	100.00
Size	Excel	1.51	1.51	100.00
Location	Excel	0.45	0.45	100.00
Storage/Fixed Equip	Unsat	0.00	0.45	0.00
Media Center				
Environment	Excel	0.97	0.97	100.00
Size	Excel	2.44	2.44	100.00
Location	Good	0.58	0.73	80.00
Storage/Fixed Equip	Good	0.58	0.73	80.00
Restrooms (Student)	Excel	0.89	0.89	100.00
Administration	Excel	2.56	2.56	100.00
Counseling	Fair	0.19	0.29	65.00
Clinic	Excel	0.58	0.58	100.00
Staff WkRm/Toilets	Good	1.01	1.27	80.00
Cafeteria	Excel	5.00	5.00	100.00
Food Service and Prep	Excel	6.20	6.20	100.00
Custodial and Maintenance	Good	0.40	0.50	80.00
Outside				
Vehicular Traffic	Excel	2.00	2.00	100.00
Pedestrian Traffic	Good	0.78	0.97	80.00
Parking	Fair	0.53	0.81	65.00
Play Areas	Good	1.87	2.34	80.00

Project #: 12382

County: Atlanta Public Schools

Site #: 1064

Project: APS Assessments 2019

Region: 761

Site: Kimberly ES

Grade Config: PK-5

Site Type: Elementary

Site Size: 7.00

Suitability	Rating	Score	Possible Score	Percent Score
Safety and Security				
Fencing	Excel	0.75	0.75	100.00
Signage & Way Finding	Good	0.80	1.00	80.00
Ease of Supervision	Excel	3.00	3.00	100.00
Controlled Entrances	Excel	0.50	0.50	100.00
Total For Site:		85.30	98.25	86.82

Comments

Suitability - ES

Kimberly Elementary School has 430 students enrolled in grades PreK through 5. The school is home to the regional program for autism and for students with emotional conditions. The original building was built in 1958, and has had a number of renovations and additions since this time.

Suitability - ES->Learning Environment-->Exterior Environment

There is no outdoor learning space.

Suitability - ES->General Classrooms-->Storage/Fixed Equip

Classrooms have some built in storage, but not enough for books and student belongings.

Suitability - ES->Kindergarten-->Storage/Fixed Equip

Classrooms do not have enough fixed storage for teachers or for students.

Suitability - ES->ECE-->Location

PreK is located on the second floor, requiring students to take stairs and be far from shared spaces such as the cafeteria.

Suitability - ES->ECE-->Storage/Fixed Equip

There are no restrooms located within the PreK classes. The storage is inadequate throughout all learning spaces.

Suitability - ES->Science-->Environment

There are no science classes in this school.

Suitability - ES->Science-->Size

There are no science classes in this school.

Suitability - ES->Science-->Location

There are no science classes in this school.

Suitability - ES->Science-->Storage/Fixed Equip

There are no science classes in this school.

Suitability - ES->Music-->Environment

The music classroom does not have sound panels.

Suitability - ES->Art-->Size

The art room is 66% of the standard.

Suitability - ES->Art-->Storage/Fixed Equip

There is no kiln or ventilation for a kiln in this room. The art room has only one sink with no clay trap.

Suitability - ES->Computer Labs-->Size

These classrooms are 65% the size of the standard.

Suitability - ES->Computer Labs-->Storage/Fixed Equip

Storage throughout all classrooms is inadequate.

Project #: 12382

County: Atlanta Public Schools

Site #: 1064

Project: APS Assessments 2019

Region: 761

Site: Kimberly ES

Grade Config: PK-5

Site Type: Elementary

Site Size: 7.00

Suitability	Rating	Score	Possible Score	Percent Score
Suitability - ES->P.E.-->Location				
The gym is located next to general classrooms and the art classroom. Causing noise disturbance.				
Suitability - ES->Performing Arts-->Storage/Fixed Equip				
There is no storage in the performing arts area.				
Suitability - ES->Counseling				
This office is difficult for students to access down stairs, and does not have a waiting area.				
Suitability - ES->Outside-->Parking				
There is no lighting in the parking area for after hours. Cameras in the parking areas have many blind spots.				
Suitability - ES->Outside-->Play Areas				
The play area is not ADA accessible.				