

Atlanta Public Schools/ N. Atlanta Cluster

Sutton Middle School

Revised

School Assessment Report

November 10, 2020



Table of Contents

School Executive Summary	4
School Dashboard Summary	7
School Condition Summary	8
<u>1951_1954_1969 Bldg 501.1_501.2_501.3_503.3</u>	10
Executive Summary	10
Dashboard Summary	11
Condition Summary	12
Photo Album	13
Condition Detail	14
System Listing	15
System Notes	17
Renewal Schedule	29
Forecasted Sustainment Requirement	32
Condition Index Forecast by Investment Scenario	33
Deficiency Summary By System	34
Deficiency Summary By Priority	35
Deficiency By Priority Investment	36
Deficiency Summary By Category	37
Deficiency Details By Priority	38
<u>1994 Bldg 501.4</u>	39
Executive Summary	39
Dashboard Summary	40
Condition Summary	41
Photo Album	42
Condition Detail	43
System Listing	44
System Notes	46
Renewal Schedule	58
Forecasted Sustainment Requirement	61

School Assessment Report

Condition Index Forecast by Investment Scenario	62
Deficiency Summary By System	63
Deficiency Summary By Priority	64
Deficiency By Priority Investment	65
Deficiency Summary By Category	66
Deficiency Details By Priority	67
Site	68
Executive Summary	68
Dashboard Summary	69
Condition Summary	70
Photo Album	71
Condition Detail	72
System Listing	73
System Notes	74
Renewal Schedule	79
Forecasted Sustainment Requirement	80
Condition Index Forecast by Investment Scenario	81
Deficiency Summary By System	82
Deficiency Summary By Priority	83
Deficiency By Priority Investment	84
Deficiency Summary By Category	85
Deficiency Details By Priority	86
Glossary	87

School Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as $100 - \text{Total FCI}$ (without the %) where 100 is best and 0 is worst condition.

Gross Area (SF):	306,506
Year Built:	1951
Last Renovation:	
Replacement Value:	\$69,362,702
Repair Cost:	\$140,712.00
Total FCI:	0.20 %
Total RSLI:	51.07 %
FCA Score:	99.80



Description:

Sutton Middle School is located 2875 Northside Dr NW in Atlanta, Georgia. The three story, 306,506 square foot building was originally constructed in 1951. Additions to the main school building were constructed in 1954, 1969, and 1994. A major three-phase renovation was completed in 2011.

This report contains condition and adequacy data collected during the 2019 Facility Condition Assessment (FCA) Update. Detailed condition and deficiency statements are contained in this report for the site and building elements.

A. SUBSTRUCTURE

The building rests on slab-on grade and is assumed to have standard cast-in-place concrete foundations. The building does not have a basement.

B. SUPERSTRUCTURE

Floor construction is metal pan deck with lightweight fill. Roof construction is metal pan deck with lightweight fill. The exterior

School Assessment Report - Sutton Middle School

envelope is composed of walls of brick veneer over CMU. Exterior windows are aluminum frame with operable panes. Exterior doors are hollow metal steel mostly with glazing. Roofing is typically low slope built-up. Roof openings include a roof hatch with fixed ladder access. Most building entrances appear to comply with ADA requirements.

C. INTERIORS

Interior partitions are typically CMU. Interior doors are generally solid core wood with hollow metal frames and mostly with glazing. Interior fittings include the following items: white boards, graphics and identifying devices, toilet accessories, storage shelving, handrails, fabricated toilet partitions. The interior wall finishes are typically painted CMU. Floor finishes in common areas are typically vinyl composition tile. Floor finishes in assignable spaces is typically vinyl composition tile., carpet, and Ceramic tile. Ceiling finishes in common areas are typically suspended acoustical tile. Ceiling finishes in assignable areas are typically suspended acoustical tile.

D. SERVICES

CONVEYING: The building does include conveying equipment. Conveying equipment includes hydraulic elevators, and wheelchair lifts.

PLUMBING: Plumbing fixtures are typically low-flow water fixtures with manual control valves. Domestic water distribution is combination of copper and galvanized steel with electric hot water heating. Sanitary waste system is cast iron. Rainwater drainage system is internal with roof drains.

HVAC: Heating is provided by gas fired boilers. Cooling is supplied by rooftop package units. The heating/cooling distribution system is a ductwork system utilizing air handling units. Ceiling mounted exhaust fans are installed in bathrooms and other required areas. Controls and instrumentation are digital and are centrally controlled by an energy management system. This school has a remote Building Automation System.

FIRE PROTECTION: The building does have a fire sprinkler system. The building does have a kitchen hood fire suppression system. Fire extinguishers and cabinets are distributed near fire exits and corridors.

ELECTRICAL: The main electrical service is fed from a pad mounted transformer to the main switchboard/distribution panel located in the building. Lighting is lay-in type, fluorescent light fixtures. Branch circuit wiring is typically copper serving electrical switches and receptacles. Emergency and life safety egress lighting systems are installed and exit signs are present at exit doors and near stairways and are typically illuminated.

COMMUNICATIONS AND SECURITY: The fire alarm system consists of audible/visual strobe annunciators in all common spaces. The system is activated by manual pull stations and smoke detectors and the system is centrally monitored. The telephone and data systems are segregated and include dedicated equipment closets. This building does have a local area network (LAN). The building includes an internal security system that is actuated by the following items: contacts, infrared, optical or a combination of all devices. The building has controlled entry doors access provided by card readers; entry doors are secured with magnetic door locks. The security system has CCTV cameras and is centrally monitored; this building has a public address and paging system combined with the telephone system.

OTHER ELECTRICAL SYSTEMS: This building does not have a separately derived emergency power system. There is no natural gas emergency generator.

E. EQUIPMENT & FURNISHINGS

This building includes the following items and equipment: fixed food service, library equipment, fixed casework, window treatment, floor grilles and mats, and multiple seating furnishings.

G. SITE

Campus site features include paved driveways and parking lots, pedestrian pavement, flagpole, landscaping, play areas, covered walkways, baseball field, football field, track, and tennis courts and fencing. Site mechanical and electrical features include water, sewer, natural gas and site lighting.

CODE REVIEW

ACCESSIBILITY: The building is generally in compliance with applicable ADA requirements with respect to path of travel, interior and exterior doors, interior signage, and toilet room dimensions, fixtures, and fittings. Most building entrances appear to comply with ADA requirements.

LIFE-SAFETY SYSTEMS: The building is not covered with a wet sprinkler system. Fire extinguishers are located throughout the building. Power outlets in wet areas are GFIC protected. The fire alarm system includes detection devices, audio/visual alarms, and pull stations. Emergency/egress lighting is a combination of battery and special circuit systems. Illuminated exit signage is present in corridors and at exit doors. There is no fall protection at the roof.

School Assessment Report - Sutton Middle School

Attributes:

General Attributes:


Arch Condition Assessor:	Eduardo Lopez	MEP Condition Assessor:	Homero Guerrero
School Grades:	07, 08	DOE Drawing Total GSF:	306506
DOE Facility Number:	192	Total # of Modular/Portables:	0
DOE Interior Site SF:	280032	Total GSF of Modular/Portables:	0
Approx. Acres:	17.5	Status:	Active

School Dashboard Summary


Gross Area: 306,506
 Year Built: 1951
 Repair Cost: \$140,712
 FCI: 0.20 %

Last Renovation:
 Replacement Value: \$69,362,702
 RSLI%: 51.07 %


Deficiency By Category

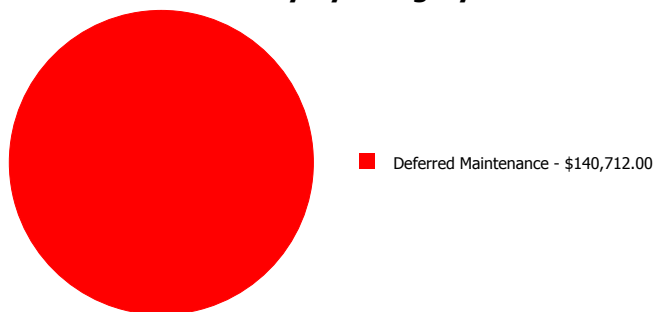


Deficiency By Priority

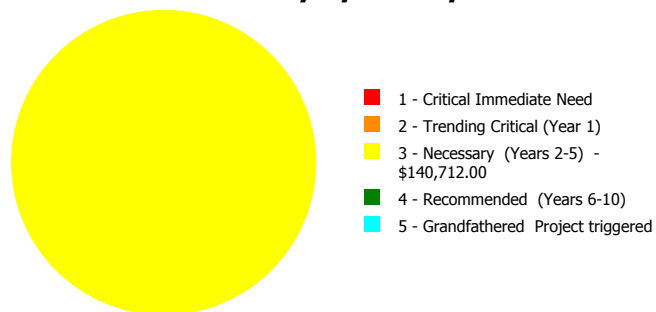

Deficiency By System

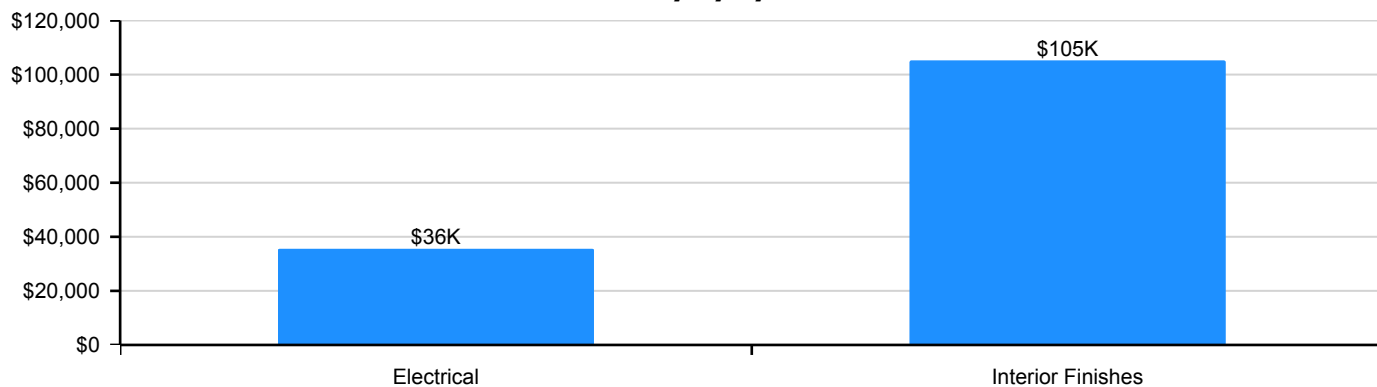

10 Year Investment Forecast

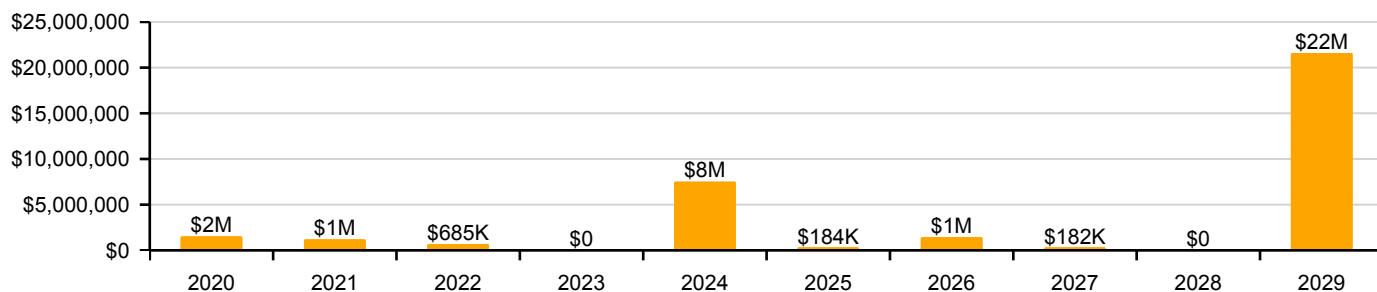

School Condition Summary

The Table below shows the RSLI and FCI for each major system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.


Current Investment Requirement and Condition by Uniformat Classification

UNIFORMAT Classification	RSLI%	FCI %	Current Repair
A10 - Foundations	43.14 %	0.00 %	\$0.00
A20 - Basement Construction	43.16 %	0.00 %	\$0.00
B10 - Superstructure	42.98 %	0.00 %	\$0.00
B20 - Exterior Enclosure	56.18 %	0.00 %	\$0.00
B30 - Roofing	38.38 %	0.00 %	\$0.00
C10 - Interior Construction	78.82 %	0.00 %	\$0.00
C20 - Stairs	44.49 %	0.00 %	\$0.00
C30 - Interior Finishes	51.01 %	1.69 %	\$105,176.00
D10 - Conveying	38.59 %	0.00 %	\$0.00
D20 - Plumbing	41.98 %	0.00 %	\$0.00
D30 - HVAC	40.19 %	0.00 %	\$0.00
D40 - Fire Protection	51.95 %	0.00 %	\$0.00
D50 - Electrical	43.81 %	0.51 %	\$35,536.00
E10 - Equipment	60.00 %	0.00 %	\$0.00
E20 - Furnishings	60.00 %	0.00 %	\$0.00
G20 - Site Improvements	60.26 %	0.00 %	\$0.00
G30 - Site Mechanical Utilities	84.00 %	0.00 %	\$0.00
G40 - Site Electrical Utilities	73.33 %	0.00 %	\$0.00
Totals:	51.07 %	0.20 %	\$140,712.00

Condition Deficiency Priority

Facility Name	Gross Area (S.F.)	FCI %	1 - Critical Immediate Need	2 - Trending Critical (Year 1)	3 - Necessary (Years 2-5)	4 - Recommended (Years 6-10)	5 - Grandfathered Project triggered
1951_1954_1969 Bldg 501.1_501.2_501.3_503.3	214,204	0.14	\$0.00	\$0.00	\$55,500.00	\$0.00	\$0.00
1994 Bldg 501.4	92,302	0.50	\$0.00	\$0.00	\$85,212.00	\$0.00	\$0.00
Site	306,506	0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Total:		0.20	\$0.00	\$0.00	\$140,712.00	\$0.00	\$0.00

Deficiencies By Priority

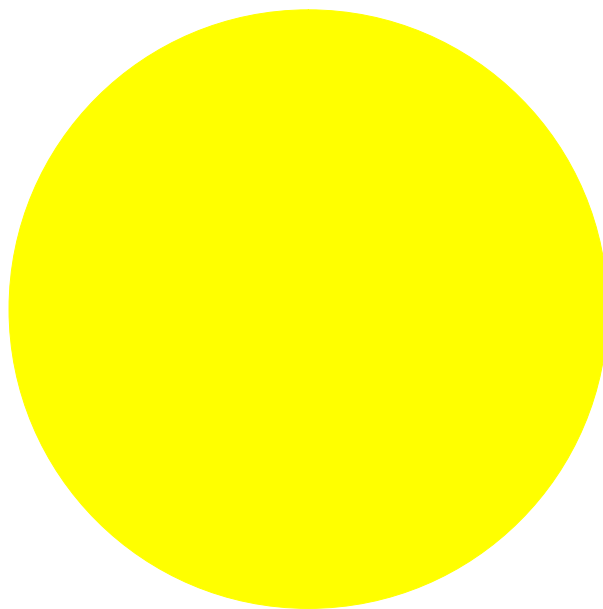

- 1 - Critical Immediate Need
- 2 - Trending Critical (Year 1)
- 3 - Necessary (Years 2-5) - \$140,712.00
- 4 - Recommended (Years 6-10)
- 5 - Grandfathered Project triggered


Budget Estimate Total: \$140,712.00

Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as $100 - \text{Total FCI}$ (without the %) where 100 is best and 0 is worst condition.

Function:	Middle
Gross Area (SF):	214,204
Year Built:	1951
Last Renovation:	
Replacement Value:	\$39,900,266
Repair Cost:	\$55,500.00
Total FCI:	0.14 %
Total RSLI:	47.05 %
FCA Score:	99.86

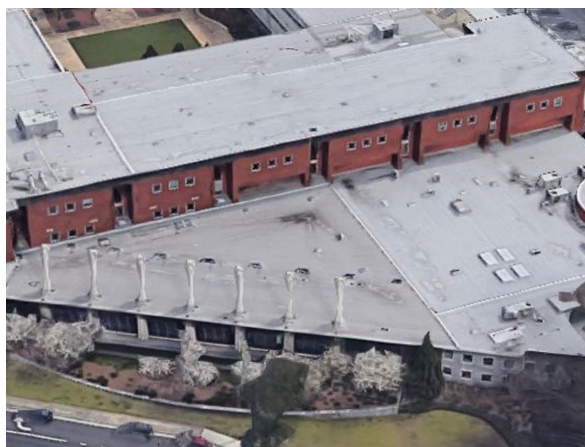

Description:


The narrative for this building is included in the Executive Summary Description at the front of this report.

Attributes: This asset has no attributes.


Dashboard Summary

Function:	Middle	Gross Area:	214,204
Year Built:	1951	Last Renovation:	
Repair Cost:	\$55,500	Replacement Value:	\$39,900,266
FCI:	0.14 %	RSLI%:	47.05 %


Deficiency By Category

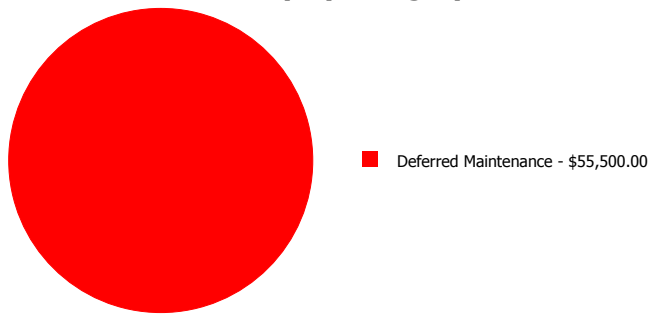


Deficiency By Priority

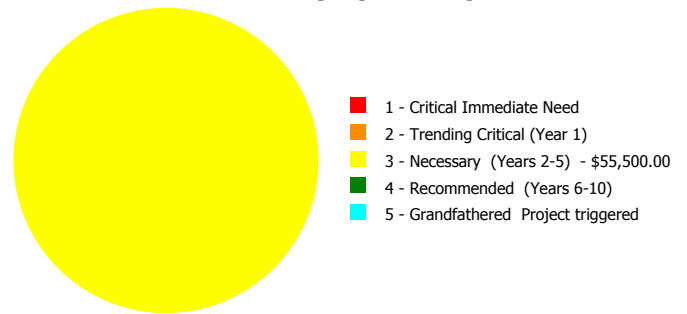

Deficiency By System

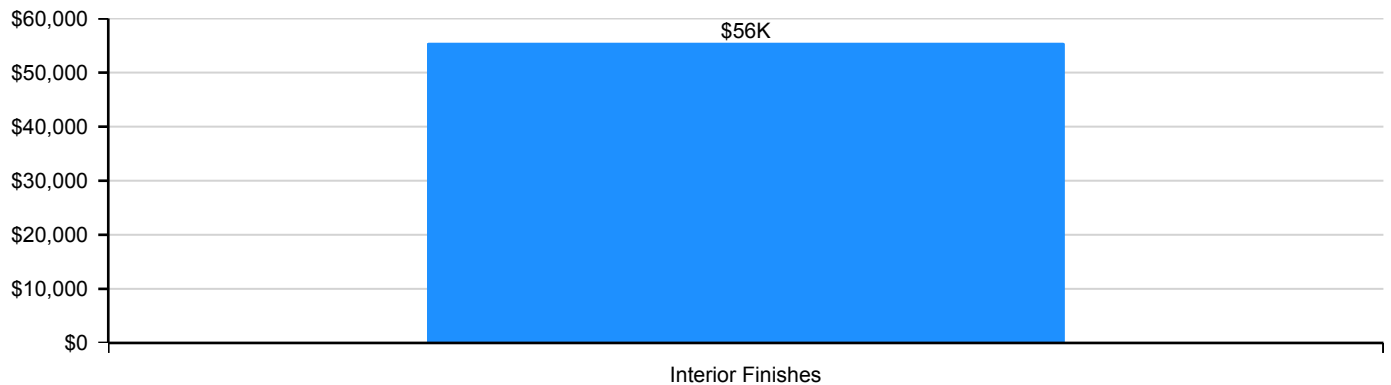

10 Year Investment Forecast

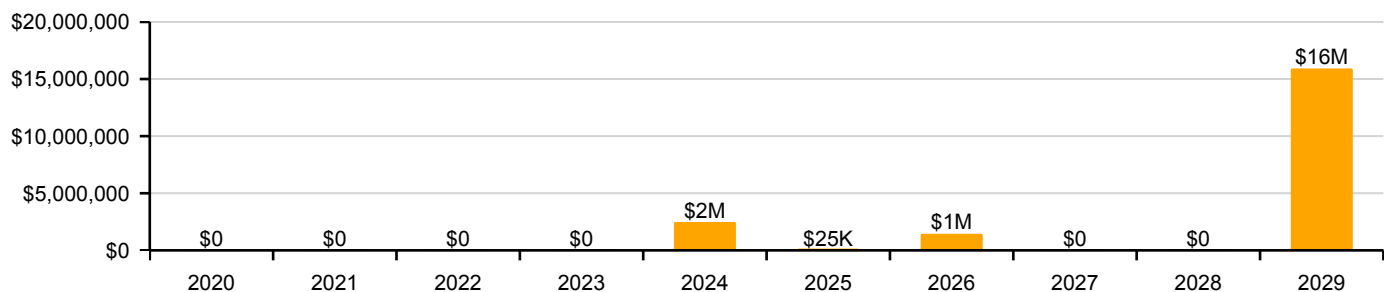

Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

UNIFORMAT Classification	RSLI %	FCI %	Current Repair Cost
A10 - Foundations	32.00 %	0.00 %	\$0.00
A20 - Basement Construction	32.00 %	0.00 %	\$0.00
B10 - Superstructure	32.00 %	0.00 %	\$0.00
B20 - Exterior Enclosure	48.76 %	0.00 %	\$0.00
B30 - Roofing	48.63 %	0.00 %	\$0.00
C10 - Interior Construction	81.14 %	0.00 %	\$0.00
C20 - Stairs	32.00 %	0.00 %	\$0.00
C30 - Interior Finishes	54.64 %	1.54 %	\$55,500.00
D10 - Conveying	50.00 %	0.00 %	\$0.00
D20 - Plumbing	54.65 %	0.00 %	\$0.00
D30 - HVAC	45.52 %	0.00 %	\$0.00
D40 - Fire Protection	66.17 %	0.00 %	\$0.00
D50 - Electrical	51.48 %	0.00 %	\$0.00
E10 - Equipment	60.00 %	0.00 %	\$0.00
E20 - Furnishings	60.00 %	0.00 %	\$0.00
Totals:	47.05 %	0.14 %	\$55,500.00

Photo Album

The photo album consists of the various cardinal compass directions of the building..

1). West Elevation - Nov 25, 2019



2). Southeast Elevation - Nov 25, 2019



3). Southeast Elevation - Nov 20, 2019



4). East Elevation - Nov 20, 2019



5). East Elevation - Nov 20, 2019



6). East Elevation - Nov 20, 2019



7). South Elevation - Nov 25, 2019



Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment)
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system as new construction.

School Assessment Report - 1951_1954_1969 Bldg 501.1_501.2_501.3_503.3

System Listing

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
A1010	Standard Foundations	\$7.66	S.F.	214,204	100	1951	2051		32.00 %	0.00 %	32			\$1,640,803
A1030	Slab on Grade	\$7.71	S.F.	214,204	100	1951	2051		32.00 %	0.00 %	32			\$1,651,513
A2010	Basement Excavation	\$0.19	S.F.	214,204	100	1951	2051		32.00 %	0.00 %	32			\$40,699
A2020	Basement Walls	\$2.92	S.F.	214,204	100	1951	2051		32.00 %	0.00 %	32			\$625,476
B1010	Floor Construction	\$20.45	S.F.	214,204	100	1951	2051		32.00 %	0.00 %	32			\$4,380,472
B1020	Roof Construction	\$15.29	S.F.	214,204	100	1951	2051		32.00 %	0.00 %	32			\$3,275,179
B2010	Exterior Walls	\$14.57	S.F.	214,204	100	1951	2051		32.00 %	0.00 %	32			\$3,120,952
B2020	Exterior Windows	\$9.07	S.F.	214,204	30	2011	2041		73.33 %	0.00 %	22			\$1,942,830
B2030	Exterior Doors	\$0.87	S.F.	214,204	30	2011	2041		73.33 %	0.00 %	22			\$186,357
B3010105	Built-Up	\$7.15	S.F.	70,000	25	2006	2031		48.00 %	0.00 %	12			\$500,500
B3020	Roof Openings	\$0.56	S.F.	70,000	30	2006	2036		56.67 %	0.00 %	17			\$39,200
C1010	Partitions	\$5.87	S.F.	214,204	100	2011	2111		92.00 %	0.00 %	92			\$1,257,377
C1020	Interior Doors	\$3.84	S.F.	214,204	40	2011	2051		80.00 %	0.00 %	32			\$822,543
C1030	Fittings	\$2.81	S.F.	214,204	20	2011	2031		60.00 %	0.00 %	12			\$601,913
C2010	Stair Construction	\$3.00	S.F.	214,204	100	1951	2051		32.00 %	0.00 %	32			\$642,612
C3010220	Tile	\$9.25	S.F.	4,000	30	1951	1981		0.00 %	150.00 %	-38		\$55,500.00	\$37,000
C3010230	Paint & Covering	\$1.47	S.F.	210,204	10	1951	1961		0.00 %	0.00 %	-58			\$309,000
C3020405	Epoxy	\$17.30	S.F.	5,000	15	2011	2026		46.67 %	0.00 %	7			\$86,500
C3020420	Ceramic Tile	\$16.74	S.F.	4,000	50	2011	2061		84.00 %	0.00 %	42			\$66,960
C3020430	Terrazzo	\$21.62	S.F.	15,000	50	2011	2061		84.00 %	0.00 %	42			\$324,300
C3020901	Carpet	\$7.50	S.F.	3,000	8	2011	2019	2024	62.50 %	0.00 %	5			\$22,500
C3020903	VCT	\$3.48	S.F.	182,204	15	2011	2026		46.67 %	0.00 %	7			\$634,070
C3020999	Other - Wood	\$13.79	S.F.	5,000	50	2011	2061		84.00 %	0.00 %	42			\$68,950
C3030	Ceiling Finishes	\$9.54	S.F.	214,204	20	2011	2031		60.00 %	0.00 %	12			\$2,043,506
D1010	Elevators and Lifts	\$1.35	S.F.	214,204	20	2009	2029		50.00 %	0.00 %	10			\$289,175
D2010	Plumbing Fixtures	\$6.71	S.F.	214,204	20	2009	2029		50.00 %	0.00 %	10			\$1,437,309
D2020	Domestic Water Distribution	\$0.78	S.F.	214,204	30	2009	2039		66.67 %	0.00 %	20			\$167,079
D2030	Sanitary Waste	\$1.82	S.F.	214,204	30	2009	2039		66.67 %	0.00 %	20			\$389,851
D3010	Energy Supply	\$0.61	S.F.	214,204	30	2009	2039		66.67 %	0.00 %	20			\$130,664
D3020	Heat Generating Systems	\$3.80	S.F.	214,204	20	2009	2029		50.00 %	0.00 %	10			\$813,975
D3030	Cooling Generating Systems	\$6.43	S.F.	214,204	20	2009	2029		50.00 %	0.00 %	10			\$1,377,332
D3040	Distribution Systems	\$11.27	S.F.	214,204	20	2009	2029		50.00 %	0.00 %	10			\$2,414,079

School Assessment Report - 1951_1954_1969 Bldg 501.1_501.2_501.3_503.3

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
D3050	Terminal & Package Units	\$6.65	S.F.	214,204	15	2009	2024		33.33 %	0.00 %	5			\$1,424,457
D3060	Controls & Instrumentation	\$2.32	S.F.	214,204	15	2009	2024		33.33 %	0.00 %	5			\$496,953
D4010	Sprinklers	\$4.35	S.F.	214,204	30	2009	2039		66.67 %	0.00 %	20			\$931,787
D4020	Standpipes	\$0.35	S.F.	214,204	30	2009	2039		66.67 %	0.00 %	20			\$74,971
D4030	Fire Protection Specialties	\$0.09	S.F.	214,204	15	2010	2025		40.00 %	0.00 %	6			\$19,278
D5010	Electrical Service/Distribution	\$2.45	S.F.	214,204	20	2009	2029		50.00 %	0.00 %	10			\$524,800
D5020	Branch Wiring	\$5.01	S.F.	214,204	20	2009	2029		50.00 %	0.00 %	10			\$1,073,162
D5020	Lighting	\$7.53	S.F.	214,204	20	2009	2029		50.00 %	0.00 %	10			\$1,612,956
D5030810	Security & Detection Systems	\$1.51	S.F.	214,204	20	2009	2029		50.00 %	0.00 %	10			\$323,448
D5030910	Fire Alarm Systems	\$2.74	S.F.	214,204	20	2009	2029		50.00 %	0.00 %	10			\$586,919
D5030920	Data Communication	\$3.56	S.F.	214,204	25	2009	2034		60.00 %	0.00 %	15			\$762,566
D5090	Other Electrical Systems	\$0.38	S.F.	214,204	15	2011	2026		46.67 %	0.00 %	7			\$81,398
E1020	Institutional Equipment	\$0.12	S.F.	214,204	20	2011	2031		60.00 %	0.00 %	12			\$25,704
E1090	Other Equipment	\$0.83	S.F.	214,204	20	2011	2031		60.00 %	0.00 %	12			\$177,789
E2010	Fixed Furnishings	\$2.07	S.F.	214,204	20	2011	2031		60.00 %	0.00 %	12			\$443,402
Total									47.05 %	0.14 %			\$55,500.00	\$39,900,266

System Notes


The facility description in the executive summary contains an overview of each system. The system notes listed below provide additional information on select systems found within the facility.

System: B2010 - Exterior Walls




Note:

System: B2020 - Exterior Windows

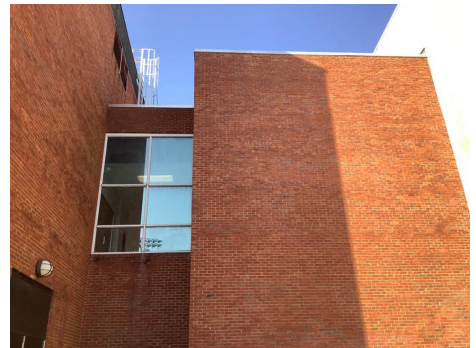

Note:

System: B2030 - Exterior Doors

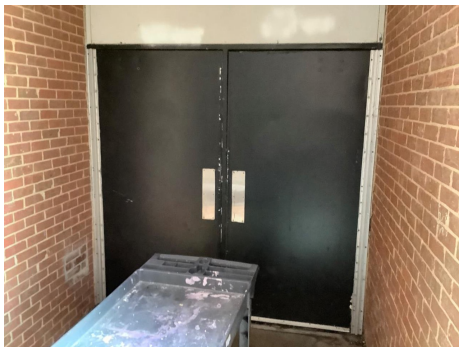

Note:


School Assessment Report - 1951_1954_1969 Bldg 501.1_501.2_501.3_503.3

System: B3010105 - Built-Up



Note:

System: B3020 - Roof Openings

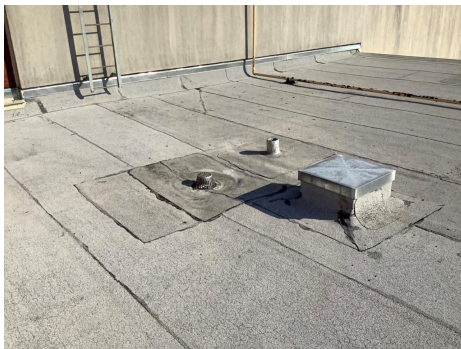

Note:



System: C1010 - Partitions



Note:

School Assessment Report - 1951_1954_1969 Bldg 501.1_501.2_501.3_503.3

System: C1020 - Interior Doors

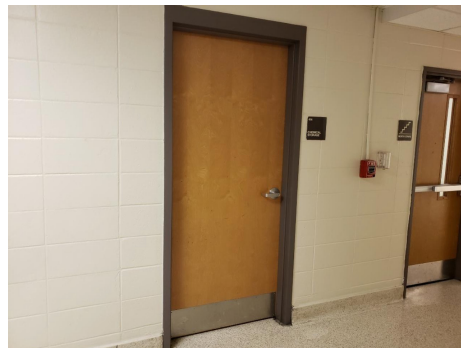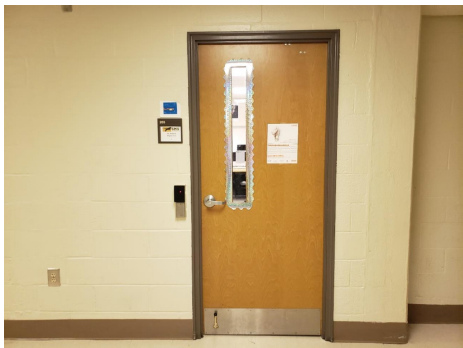




Note:

System: C1030 - Fittings



Note:


System: C2010 - Stair Construction

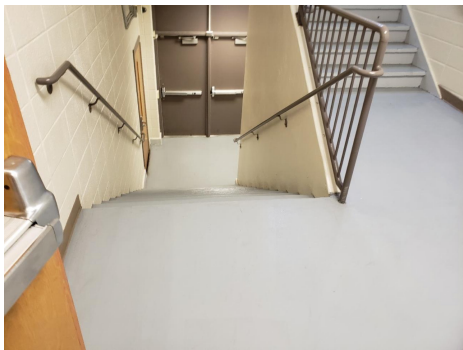

Note:



School Assessment Report - 1951_1954_1969 Bldg 501.1_501.2_501.3_503.3

System: C3010220 - Tile

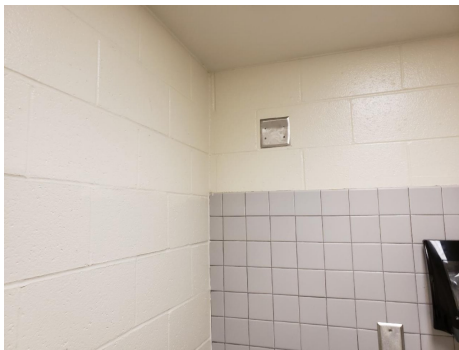



Note:

System: C3010230 - Paint & Covering

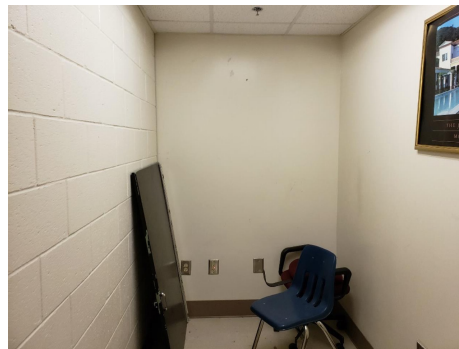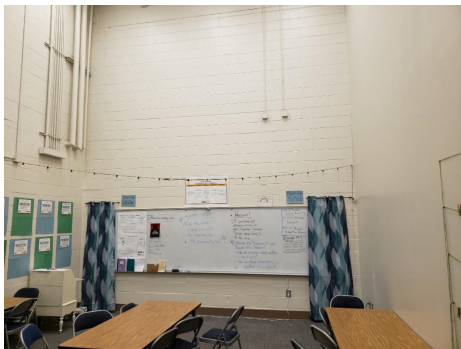

Note:




System: C3020405 - Epoxy

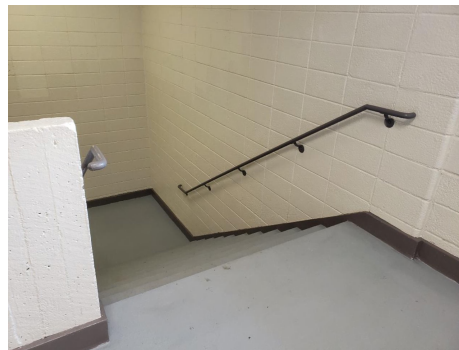

Note:


School Assessment Report - 1951_1954_1969 Bldg 501.1_501.2_501.3_503.3

System: C3020420 - Ceramic Tile

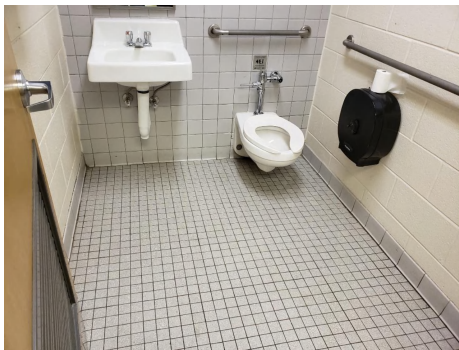



Note:

System: C3020430 - Terrazzo

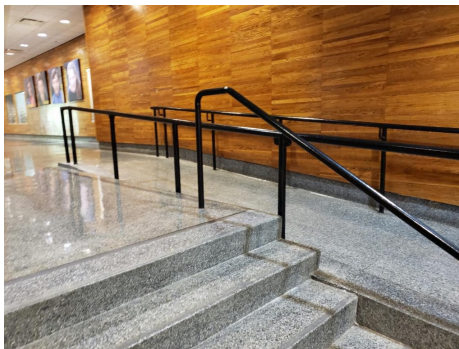

Note:

System: C3020901 - Carpet

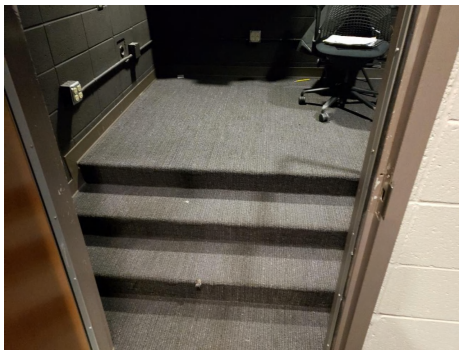

Note:

School Assessment Report - 1951_1954_1969 Bldg 501.1_501.2_501.3_503.3

System: C3020903 - VCT



Note:

System: C3020999 - Other - Wood



Note:




System: C3030 - Ceiling Finishes



Note:


School Assessment Report - 1951_1954_1969 Bldg 501.1_501.2_501.3_503.3

System: D1010 - Elevators and Lifts

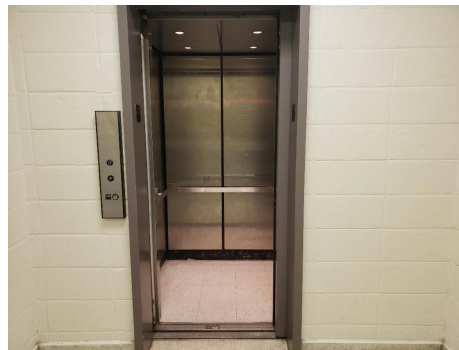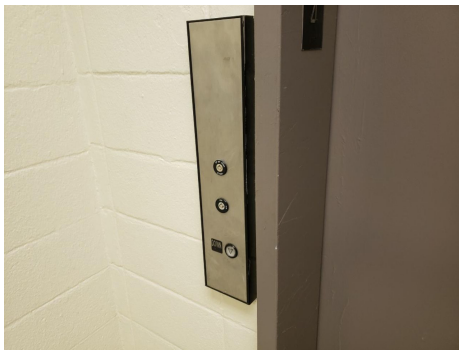


Note:

System: D2010 - Plumbing Fixtures



Note:


System: D2020 - Domestic Water Distribution

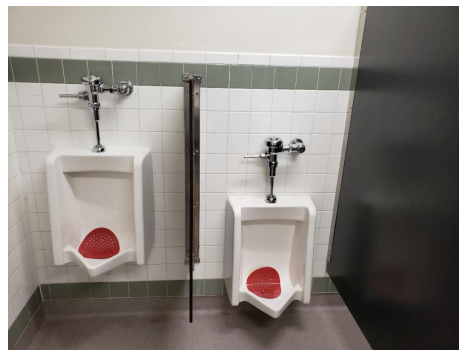

Note:

School Assessment Report - 1951_1954_1969 Bldg 501.1_501.2_501.3_503.3

System: D2030 - Sanitary Waste

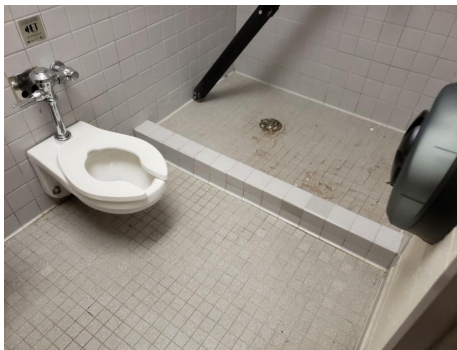

Note:

System: D3020 - Heat Generating Systems



Note:


System: D3030 - Cooling Generating Systems



Note:

School Assessment Report - 1951_1954_1969 Bldg 501.1_501.2_501.3_503.3

System: D3040 - Distribution Systems

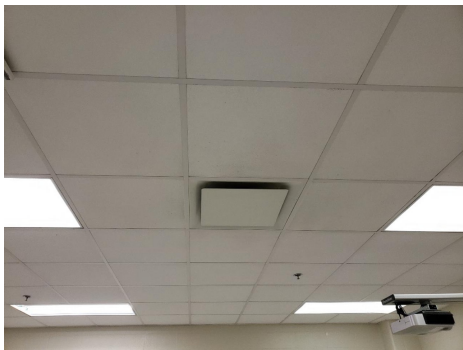


Note:

System: D3050 - Terminal & Package Units



Note:

System: D4010 - Sprinklers

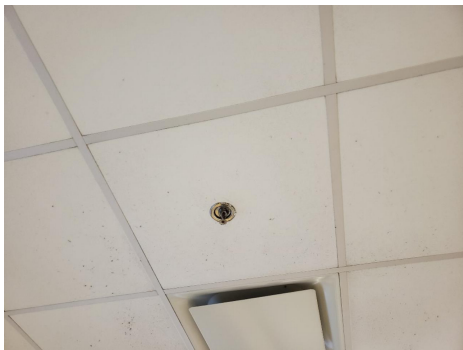

Note:

School Assessment Report - 1951_1954_1969 Bldg 501.1_501.2_501.3_503.3

System: D4020 - Standpipes




Note:

System: D5010 - Electrical Service/Distribution



Note:


System: D5020 - Branch Wiring



Note:


School Assessment Report - 1951_1954_1969 Bldg 501.1_501.2_501.3_503.3

System: D5020 - Lighting

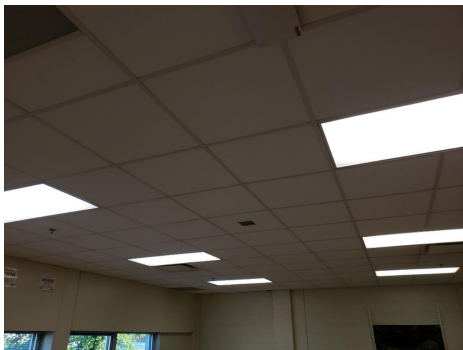




Note:

System: D5030810 - Security & Detection Systems

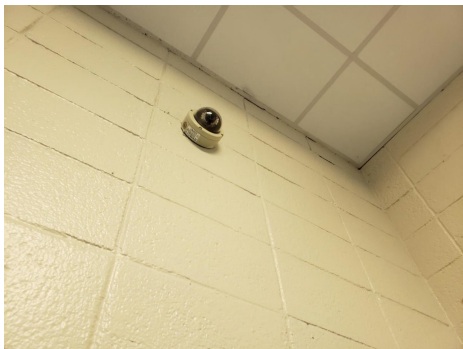

Note:


System: D5030910 - Fire Alarm Systems

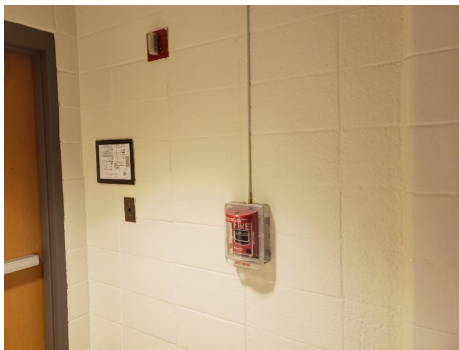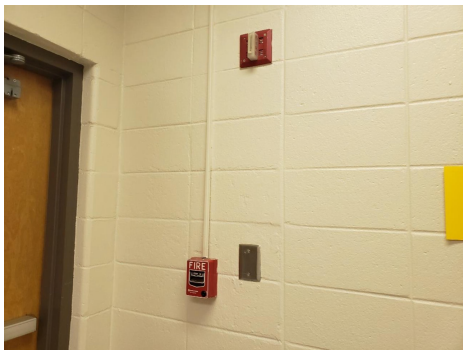

Note:

School Assessment Report - 1951_1954_1969 Bldg 501.1_501.2_501.3_503.3

System: E1020 - Institutional Equipment

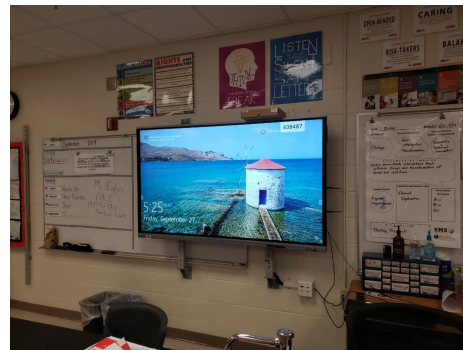

Note:

System: E2010 - Fixed Furnishings



Note:

Renewal Schedule

eCOMET forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the System Listing table. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.

Inflation Rate: 3%

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
Total:	\$55,500	\$0	\$0	\$0	\$0	\$2,478,877	\$25,321	\$1,444,382	\$0	\$0	\$15,909,782	\$19,913,862
* A - Substructure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A10 - Foundations	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
A1010 - Standard Foundations	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
A1030 - Slab on Grade	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A20 - Basement Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
A2010 - Basement Excavation	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
A2020 - Basement Walls	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B - Shell	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B10 - Superstructure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B1010 - Floor Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B1020 - Roof Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B20 - Exterior Enclosure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B2010 - Exterior Walls	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B2020 - Exterior Windows	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B2030 - Exterior Doors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B30 - Roofing	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B3010 - Roof Coverings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B3010105 - Built-Up	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B3020 - Roof Openings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C - Interiors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C10 - Interior Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1010 - Partitions	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1020 - Interior Doors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1030 - Fittings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C20 - Stairs	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0

School Assessment Report - 1951_1954_1969 Bldg 501.1_501.2_501.3_503.3

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
* C2010 - Stair Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C30 - Interior Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3010 - Wall Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3010220 - Tile	\$55,500	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$55,500
C3010230 - Paint & Covering	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$456,797	\$456,797
C3020 - Floor Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020405 - Epoxy	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$125,533	\$0	\$0	\$0	\$125,533
C3020420 - Ceramic Tile	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020430 - Terrazzo	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020901 - Carpet	\$0	\$0	\$0	\$0	\$0	\$28,692	\$0	\$0	\$0	\$0	\$0	\$28,692
C3020903 - VCT	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$1,208,730	\$0	\$0	\$0	\$1,208,730
C3020999 - Other - Wood	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3030 - Ceiling Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D - Services	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D10 - Conveying	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D1010 - Elevators and Lifts	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$427,490	\$427,490
D20 - Plumbing	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2010 - Plumbing Fixtures	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$2,124,786	\$2,124,786
D2020 - Domestic Water Distribution	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2030 - Sanitary Waste	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D30 - HVAC	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3010 - Energy Supply	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3020 - Heat Generating Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$1,203,306	\$1,203,306
D3030 - Cooling Generating Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$2,036,121	\$2,036,121
D3040 - Distribution Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$3,568,752	\$3,568,752
D3050 - Terminal & Package Units	\$0	\$0	\$0	\$0	\$0	\$1,816,469	\$0	\$0	\$0	\$0	\$0	\$1,816,469
D3060 - Controls & Instrumentation	\$0	\$0	\$0	\$0	\$0	\$633,716	\$0	\$0	\$0	\$0	\$0	\$633,716
D40 - Fire Protection	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D4010 - Sprinklers	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D4020 - Standpipes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D4030 - Fire Protection Specialties	\$0	\$0	\$0	\$0	\$0	\$0	\$25,321	\$0	\$0	\$0	\$0	\$25,321
D50 - Electrical	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0


School Assessment Report - 1951_1954_1969 Bldg 501.1_501.2_501.3_503.3

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
D5010 - Electrical Service/Distribution	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$775,816	\$775,816
D5020 - Branch Wiring	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$1,586,464	\$1,586,464
D5020 - Lighting	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$2,384,446	\$2,384,446
D5030 - Communications and Security	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030810 - Security & Detection Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$478,156	\$478,156
D5030910 - Fire Alarm Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$867,647	\$867,647
D5030920 - Data Communication	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5090 - Other Electrical Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$110,119	\$0	\$0	\$0	\$110,119
E - Equipment & Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E10 - Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E1020 - Institutional Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E1090 - Other Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E20 - Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E2010 - Fixed Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0

* Indicates non-renewable system

Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and forecasted capital renewal (sustainment) requirements over the next ten years.

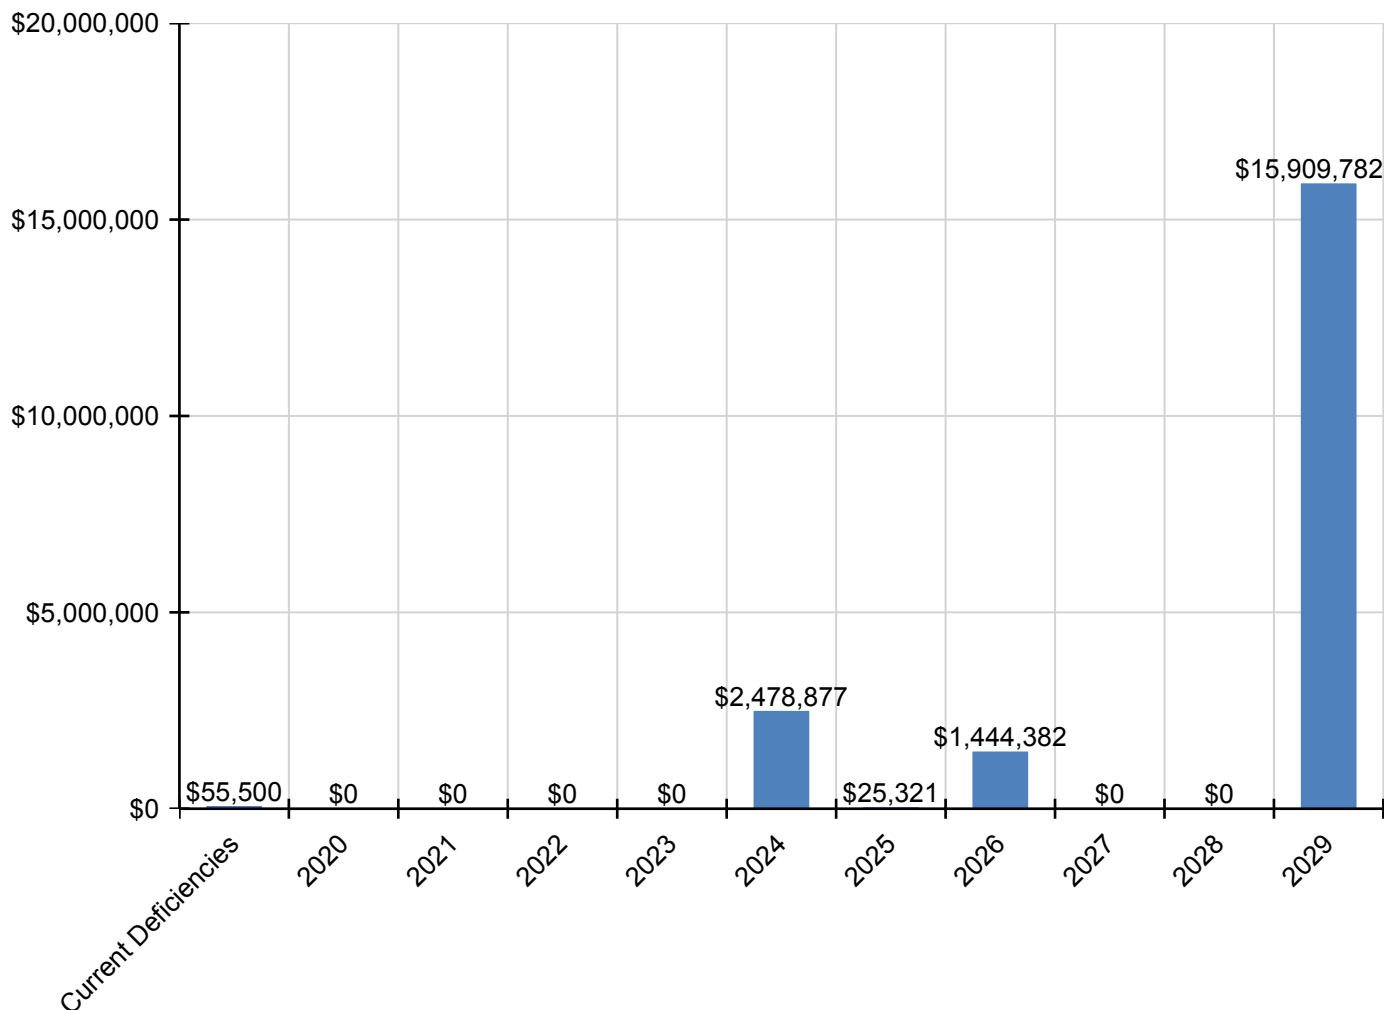


Condition Index Forecast by Investment Scenario

The chart below illustrates the effect of various investment levels on the building FCI for the next 10 years. The levels of investment shown below include:

- Current FCI: a variable investment amount based on renewing expired systems to maintain the current FCI for the building
- 2% Investment: an annual investment of 2% of the replacement value of the building, escalated for inflation
- 4% Investment: an annual investment of 4% of the replacement value of the building, escalated for inflation


Facility Investment vs. FCI Forecast

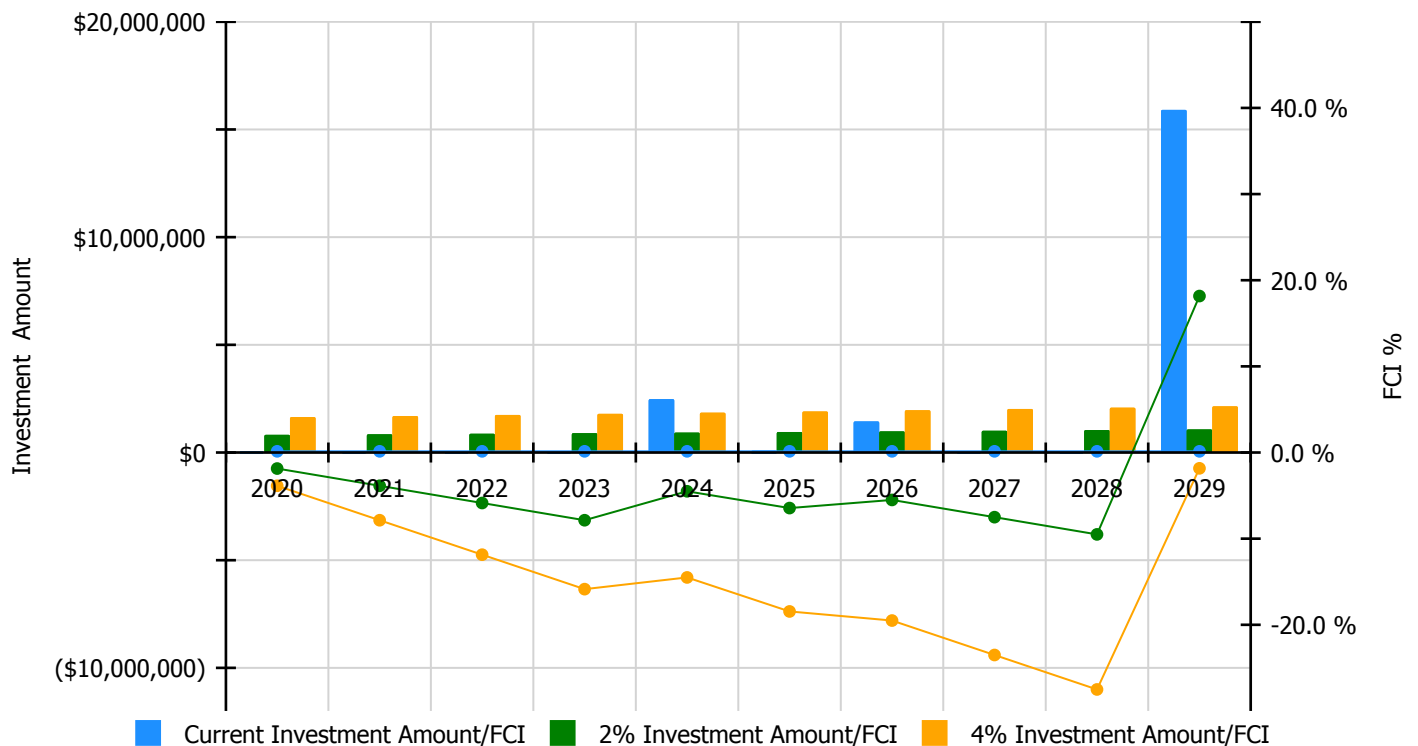

Year	Investment Amount Current FCI - 0.14%	2% Investment		4% Investment	
		Amount	FCI	Amount	FCI
2020	\$0	\$821,945.00	-1.86 %	\$1,643,891.00	-3.86 %
2021	\$0	\$846,604.00	-3.86 %	\$1,693,208.00	-7.86 %
2022	\$0	\$872,002.00	-5.86 %	\$1,744,004.00	-11.86 %
2023	\$0	\$898,162.00	-7.86 %	\$1,796,324.00	-15.86 %
2024	\$2,478,877	\$925,107.00	-4.50 %	\$1,850,214.00	-14.50 %
2025	\$25,321	\$952,860.00	-6.45 %	\$1,905,720.00	-18.45 %
2026	\$1,444,382	\$981,446.00	-5.51 %	\$1,962,892.00	-19.51 %
2027	\$0	\$1,010,889.00	-7.51 %	\$2,021,779.00	-23.51 %
2028	\$0	\$1,041,216.00	-9.51 %	\$2,082,432.00	-27.51 %
2029	\$15,909,782	\$1,072,452.00	18.16 %	\$2,144,905.00	-1.84 %
Total:	\$19,858,362	\$9,422,683.00		\$18,845,369.00	


Deficiency Summary by System

Current deficiencies included assemblies that have reached or exceeded their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Useful Life'. The following chart lists all current deficiencies associated with this facility.

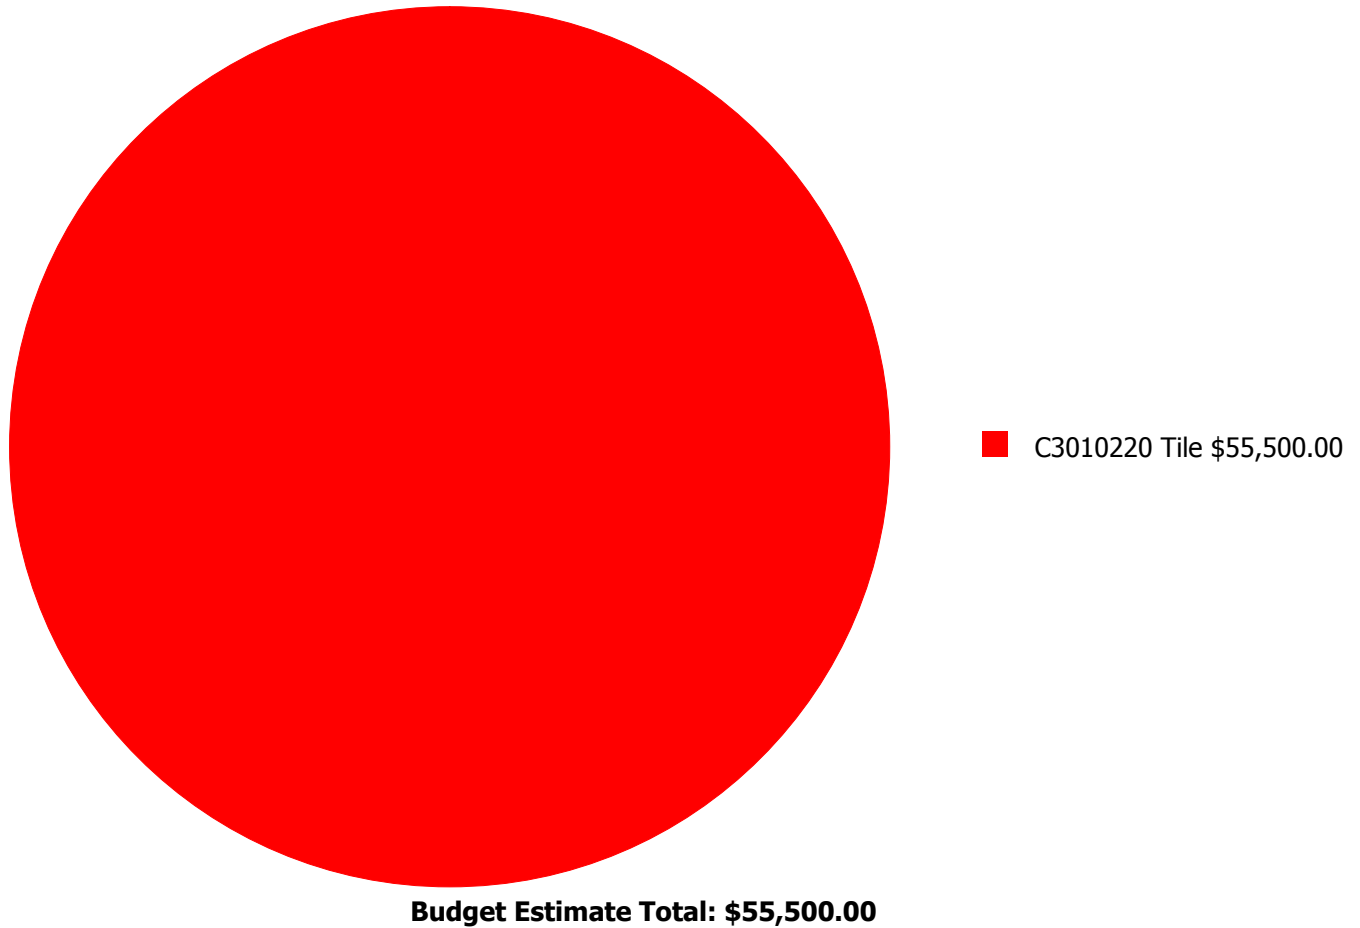

Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

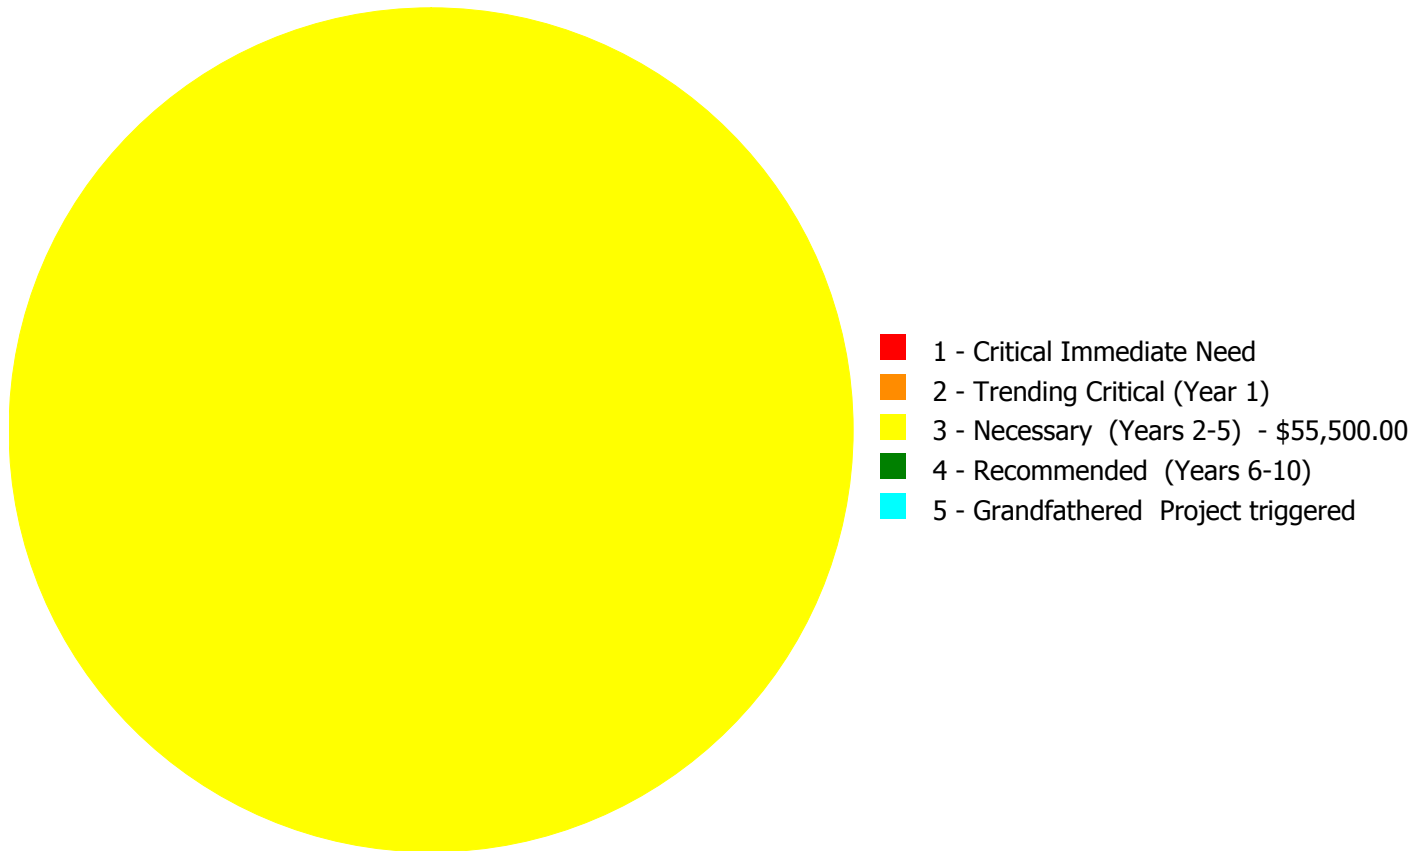

Budget Estimate Total: \$55,500.00


Deficiency By Priority Investment Table

The table below shows the current investment cost grouped by deficiency priority and building system.

System Code	System Description	1 - Critical Immediate Need	2 - Trending Critical (Year 1)	3 - Necessary (Years 2-5)	4 - Recommended (Years 6-10)	5 - Grandfathered Project triggered	Total
C3010220	Tile	\$0.00	\$0.00	\$55,500.00	\$0.00	\$0.00	\$55,500.00
	Total:	\$0.00	\$0.00	\$55,500.00	\$0.00	\$0.00	\$55,500.00

Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

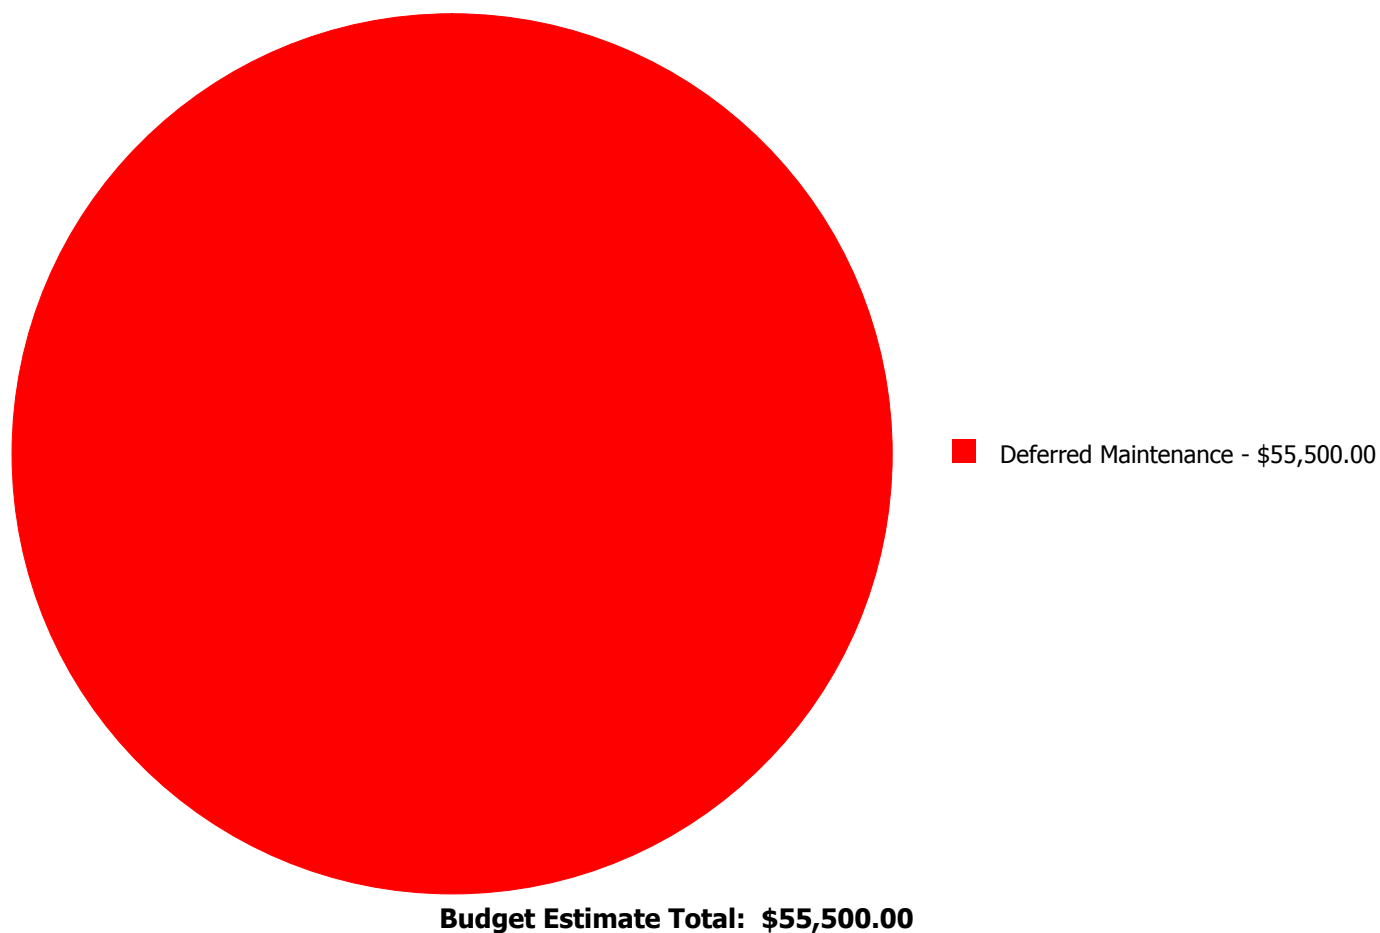

Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

Priority 3 - Necessary (Years 2-5):

System: C3010220 - Tile



Location: Restroom
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 4,000.00
Unit of Measure: S.F.
Estimate: \$55,500.00
Assessor Name: Jejuan Hall
Date Created: 01/27/2020

Notes: The ceramic tile floor finish is beyond its expected service life and should be replaced in conjunction with other recommended renovations.

Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as 100-Total FCI (without the %) where 100 is best and 0 is worst condition.

Function:	Middle
Gross Area (SF):	92,302
Year Built:	1994
Last Renovation:	
Replacement Value:	\$16,963,120
Repair Cost:	\$85,212.00
Total FCI:	0.50 %
Total RSLI:	50.19 %
FCA Score:	99.50



Description:


The narrative for this building is included in the Executive Summary Description at the front of this report.

Attributes: This asset has no attributes.


Dashboard Summary

Function:	Middle	Gross Area:	92,302
Year Built:	1994	Last Renovation:	
Repair Cost:	\$85,212	Replacement Value:	\$16,963,120
FCI:	0.50 %	RSLI%:	50.19 %


Deficiency By Category

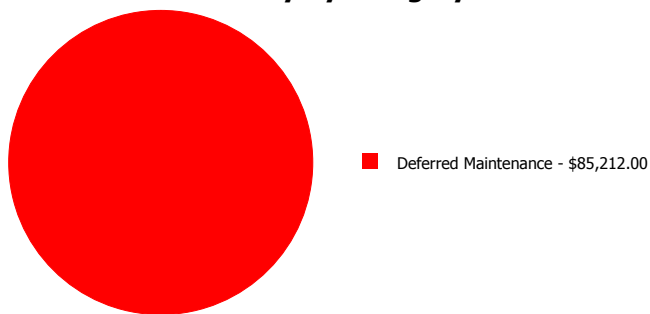


Deficiency By Priority

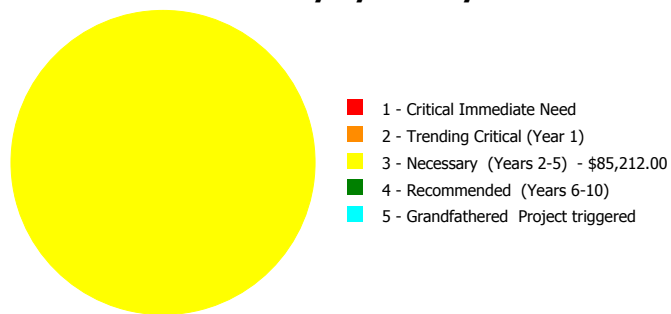

Deficiency By System

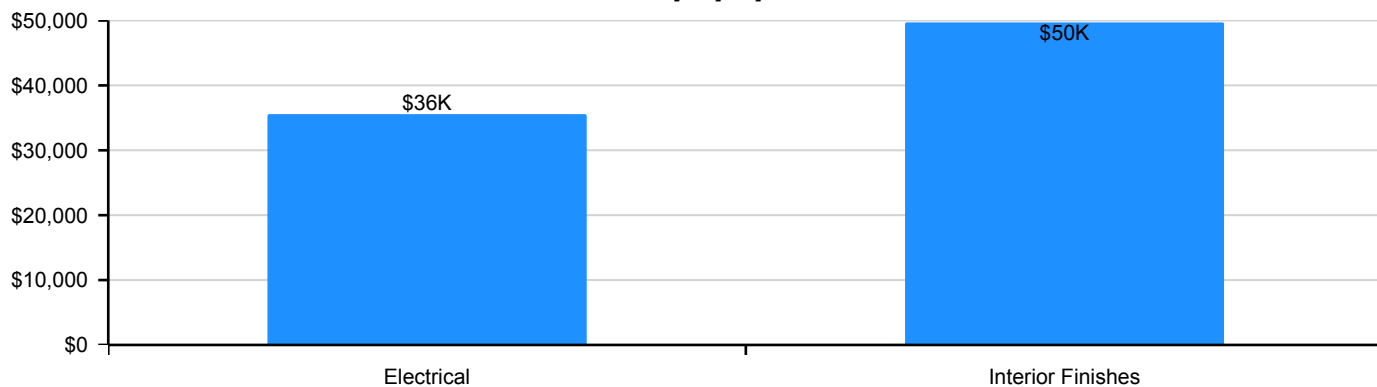

10 Year Investment Forecast

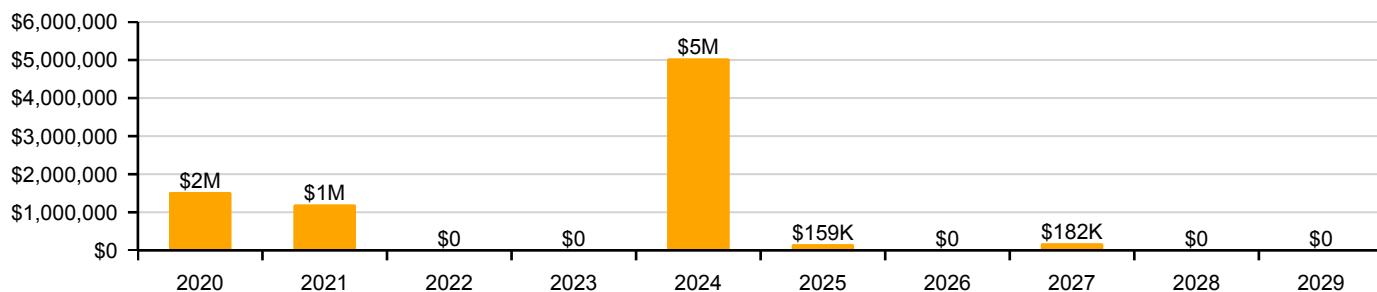

Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

UNIFORMAT Classification	RSLI %	FCI %	Current Repair Cost
A10 - Foundations	75.00 %	0.00 %	\$0.00
A20 - Basement Construction	75.00 %	0.00 %	\$0.00
B10 - Superstructure	75.00 %	0.00 %	\$0.00
B20 - Exterior Enclosure	74.32 %	0.00 %	\$0.00
B30 - Roofing	22.71 %	0.00 %	\$0.00
C10 - Interior Construction	73.17 %	0.00 %	\$0.00
C20 - Stairs	75.00 %	0.00 %	\$0.00
C30 - Interior Finishes	46.03 %	1.90 %	\$49,676.00
D10 - Conveying	10.00 %	0.00 %	\$0.00
D20 - Plumbing	12.48 %	0.00 %	\$0.00
D30 - HVAC	27.30 %	0.00 %	\$0.00
D40 - Fire Protection	17.13 %	0.00 %	\$0.00
D50 - Electrical	25.39 %	1.72 %	\$35,536.00
E10 - Equipment	60.00 %	0.00 %	\$0.00
E20 - Furnishings	60.00 %	0.00 %	\$0.00
Totals:	50.19 %	0.50 %	\$85,212.00

Photo Album

The photo album consists of the various cardinal compass directions of the building..

1). North Elevation - Nov 25, 2019



2). South Elevation - Nov 25, 2019



3). West Elevation - Nov 20, 2019



4). North Elevation - Nov 20, 2019



5). South Elevation - Nov 20, 2019



6). Northwest Elevation - Nov 20, 2019



Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment)
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system as new construction.

System Listing

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
A1010	Standard Foundations	\$6.22	S.F.	92,302	100	1994	2094		75.00 %	0.00 %	75			\$574,118
A1030	Slab on Grade	\$6.25	S.F.	92,302	100	1994	2094		75.00 %	0.00 %	75			\$576,888
A2010	Basement Excavation	\$0.16	S.F.	92,302	100	1994	2094		75.00 %	0.00 %	75			\$14,768
A2020	Basement Walls	\$2.37	S.F.	92,302	100	1994	2094		75.00 %	0.00 %	75			\$218,756
B1010	Floor Construction	\$16.26	S.F.	92,302	100	1994	2094		75.00 %	0.00 %	75			\$1,500,831
B1020	Roof Construction	\$12.17	S.F.	92,302	100	1994	2094		75.00 %	0.00 %	75			\$1,123,315
B2010	Exterior Walls	\$13.82	S.F.	92,302	100	1994	2094		75.00 %	0.00 %	75			\$1,275,614
B2020	Exterior Windows	\$8.63	S.F.	92,302	30	2011	2041		73.33 %	0.00 %	22			\$796,566
B2030	Exterior Doors	\$0.82	S.F.	92,302	30	2011	2041		73.33 %	0.00 %	22			\$75,688
B3010105	Built-Up	\$7.15	S.F.	46,000	25	2006	2031	2024	20.00 %	0.00 %	5			\$328,900
B3020	Roof Openings	\$0.52	S.F.	46,000	30	2007	2037		60.00 %	0.00 %	18			\$23,920
C1010	Partitions	\$5.58	S.F.	92,302	100	1994	2094		75.00 %	0.00 %	75			\$515,045
C1020	Interior Doors	\$3.65	S.F.	92,302	40	2011	2051		80.00 %	0.00 %	32			\$336,902
C1030	Fittings	\$2.67	S.F.	92,302	20	2011	2031		60.00 %	0.00 %	12			\$246,446
C2010	Stair Construction	\$2.85	S.F.	92,302	100	1994	2094		75.00 %	0.00 %	75			\$263,061
C3010220	Tile	\$9.25	S.F.	4,000	30	1994	2024		16.67 %	0.00 %	5			\$37,000
C3010230	Paint & Covering	\$1.47	S.F.	58,302	8	1994	2002		0.00 %	0.00 %	-17			\$85,704
C3010902	Wood Paneling	\$6.66	S.F.	15,000	15	1994	2009	2025	40.00 %	0.00 %	6			\$99,900
C3010903	Other - Natural Stone	\$56.49	S.F.	15,000	50	1994	2044		50.00 %	0.00 %	25			\$847,350
C3020405	Epoxy	\$17.30	S.F.	2,000	15	2003	2018	2020	6.67 %	0.00 %	1			\$34,600
C3020420	Ceramic Tile	\$16.74	S.F.	5,000	50	1994	2044		50.00 %	0.00 %	25			\$83,700
C3020430	Terrazzo	\$21.62	S.F.	15,000	50	1994	2044		50.00 %	0.00 %	25			\$324,300
C3020901	Carpet	\$11.29	S.F.	4,000	8	1994	2002		0.00 %	110.00 %	-17		\$49,676.00	\$45,160
C3020903	VCT	\$3.48	S.F.	66,302	15	2005	2020	2021	13.33 %	0.00 %	2			\$230,731
C3030	Ceiling Finishes	\$9.02	S.F.	92,302	20	2011	2031		60.00 %	0.00 %	12			\$832,564
D1010	Elevators and Lifts	\$1.25	S.F.	92,302	20	1994	2014	2021	10.00 %	0.00 %	2			\$115,378
D2010	Plumbing Fixtures	\$6.39	S.F.	92,302	20	1994	2014	2021	10.00 %	0.00 %	2			\$589,810
D2020	Domestic Water Distribution	\$0.75	S.F.	92,302	30	1994	2024		16.67 %	0.00 %	5			\$69,227
D2030	Sanitary Waste	\$1.69	S.F.	92,302	30	1994	2024		16.67 %	0.00 %	5			\$155,990
D2040	Rain Water Drainage	\$0.45	S.F.	92,302	20	1994	2014	2024	25.00 %	0.00 %	5			\$41,536
D3010	Energy Supply	\$0.61	S.F.	92,302	30	1994	2024		16.67 %	0.00 %	5			\$56,304
D3020	Heat Generating Systems	\$3.60	S.F.	92,302	20	1994	2014	2024	25.00 %	0.00 %	5			\$332,287

School Assessment Report - 1994 Bldg 501.4

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
D3030	Cooling Generating Systems	\$6.08	S.F.	92,302	20	1994	2014	2024	25.00 %	0.00 %	5			\$561,196
D3040	Distribution Systems	\$10.69	S.F.	92,302	20	1994	2014	2024	25.00 %	0.00 %	5			\$986,708
D3050	Terminal & Package Units	\$6.65	S.F.	92,302	15	1994	2009	2024	33.33 %	0.00 %	5			\$613,808
D3060	Controls & Instrumentation	\$2.20	S.F.	92,302	15	1994	2009	2024	33.33 %	0.00 %	5			\$203,064
D4010	Sprinklers	\$4.11	S.F.	92,302	30	1994	2024		16.67 %	0.00 %	5			\$379,361
D4020	Standpipes	\$0.34	S.F.	92,302	30	1994	2024		16.67 %	0.00 %	5			\$31,383
D4030	Fire Protection Specialties	\$0.09	S.F.	92,302	15	1994	2009	2025	40.00 %	0.00 %	6			\$8,307
D5010	Electrical Service/Distribution	\$2.34	S.F.	92,302	20	1994	2014	2020	5.00 %	0.00 %	1			\$215,987
D5020	Branch Wiring	\$4.75	S.F.	92,302	20	1994	2014	2020	5.00 %	0.00 %	1			\$438,435
D5020	Lighting	\$7.13	S.F.	92,302	20	1994	2014	2020	5.00 %	0.00 %	1			\$658,113
D5030810	Security & Detection Systems	\$1.51	S.F.	92,302	20	2011	2031		60.00 %	0.00 %	12			\$139,376
D5030910	Fire Alarm Systems	\$2.74	S.F.	92,302	20	2011	2031		60.00 %	0.00 %	12			\$252,907
D5030920	Data Communication	\$3.56	S.F.	92,302	25	2011	2036		68.00 %	0.00 %	17			\$328,595
D5090	Other Electrical Systems	\$0.35	S.F.	92,302	15	1994	2009		0.00 %	110.00 %	-10		\$35,536.00	\$32,306
E1020	Institutional Equipment	\$0.12	S.F.	92,302	20	2011	2031		60.00 %	0.00 %	12			\$11,076
E1090	Other Equipment	\$0.78	S.F.	92,302	20	2011	2031		60.00 %	0.00 %	12			\$71,996
E2010	Fixed Furnishings	\$1.93	S.F.	92,302	20	2011	2031		60.00 %	0.00 %	12			\$178,143
Total									50.19 %	0.50 %			\$85,212.00	\$16,963,120

System Notes

The facility description in the executive summary contains an overview of each system. The system notes listed below provide additional information on select systems found within the facility.

System: B2010 - Exterior Walls



Note:

System: B2020 - Exterior Windows



Note:

System: B2030 - Exterior Doors



Note:


School Assessment Report - 1994 Bldg 501.4

System: B3010105 - Built-Up



Note:

System: B3020 - Roof Openings

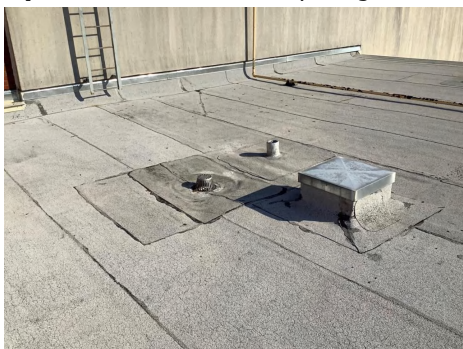

Note:


System: C1010 - Partitions



Note:



School Assessment Report - 1994 Bldg 501.4

System: C1020 - Interior Doors





Note:

System: C1030 - Fittings

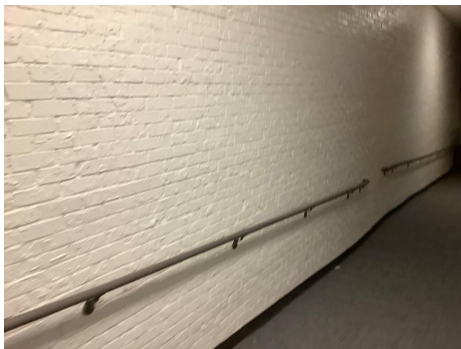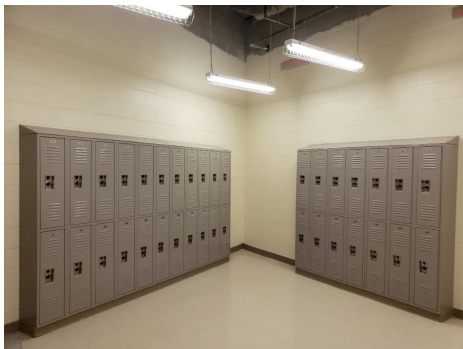

Note:


System: C2010 - Stair Construction

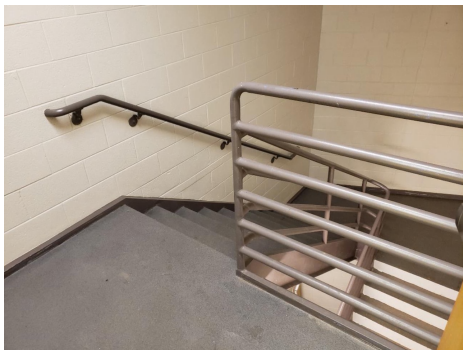

Note:


School Assessment Report - 1994 Bldg 501.4

System: C3010220 - Tile

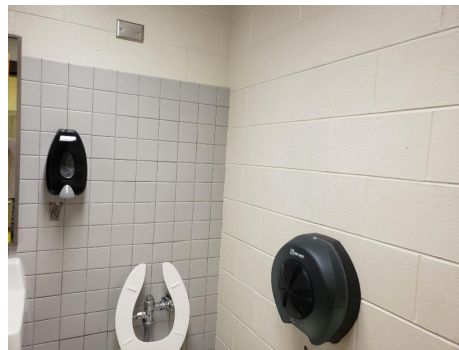

Note:

System: C3010230 - Paint & Covering

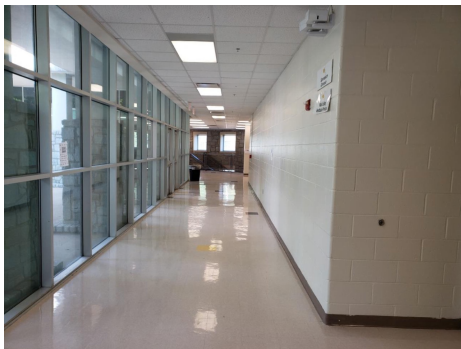

Note:


System: C3010902 - Wood Paneling



Note:


School Assessment Report - 1994 Bldg 501.4

System: C3010903 - Other - Natural Stone

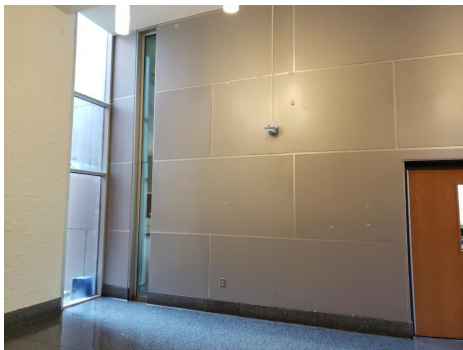

Note:

System: C3020405 - Epoxy

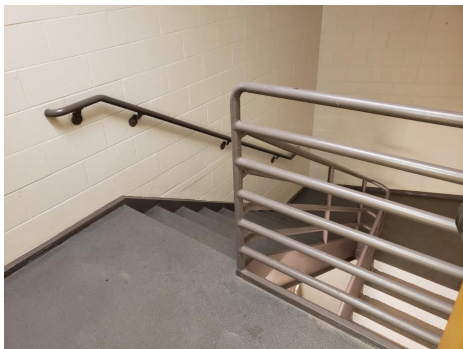

Note:




System: C3020420 - Ceramic Tile



Note:

School Assessment Report - 1994 Bldg 501.4

System: C3020430 - Terrazzo



Note:

System: C3020901 - Carpet



Note:

System: C3020903 - VCT



Note:


School Assessment Report - 1994 Bldg 501.4

System: C3030 - Ceiling Finishes



Note:

System: D2010 - Plumbing Fixtures

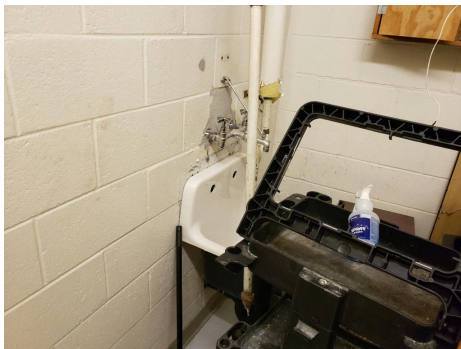

Note:

System: D2020 - Domestic Water Distribution



Note:

School Assessment Report - 1994 Bldg 501.4

System: D2030 - Sanitary Waste



Note:

System: D2040 - Rain Water Drainage



Note:

System: D3020 - Heat Generating Systems



Note:

School Assessment Report - 1994 Bldg 501.4

System: D3030 - Cooling Generating Systems



Note:

System: D3040 - Distribution Systems



Note:

System: D3050 - Terminal & Package Units



Note:

School Assessment Report - 1994 Bldg 501.4

System: D3060 - Controls & Instrumentation



Note:

System: D4010 - Sprinklers



Note:

System: D4020 - Standpipes



Note:

School Assessment Report - 1994 Bldg 501.4

System: D5010 - Electrical Service/Distribution



Note:

System: D5020 - Lighting



Note:

System: D5030910 - Fire Alarm Systems



Note:

School Assessment Report - 1994 Bldg 501.4

System: E1020 - Institutional Equipment



Note:

System: E2010 - Fixed Furnishings



Note:

Renewal Schedule

eCOMET forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the System Listing table. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.

Inflation Rate: 3%

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
Total:	\$85,212	\$1,529,154	\$1,202,359	\$0	\$0	\$5,038,001	\$158,826	\$0	\$182,352	\$0	\$0	\$8,195,904
* A - Substructure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A10 - Foundations	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A1010 - Standard Foundations	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A1030 - Slab on Grade	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A20 - Basement Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A2010 - Basement Excavation	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A2020 - Basement Walls	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B - Shell	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B10 - Superstructure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B1010 - Floor Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B1020 - Roof Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B20 - Exterior Enclosure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B2010 - Exterior Walls	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B2020 - Exterior Windows	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B2030 - Exterior Doors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B30 - Roofing	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B3010 - Roof Coverings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B3010105 - Built-Up	\$0	\$0	\$0	\$0	\$0	\$598,618	\$0	\$0	\$0	\$0	\$0	\$598,618
B3020 - Roof Openings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C - Interiors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C10 - Interior Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1010 - Partitions	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1020 - Interior Doors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1030 - Fittings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C20 - Stairs	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0

School Assessment Report - 1994 Bldg 501.4

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
* C2010 - Stair Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C30 - Interior Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3010 - Wall Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3010220 - Tile	\$0	\$0	\$0	\$0	\$0	\$64,340	\$0	\$0	\$0	\$0	\$0	\$64,340
C3010230 - Paint & Covering	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$119,423	\$0	\$0	\$119,423
C3010902 - Wood Paneling	\$0	\$0	\$0	\$0	\$0	\$0	\$147,914	\$0	\$0	\$0	\$0	\$147,914
C3010903 - Other - Natural Stone	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020 - Floor Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020405 - Epoxy	\$0	\$42,053	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$42,053
C3020420 - Ceramic Tile	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020430 - Terrazzo	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020901 - Carpet	\$49,676	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$62,928	\$0	\$0	\$112,604
C3020903 - VCT	\$0	\$0	\$379,413	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$379,413
C3030 - Ceiling Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D - Services	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D10 - Conveying	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D1010 - Elevators and Lifts	\$0	\$0	\$134,644	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$134,644
D20 - Plumbing	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2010 - Plumbing Fixtures	\$0	\$0	\$688,302	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$688,302
D2020 - Domestic Water Distribution	\$0	\$0	\$0	\$0	\$0	\$88,278	\$0	\$0	\$0	\$0	\$0	\$88,278
D2030 - Sanitary Waste	\$0	\$0	\$0	\$0	\$0	\$198,919	\$0	\$0	\$0	\$0	\$0	\$198,919
D2040 - Rain Water Drainage	\$0	\$0	\$0	\$0	\$0	\$52,966	\$0	\$0	\$0	\$0	\$0	\$52,966
D30 - HVAC	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3010 - Energy Supply	\$0	\$0	\$0	\$0	\$0	\$71,800	\$0	\$0	\$0	\$0	\$0	\$71,800
D3020 - Heat Generating Systems	\$0	\$0	\$0	\$0	\$0	\$423,733	\$0	\$0	\$0	\$0	\$0	\$423,733
D3030 - Cooling Generating Systems	\$0	\$0	\$0	\$0	\$0	\$715,638	\$0	\$0	\$0	\$0	\$0	\$715,638
D3040 - Distribution Systems	\$0	\$0	\$0	\$0	\$0	\$1,258,252	\$0	\$0	\$0	\$0	\$0	\$1,258,252
D3050 - Terminal & Package Units	\$0	\$0	\$0	\$0	\$0	\$782,729	\$0	\$0	\$0	\$0	\$0	\$782,729
D3060 - Controls & Instrumentation	\$0	\$0	\$0	\$0	\$0	\$258,948	\$0	\$0	\$0	\$0	\$0	\$258,948
D40 - Fire Protection	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D4010 - Sprinklers	\$0	\$0	\$0	\$0	\$0	\$483,762	\$0	\$0	\$0	\$0	\$0	\$483,762
D4020 - Standpipes	\$0	\$0	\$0	\$0	\$0	\$40,019	\$0	\$0	\$0	\$0	\$0	\$40,019


School Assessment Report - 1994 Bldg 501.4

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
D4030 - Fire Protection Specialties	\$0	\$0	\$0	\$0	\$0	\$0	\$10,911	\$0	\$0	\$0	\$0	\$10,911
D50 - Electrical	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5010 - Electrical Service/Distribution	\$0	\$244,713	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$244,713
D5020 - Branch Wiring	\$0	\$496,746	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$496,746
D5020 - Lighting	\$0	\$745,643	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$745,643
D5030 - Communications and Security	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030810 - Security & Detection Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030910 - Fire Alarm Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5030920 - Data Communication	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D5090 - Other Electrical Systems	\$35,536	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$35,536
E - Equipment & Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E10 - Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E1020 - Institutional Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E1090 - Other Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E20 - Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E2010 - Fixed Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0

* Indicates non-renewable system

Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and forecasted capital renewal (sustainment) requirements over the next ten years.

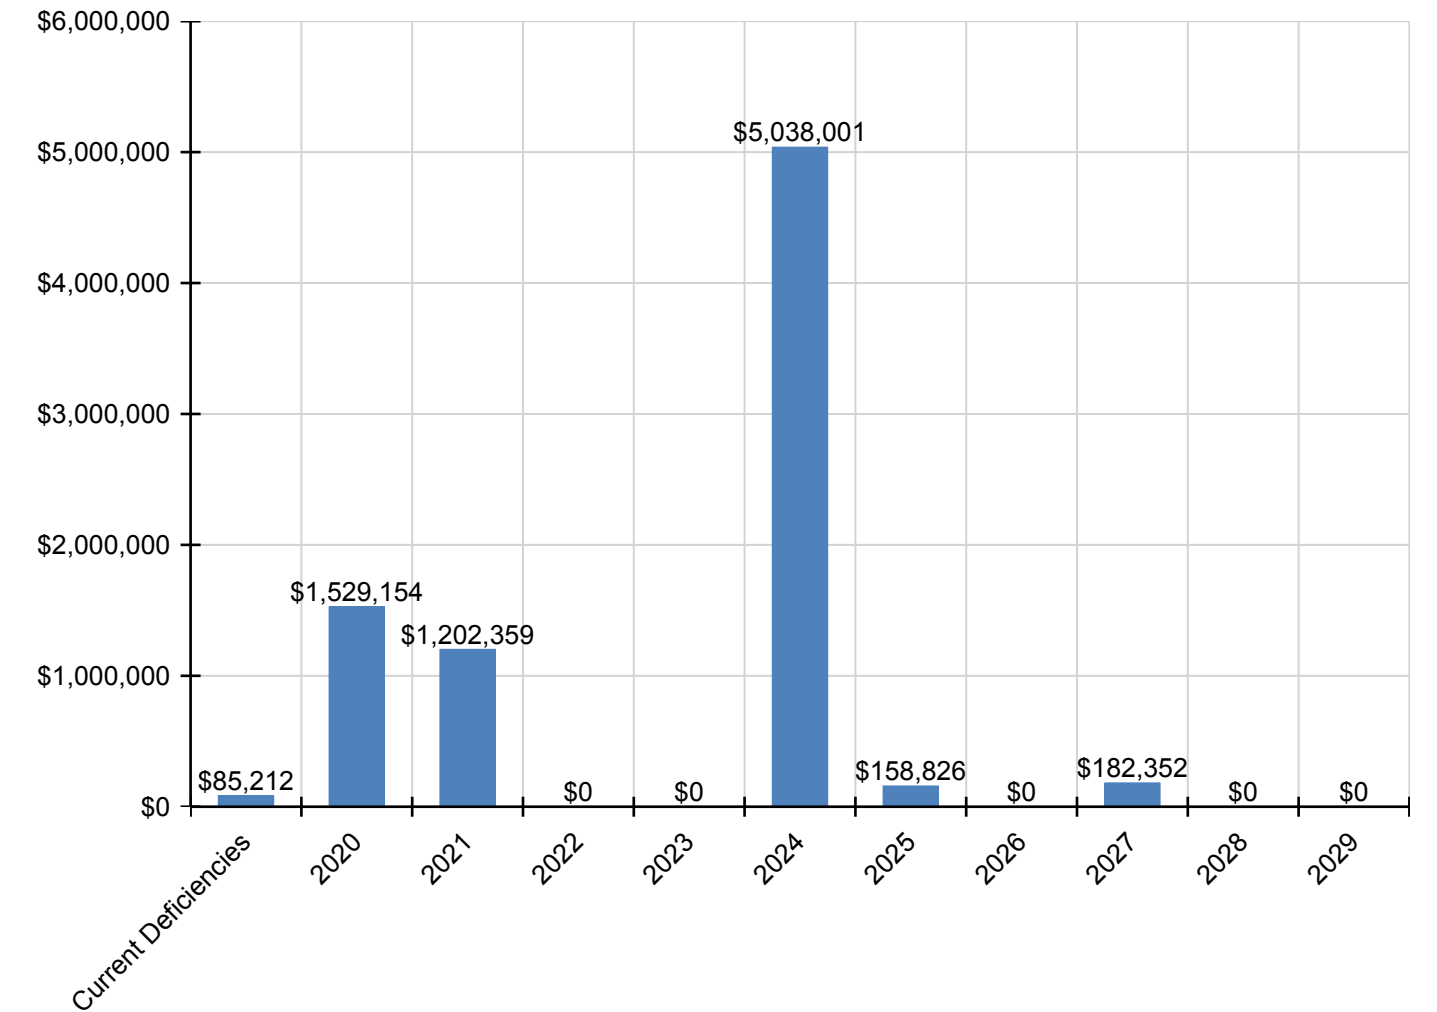


Condition Index Forecast by Investment Scenario

The chart below illustrates the effect of various investment levels on the building FCI for the next 10 years. The levels of investment shown below include:

- Current FCI: a variable investment amount based on renewing expired systems to maintain the current FCI for the building
- 2% Investment: an annual investment of 2% of the replacement value of the building, escalated for inflation
- 4% Investment: an annual investment of 4% of the replacement value of the building, escalated for inflation


Facility Investment vs. FCI Forecast

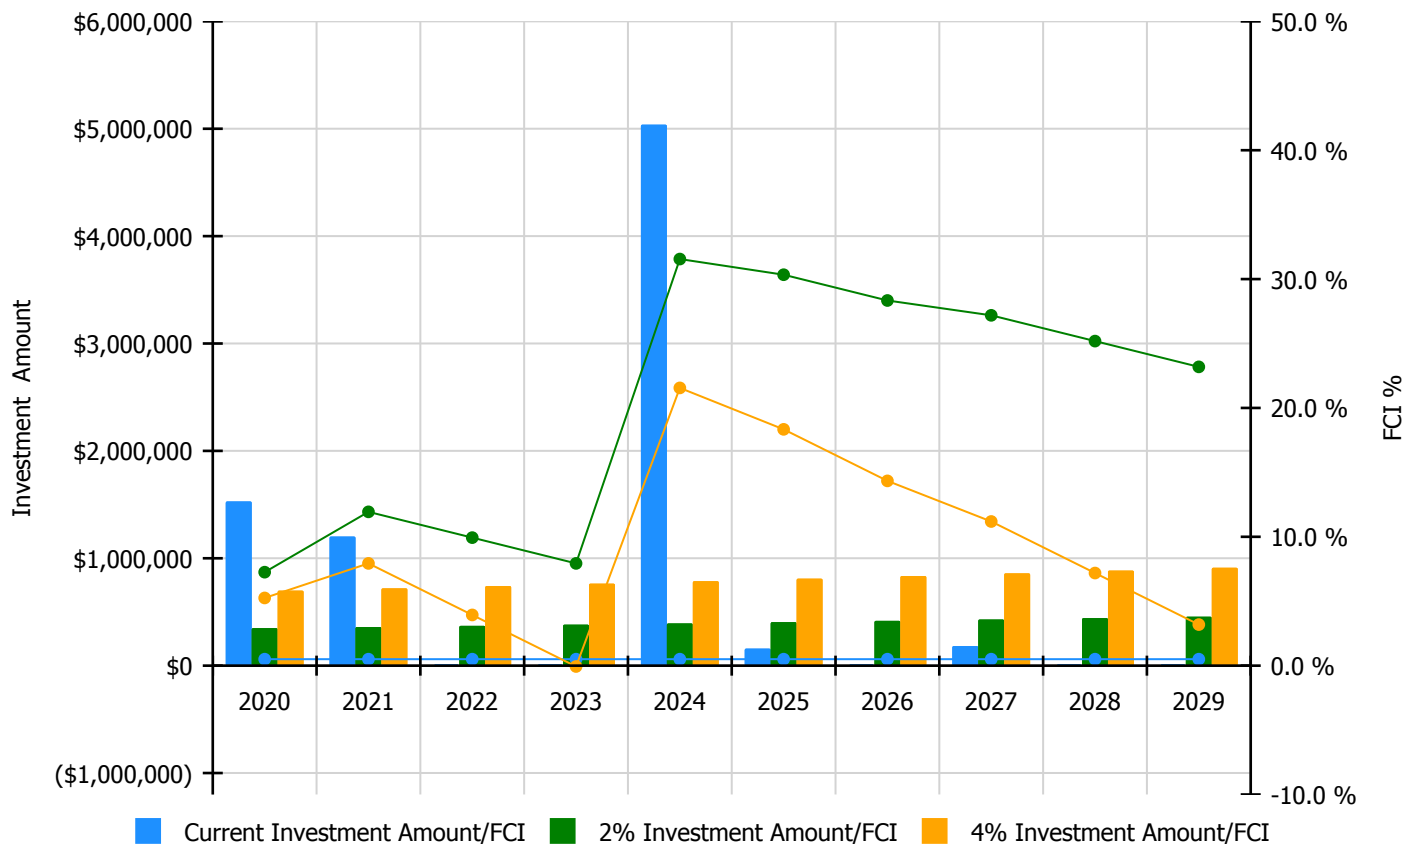

Year	Investment Amount Current FCI - 0.5%	2% Investment		4% Investment	
		Amount	FCI	Amount	FCI
2020	\$1,529,154	\$349,440.00	7.25 %	\$698,881.00	5.25 %
2021	\$1,202,359	\$359,923.00	11.94 %	\$719,847.00	7.94 %
2022	\$0	\$370,721.00	9.94 %	\$741,442.00	3.94 %
2023	\$0	\$381,843.00	7.94 %	\$763,686.00	-0.06 %
2024	\$5,038,001	\$393,298.00	31.55 %	\$786,596.00	21.55 %
2025	\$158,826	\$405,097.00	30.34 %	\$810,194.00	18.34 %
2026	\$0	\$417,250.00	28.34 %	\$834,500.00	14.34 %
2027	\$182,352	\$429,767.00	27.19 %	\$859,535.00	11.19 %
2028	\$0	\$442,660.00	25.19 %	\$885,321.00	7.19 %
2029	\$0	\$455,940.00	23.19 %	\$911,881.00	3.19 %
Total:	\$8,110,692	\$4,005,939.00		\$8,011,883.00	

Deficiency Summary by System


Current deficiencies included assemblies that have reached or exceeded their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Useful Life'. The following chart lists all current deficiencies associated with this facility.

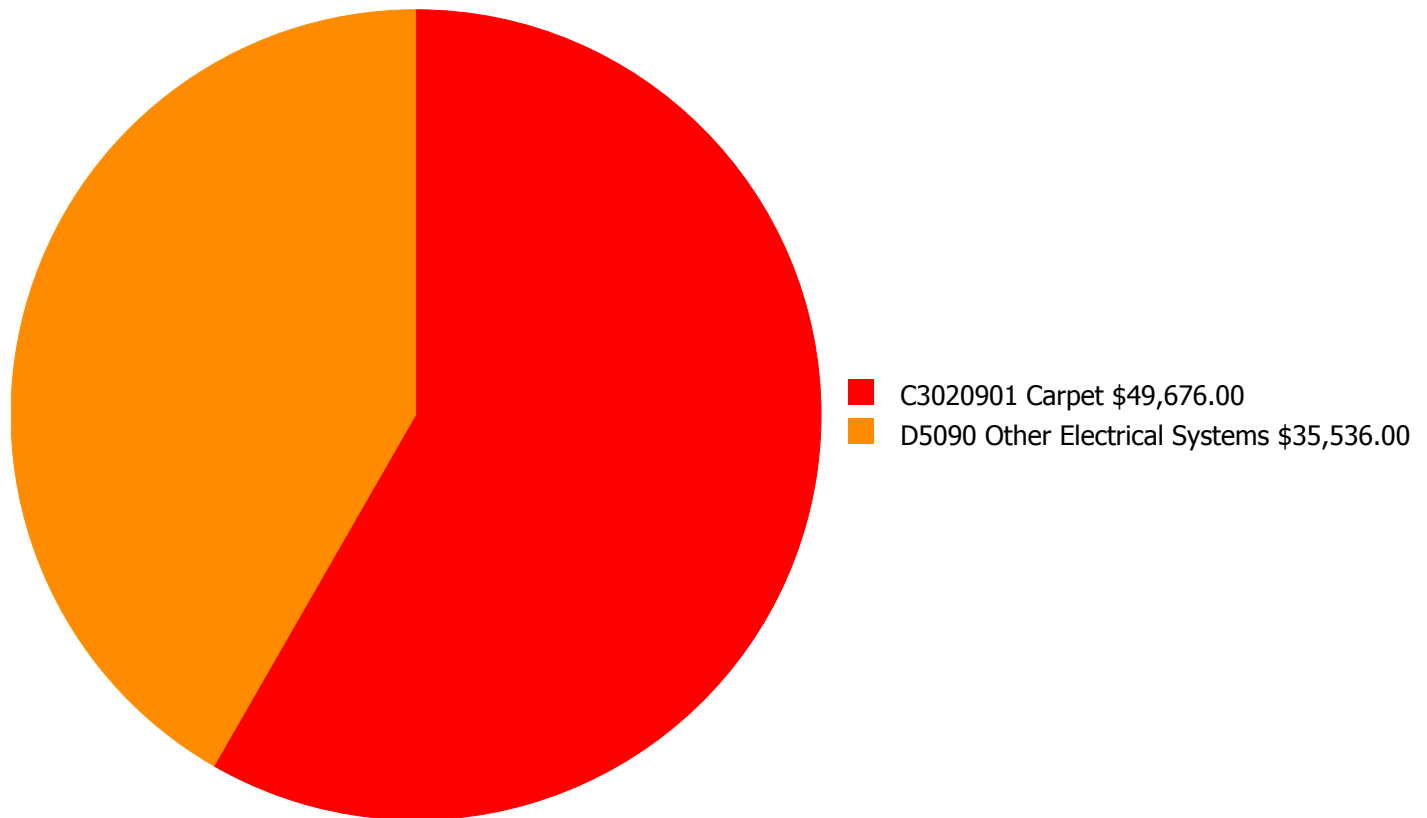

Budget Estimate Total: \$85,212.00

Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

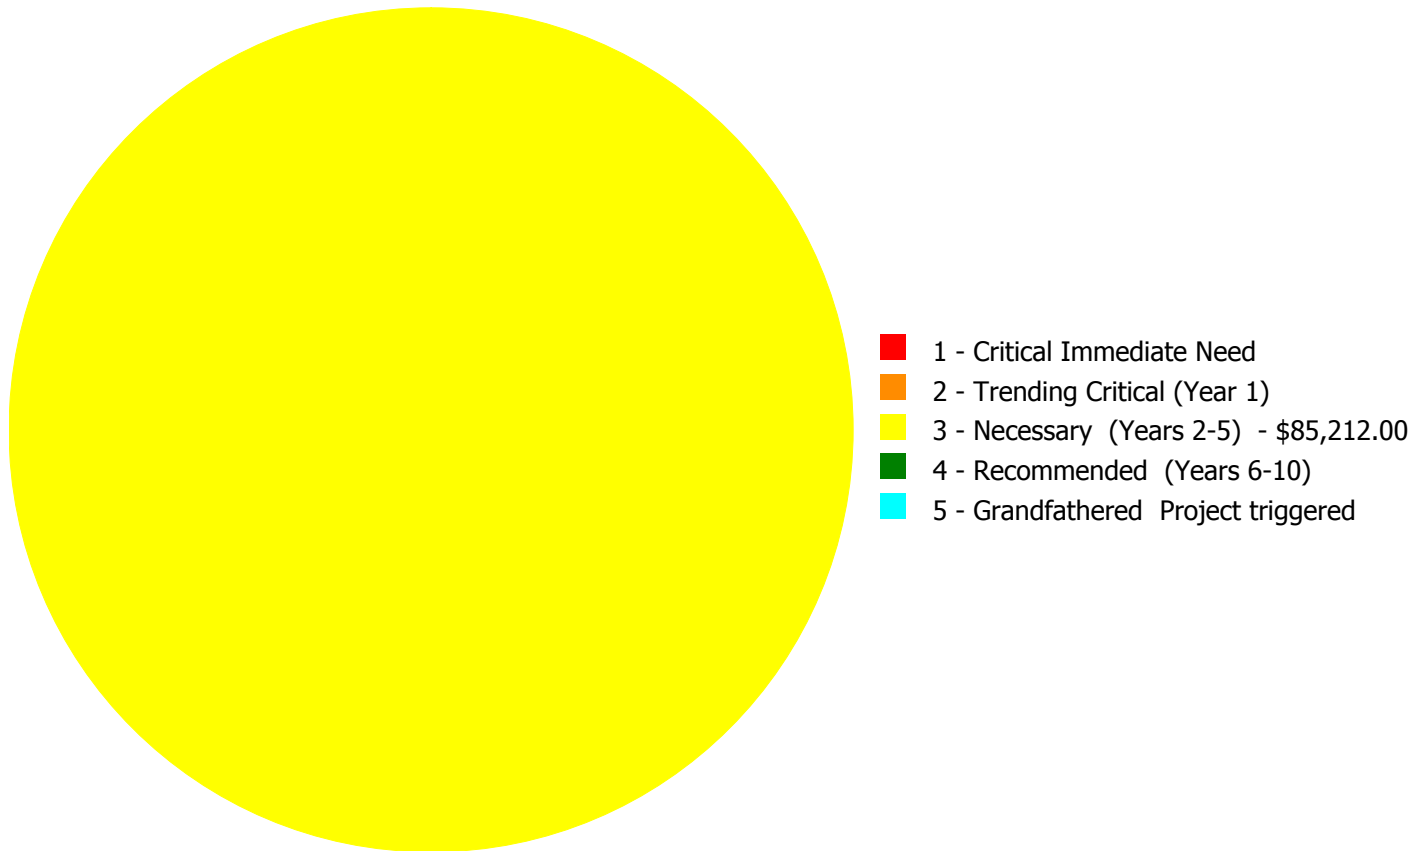

Budget Estimate Total: \$85,212.00


Deficiency By Priority Investment Table

The table below shows the current investment cost grouped by deficiency priority and building system.

System Code	System Description	1 - Critical Immediate Need	2 - Trending Critical (Year 1)	3 - Necessary (Years 2-5)	4 - Recommended (Years 6-10)	5 - Grandfathered Project triggered	Total
C3020901	Carpet	\$0.00	\$0.00	\$49,676.00	\$0.00	\$0.00	\$49,676.00
D5090	Other Electrical Systems	\$0.00	\$0.00	\$35,536.00	\$0.00	\$0.00	\$35,536.00
	Total:	\$0.00	\$0.00	\$85,212.00	\$0.00	\$0.00	\$85,212.00

Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

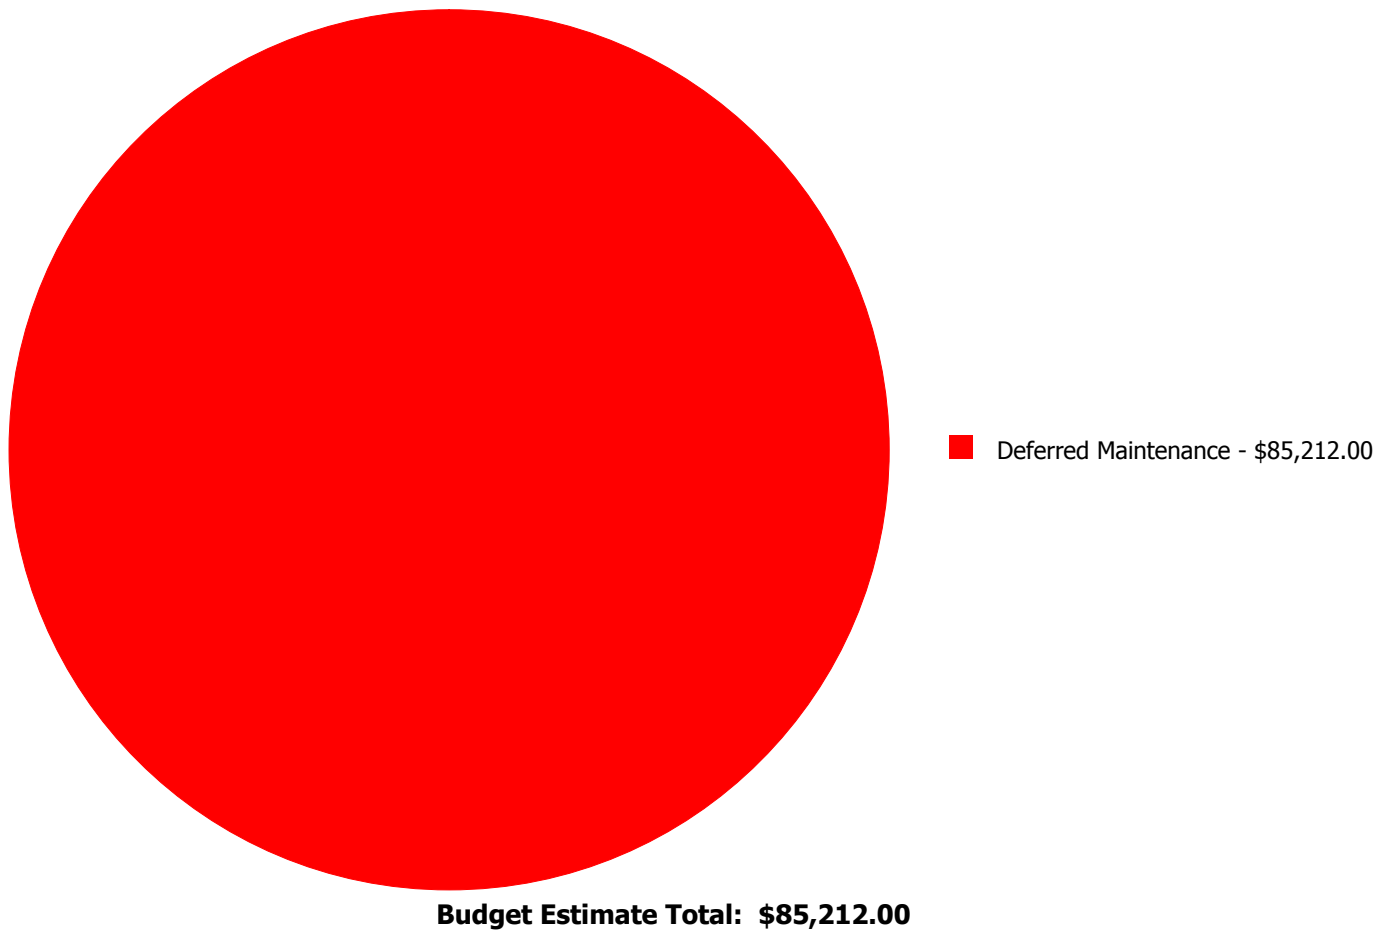

Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

Priority 3 - Necessary (Years 2-5):

System: C3020901 - Carpet



Location: Media Center
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 4,000.00
Unit of Measure: S.F.
Estimate: \$49,676.00
Assessor Name: Homero Guerrero
Date Created: 01/27/2020

Notes: The carpet floor finish is beyond its expected service life, faded and stained, and should be replaced.

System: D5090 - Other Electrical Systems

This deficiency has no image.

Location: Site
Distress: Beyond Expected Life
Category: Deferred Maintenance
Priority: 3 - Necessary (Years 2-5)
Correction: Renew System
Qty: 92,302.00
Unit of Measure: S.F.
Estimate: \$35,536.00
Assessor Name: Homero Guerrero
Date Created: 08/22/2013

Notes: There are no emergency generators and this project provides a budgetary consideration for the addition of an emergency power.

Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as $100 - \text{Total FCI}$ (without the %) where 100 is best and 0 is worst condition.

Function:

Gross Area (SF): 306,506

Year Built: 1951

Last Renovation:

Replacement Value: \$12,499,316

Repair Cost: \$0.00

Total FCI: 0.00 %

Total RSLI: 65.09 %

FCA Score: 100.00



Description:

The narrative for this site is included in the Executive Summary Description at the front of this report.

Attributes: This asset has no attributes.

Dashboard Summary


Function:		Gross Area:	306,506
Year Built:	1951	Last Renovation:	
Repair Cost:	\$0	Replacement Value:	\$12,499,316
FCI:	0.00 %	RSLI%:	65.09 %

No data found for this asset

No data found for this asset

No data found for this asset

10 Year Investment Forecast

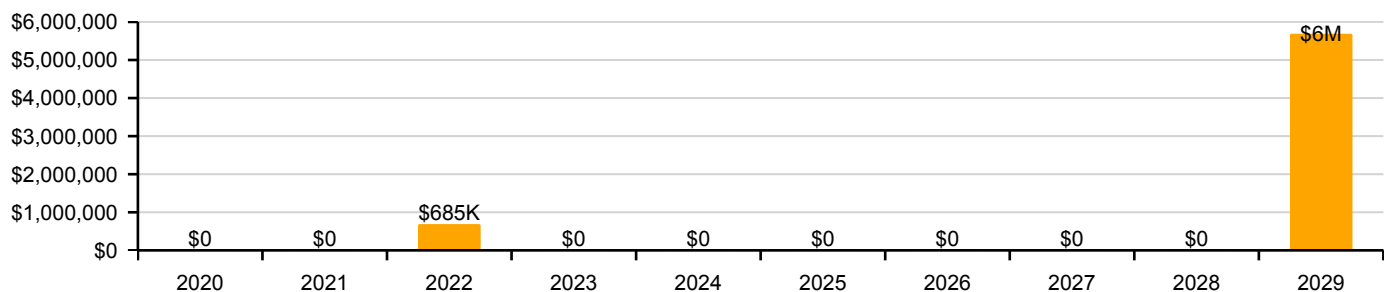

Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

UNIFORMAT Classification	RSLI %	FCI %	Current Repair Cost
G20 - Site Improvements	60.26 %	0.00 %	\$0.00
G30 - Site Mechanical Utilities	84.00 %	0.00 %	\$0.00
G40 - Site Electrical Utilities	73.33 %	0.00 %	\$0.00
Totals:	65.09 %	0.00 %	\$0.00

Photo Album

The photo album consists of the various cardinal compass directions of the building..



Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment)
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system as new construction.

System Listing

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.


System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
G2010	Roadways	\$2.37	S.F.	306,506	35	2011	2046		77.14 %	0.00 %	27			\$726,419
G2020	Parking Lots	\$8.00	S.F.	306,506	35	2009	2044		71.43 %	0.00 %	25			\$2,452,048
G2030	Pedestrian Paving	\$2.33	S.F.	306,506	35	2011	2046		77.14 %	0.00 %	27			\$714,159
G2040105	Fence & Guardrails	\$1.14	S.F.	306,506	30	2009	2039		66.67 %	0.00 %	20			\$349,417
G2040950	Baseball Field	\$6.68	S.F.	306,506	20	2009	2029		50.00 %	0.00 %	10			\$2,047,460
G2040950	Football/Soccer Field	\$4.45	S.F.	306,506	20	2009	2029		50.00 %	0.00 %	10			\$1,363,952
G2040950	Tennis Courts	\$1.42	S.F.	306,506	20	2009	2029		50.00 %	0.00 %	10			\$435,239
G2040950	Track	\$1.86	S.F.	306,506	10	2009	2019	2022	30.00 %	0.00 %	3			\$570,101
G2050	Landscaping	\$1.18	S.F.	306,506	25	2011	2036		68.00 %	0.00 %	17			\$361,677
G3010	Water Supply	\$1.09	S.F.	306,506	50	2011	2061		84.00 %	0.00 %	42			\$334,092
G3020	Sanitary Sewer	\$2.20	S.F.	306,506	50	2011	2061		84.00 %	0.00 %	42			\$674,313
G3030	Storm Sewer	\$1.25	S.F.	306,506	50	2011	2061		84.00 %	0.00 %	42			\$383,133
G4010	Electrical Distribution	\$2.55	S.F.	306,506	30	2011	2041		73.33 %	0.00 %	22			\$781,590
G4020	Site Lighting	\$2.98	S.F.	306,506	30	2011	2041		73.33 %	0.00 %	22			\$913,388
G4030	Site Communication and Security	\$1.28	S.F.	306,506	30	2011	2041		73.33 %	0.00 %	22			\$392,328
Total									65.09 %					\$12,499,316

System Notes

The facility description in the executive summary contains an overview of each system. The system notes listed below provide additional information on select systems found within the facility.

System: G2010 - Roadways**Note:**

System: G2020 - Parking Lots**Note:**

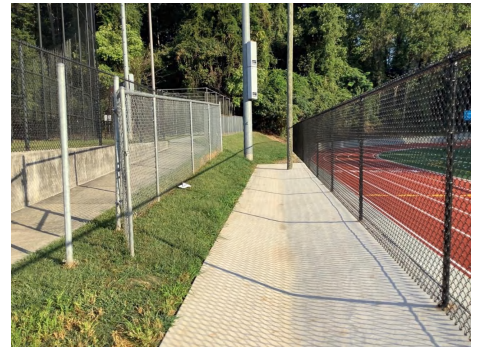System: G2030 - Pedestrian Paving**Note:**

School Assessment Report - Site

System: G2040105 - Fence & Guardrails



Note:

System: G2040950 - Baseball Field



Note:

System: G2040950 - Football/Soccer Field



Note:


School Assessment Report - Site

System: G2040950 - Tennis Courts



Note:

System: G2040950 - Track

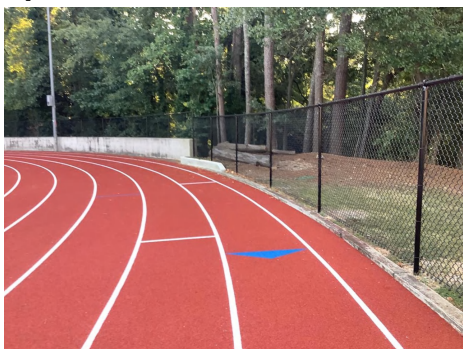

Note:

System: G2050 - Landscaping



Note:

School Assessment Report - Site

System: G3010 - Water Supply



Note:

System: G3020 - Sanitary Sewer



Note:

System: G3030 - Storm Sewer



Note:

School Assessment Report - Site

System: G4010 - Electrical Distribution



Note:

System: G4020 - Site Lighting



Note:

Renewal Schedule

eCOMET forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the System Listing table. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.


Inflation Rate: 3%

System	Current Deficiencies	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	Total
Total:		\$0	\$0	\$685,261	\$0	\$0	\$0	\$0	\$0	\$0	\$5,686,534	\$6,371,795
G - Building Sitework	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G20 - Site Improvements	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2010 - Roadways	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2020 - Parking Lots	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2030 - Pedestrian Paving	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040 - Site Development	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040105 - Fence & Guardrails	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040950 - Baseball Field	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$3,026,777	\$3,026,777
G2040950 - Football/Soccer Field	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$2,016,341	\$2,016,341
G2040950 - Tennis Courts	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$643,416	\$643,416
G2040950 - Track	\$0	\$0	\$0	\$685,261	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$685,261
G2050 - Landscaping	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G30 - Site Mechanical Utilities	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G3010 - Water Supply	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G3020 - Sanitary Sewer	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G3030 - Storm Sewer	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G40 - Site Electrical Utilities	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G4010 - Electrical Distribution	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G4020 - Site Lighting	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G4030 - Site Communication and Security	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0

** Indicates non-renewable system*

Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and forecasted capital renewal (sustainment) requirements over the next ten years.

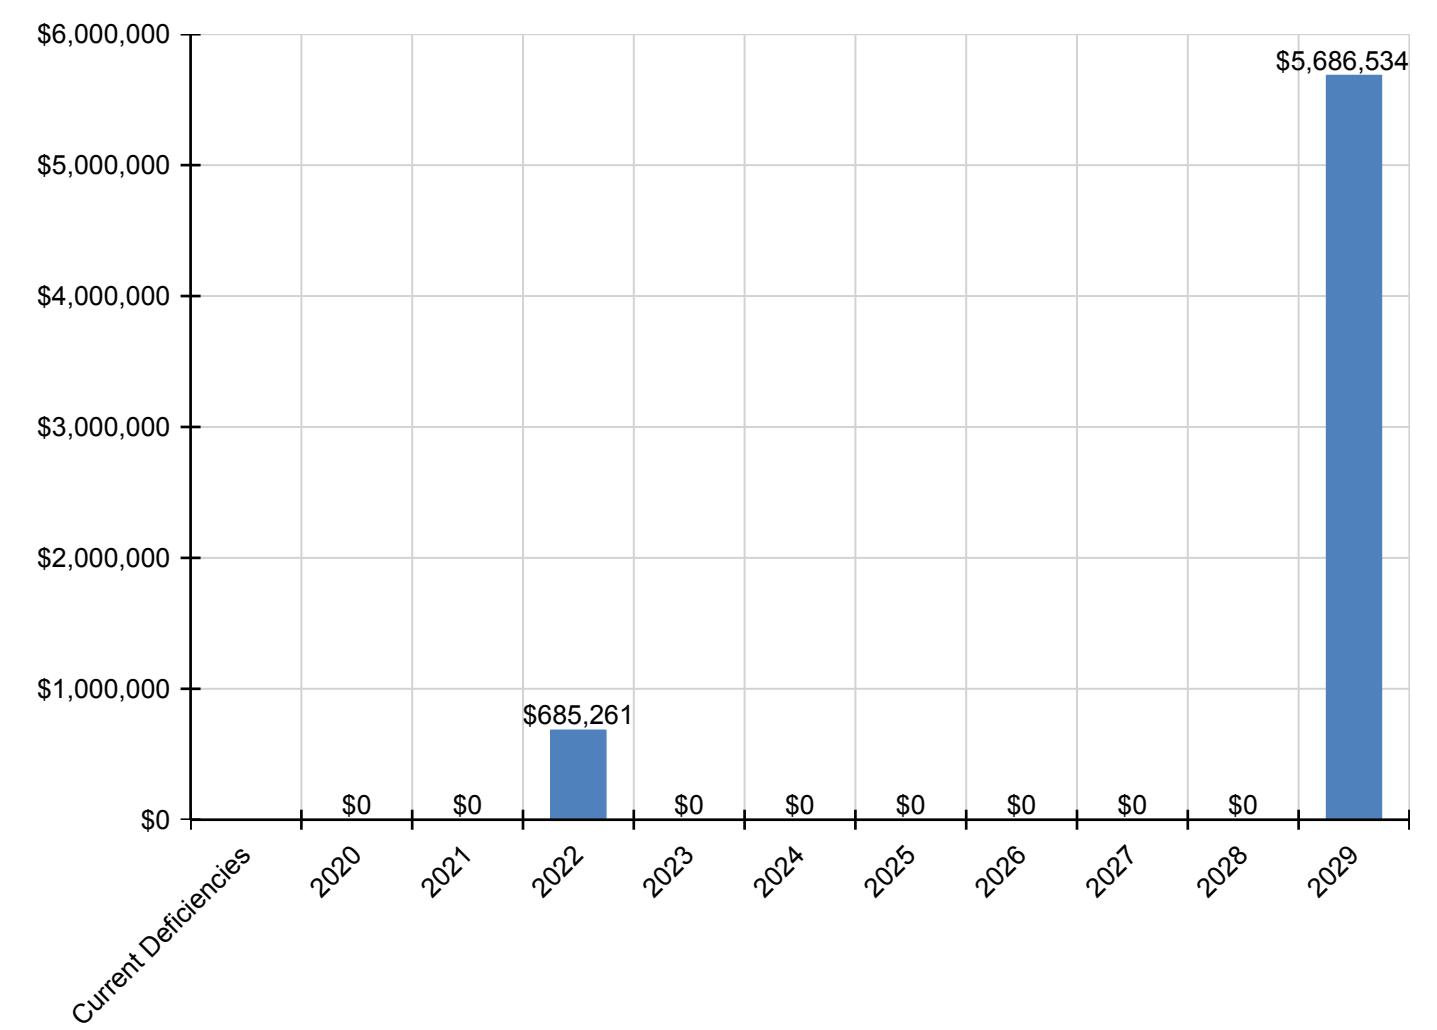


Condition Index Forecast by Investment Scenario

The chart below illustrates the effect of various investment levels on the building FCI for the next 10 years. The levels of investment shown below include:

- Current FCI: a variable investment amount based on renewing expired systems to maintain the current FCI for the building
- 2% Investment: an annual investment of 2% of the replacement value of the building, escalated for inflation
- 4% Investment: an annual investment of 4% of the replacement value of the building, escalated for inflation

Facility Investment vs. FCI Forecast

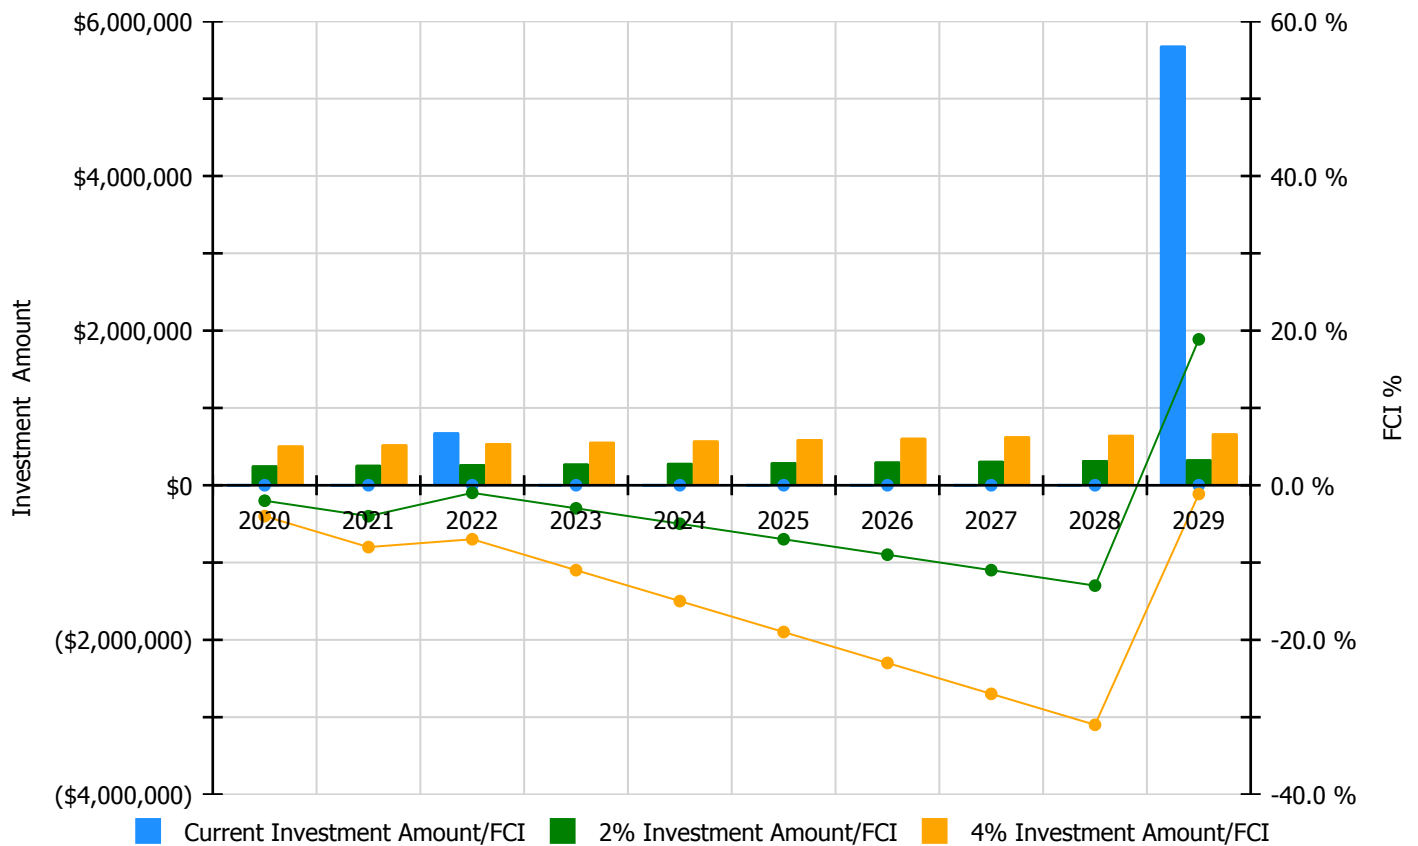

Year	Investment Amount Current FCI - 0%	2% Investment		4% Investment	
		Amount	FCI	Amount	FCI
2020	\$0	\$257,486.00	-2.00 %	\$514,972.00	-4.00 %
2021	\$0	\$265,210.00	-4.00 %	\$530,421.00	-8.00 %
2022	\$685,261	\$273,167.00	-0.98 %	\$546,334.00	-6.98 %
2023	\$0	\$281,362.00	-2.98 %	\$562,724.00	-10.98 %
2024	\$0	\$289,803.00	-4.98 %	\$579,605.00	-14.98 %
2025	\$0	\$298,497.00	-6.98 %	\$596,993.00	-18.98 %
2026	\$0	\$307,452.00	-8.98 %	\$614,903.00	-22.98 %
2027	\$0	\$316,675.00	-10.98 %	\$633,350.00	-26.98 %
2028	\$0	\$326,175.00	-12.98 %	\$652,351.00	-30.98 %
2029	\$5,686,534	\$335,961.00	18.87 %	\$671,921.00	-1.13 %
Total:	\$6,371,795	\$2,951,788.00		\$5,903,574.00	

Deficiency Summary by System

Current deficiencies included assemblies that have reached or exceeded their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Useful Life'. The following chart lists all current deficiencies associated with this facility.

No data found for this asset

Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

No data found for this asset

Deficiency By Priority Investment Table

The table below shows the current investment cost grouped by deficiency priority and building system.

No data found for this asset

Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

No data found for this asset

Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

No data found for this asset

Glossary

Abandoned	A facility owned by the city that is not occupied and not maintained. See Vacant.
Additional Cost	Total project cost is composed of hard and soft costs. Additional costs or soft expenses are costs that are necessary to accomplish the corrective work but are not directly attributable to the deficient systems direct construction cost, which are often referred to as hard cost. The components included in the soft costs vary by owner but usually include architect and contractor fees, contingencies and other owner-incurred costs necessary to fully develop and build a facility. These soft cost factors can be adjusted anytime within the eCOMET database at the owner's discretion.
Assessment	Visual survey of a facility to determine its condition. It involves looking at the age of systems, reviewing information from local sources and visual evidence of potential problems to assign a condition rating. It does not include destructive testing of materials or testing of systems or equipment for functionality.
ASTM	ASTM International (ASTM): Originally known as the American Society for Testing and Materials, ASTM is an international standards organization that develops and publishes voluntary consensus technical standards for a wide range of materials, products, systems, and services.
BOMA	Building Owners Managers of America (BOMA): National organization of public and private facility owners focused on building management tools and maintenance techniques. eCOMET® reference: Building and component system effective economic life expectancies.
Building	A fully enclosed and roofed structure that can be traversed internally without exiting to the exterior.
Building Addition	An area, space or component of a building added to a building after the original building's year built date. NOTE: As a convention in the database, "Main" was used to designate the original building. Additions built prior to 1987 (30 years) were included in the main building area calculations to reflect their predicted system depreciation characteristics and remaining service life.
Building Systems	eCOMET® uses UNIFORMAT II to organize building data. UNIFORMAT II was originally developed by the federal General Services Administration to delineate building costs by systems rather than by material. UNIFORMAT II was formalized by an NIST standard, NISTIR 6389 in 1999. It has been further quantified and updated by ASTM standard 2005, E1557-05. The Construction Specifications Institute, CSI, has taken over the standard as part of their MasterFormat / MasterSpec system.
Calculated Next Renewal	The year a system or building element would be expected to expire based solely on the date it was installed and the expected useful lifetime for that kind of system.
Capital Renewal	Capital renewal refers to the cyclical replacement of building systems or elements as they become obsolete or beyond their useful life. It is not normally included in an annual operating/maintenance budget. See calculated next renewal and next renewal.
City Cost Index (CCI)	RS Means provides building system, equipment, and construction costs at a national level. The City Cost Index (also provided by RS Means) localizes those costs to a geographic region of the United States. In eCOMET®, each building or site is assigned a City Cost Index, which adjusts all of the associated costs for systems, deficiencies and inventory to the local value.
Condition	Condition refers to the state of physical fitness or readiness of a facility system or system element for its intended use.
Condition Budget	The Condition Budget, also known as Condition Needs, represents the budgeted contractor installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging the work.

School Assessment Report - Sutton Middle School

Condition Index (CI) %	The Condition Index (CI) also known as the Remaining Service Life Index (RSLI) is calculated as the sum of a renewable system's Remaining Service Life (RSL) Value divided by the sum of a system's Replacement Value (both values exclude soft cost to simplify calculation updates) expressed as a percentage ranging from 100.00% (new) to 0.00% (expired - no remaining life).
Correction	Correction refers to an assessor's recommended deficiency repair or replacement action. For any system or element deficiency, there can be multiple and alternative solutions for its repair or replacement. A Correction is user defined and tied to a UNIFORMAT II element, or system it is intended to address. It excludes other peripheral costs that may also be included in the packaging of repair, replacement or renewal improvements that may also be triggered by the deficiency correction.
Cost Model	A cost model is a list of facility systems which could represent the installed systems a given facility. Included in the cost model are standard unit cost estimates, gross areas, life cycles and installed dates. Also represented is the repair cost for deficient systems, replacement values. See eCOMET® cost models.
Criteria	Criteria refer to the set of requirements, guidelines or standards that are assessed and rated to develop a score.
Current Period	The Current Period is the current year plus a user defined number of forward years.
Current Replacement Value (CRV)	The Current Replacement Value (CRV) of a facility, building or system represents the hypothetical cost of rebuilding or replacing an existing facility under today's codes and construction standards, using its current configuration. It is calculated by multiplying the gross area of the facility by a square foot cost developed in that facility's cost model. Replacement cost includes construction costs and owner's additional or soft costs for fees, permits and other expenses to reflect a total project cost.
Deferred Maintenance	Deferred maintenance is condition work deferred on a planned or unplanned basis to a future budget cycle or postponed until funds are available.
Deficiency	A deficiency is a repair item that is damaged, missing, inadequate or insufficient for an intended purpose.
Deficiency Category	Category refers to the type or class of a user defined deficiency grouping with shared or similar characteristics. Category descriptions include, but are not limited to: Accessibility Code Compliance, Appearance, Building Code Compliance, Deferred Maintenance, Energy, Environmental, Life Safety Code Compliance, and Safety.
Deficiency Priority	Priority refers to a deficiency's urgency for repair as determined by the assessment team. Five typical industry priority settings were used for the assessment: Priority 1 – Currently Critical; Priority 2 – Potentially Critical; Priority 3 – Necessary/Not Yet Critical; Priority 4 – Recommended.
Distress	Distress refers to a user-defined root cause of a deficiency. Distress descriptions are: Beyond Service Life, Damaged, Inadequate, Needs Remediation, and Missing.
eCOMET®	Energy and Condition Management Estimation Technology (eCOMET®) is Parsons proprietary facility asset management software developed to provide facility managers with a state of the art, web-based tool to develop and maintain a comprehensive database of FCA data and information used for facility asset management, maintenance and repair, and capital renewal planning. eCOMET® is used by Parsons and its clients as the primary tool for collecting FCA data, preparing cost estimates, generating individual facility reports and cost estimates, and developing the overall capital renewal program.
eCOMET® Cost Models	eCOMET cost models are derived from RS Means Square Foot Cost Data cost models and these models are used to develop the current replacement value (CRV) and assign life cycle costs to the various systems within a building. Cost models are assigned current costs-per-square-foot to establish replacement values. The Cost models are designed to represent a client specific facility that meets local standards cost trends.

School Assessment Report - Sutton Middle School

Element	Elements are the major components that comprise building systems as defined by UNIFORMAT II.
Expected Life	Also referred to as Useful Life. See Useful Life definition.
Facility	A facility refers to site(s) building(s) or building addition(s) or combinations thereof that provide a particular service.
Facility Attributes	Customizable eCOMET fields to identify attributes specific to a facility. These fields are part of the eCOMET database set-up with the owner.
Facility Condition Assessment (FCA)	A facility condition assessment (FCA) is a visual inspection of buildings and grounds at a facility to identify and estimate current and future needed repairs or replacements of major systems for planning and budgeting purposes. It is typically performed for organizations that are tasked with the day to day maintenance, operation, and capital renewal (replacement) of building systems and components of a large inventory of facilities. The primary goal of an FCA is to objectively and quantifiably identify, inspect, and prioritize the repair and replacement needs of the building and ground systems (e.g., roofs, windows, doors, floor finishes, plumbing fixtures, parking lot, and sidewalks) within facilities that have either failed or have surpassed their service life, and to identify and forecast future capital replacement needs for systems that have not yet failed, but planned replacement of those systems is needed to ensure that the facilities will continue to meet the mission of the organization.
Facility Condition Index (FCI%)	FCI is an industry-standard measurement of a facility's condition that is the ratio of the cost to correct a facility's deficiencies to the Current Replacement Value of the facilities. The higher the FCI the poorer the condition of a facility. After an FCI is established for all buildings within a portfolio a building's condition can be ranked relative to other buildings. The FCI may also represent the condition of a portfolio based on the cumulative FCIs of the portfolio's facilities.
Forecast Period	The Forecast Period refers to a user defined number of years forward of the Current Period.
Gen (Generate)	The Cost Model has a Gen box for each system line item. By checking the box, eCOMET will generate life cycle deficiencies based on the Year Installed and the Life for that system. Systems that typically do not re-generate (foundations, floor construction, roof construction, basement walls, etc.) would not have the Gen box checked as those systems would not re-generate at the end of a life cycle. In those instances, it would be more practical and cost effective to demolish the entire facility than re-new those systems.
Gross Square Feet (GSF)	The size of the enclosed floor space of a building in square feet measured to the outside face of the enclosing wall.
Life Cycle	Life cycle refers to the period of time that a building or site system or element can be expected to adequately serve its intended function. Parsons assigns expected life cycles to all building systems based on Building Operators and Managers of America (BOMA) recommended life cycles, manufacturers suggested life, and RS Means cost data, and client-provided historical data. BOMA standards are a nationally recognized source of life cycle data for various components and/or systems associated with facilities. RS Means is a national company specializing in construction estimating and costs.
Next Renewal	Next Renewal refers to a manually-adjusted expected useful life of a system or element based on on-site inspection either by reducing or extending the Calculated Next Renewal to more accurately reflect current conditions.
Order of Magnitude	Order of Magnitude refers to a rough approximation made with a degree of knowledge and confidence that the budgeted, projected or estimated cost falls within a reasonable range of cost values.
Remaining Service Life (RSL)	RSL is the number of years service remaining for a system or equipment item. It is automatically calculated based on the difference between the current year and the 'Calculated Next Renewal' date or the 'Next Renewal' date whichever one is the later date.

School Assessment Report - Sutton Middle School

Remaining Service Life Index (RSLI)	The Remaining Service Life Index (RSLI), also known as the Condition Index (CI), is calculated as the sum of a renewable system's or component's Remaining Service Life (RSL) Value divided by the sum of a system's or component's Replacement Value (both values exclude softcost to simplify calculation updates) expressed as a percentage ranging from 100.00% (new) to 0.00% (expired - no remaining service life).
Remaining Service Life Value	Remaining Service Life Value, also known as the RSL Weight, is a calculated value used to determine the RSLI and is equal to the system Value (Unit Cost * Qty) * RSL (not displayed).
Renewal Factors	Renewal factors represent the difference in cost of renovating or replacing an existing system, rather than new construction of a building system. For example, installing a new built-up roof on an existing building would include removing and disposing of the old roof, a cost not associated with new construction. Using a renewal premium to account for demolition and other difficulty costs, Parsons typically assigns a renewal factor of 110%.
Renewal Schedule	A timeline that provides the items that need repair the year in which the repair is needed and the estimated price of the renewal.
Repair Cost	Repair cost is the sum of all the deficiencies associated with a building or multiple buildings/facilities. It will include any applied soft costs or City Cost Indexes.
Replacement Value	See Current Replacement Value.
Site	A facility's grounds and its utilities, roadways, landscaping, fencing and other typical land improvements needed to support a facility.
Soft Costs	Soft Costs are a construction industry term that refers to expense items that are not considered direct construction costs. Soft costs are user-defined and include architectural, engineering, management, testing, and mitigation fees, and other owner pre- and post-construction expenses.
Sustainability	Sustainability refers to the collection of policies and strategies that meet society's present needs without compromising the ability of future generations to meet their own needs.
System	System refers to building and related site work elements as described by ASTM Uniformat II Classification for Building Elements (E1557-97) a format for classifying major facility elements common to most buildings. Elements usually perform a given function regardless of the design specification construction method or materials used. See also Uniformat II.
System Generated Deficiency	eCOMET automatically generates system deficiencies based on system life cycles using the systems installation dates as the base year. By adjusting the Next Renewal date ahead or behind the predicted or stated life cycle date, a system cost will come due earlier or later than the originally installed life cycle date. This utility accounts for good maintenance conditions and a longer life, or early expiration of a system life due to any number of adverse factors such as poor installation, acts of god, material defects, poor design applications and other factors that may shorten the life of a material or system. It is important to mention that the condition of the systems is not necessarily a reflection of maintenance practices, but a combination of system usage and age.
UNIFORMAT	ASTM UNIFORMAT II, Classification for Building Elements (E1557-97), a publication of the Construction Specification Institute (CSI), is a format used to classify major facility components common to most buildings. The format is based on functional elements or parts of a facility characterized by their functions without regard to the materials and methods used to accomplish them. These elements are often referred to as systems or assemblies.
Unit Price	The Unit Price (Raw) x the Additional Cost Template percentage.
Unit Price (Raw)	The actual \$/sq. ft. cost being used for the building and systems. It will include adjustments for the City Cost Index applied to the facility.

School Assessment Report - Sutton Middle School

Useful Life	Also known as Expected Life, Useful Life refers to the intrinsic period of time a system or element is expected to perform as intended. Useful life is generally provided by manufacturers of materials, systems and elements through their literature, testing and experience. Useful Lives in the database are derived from the Building Owners and Managers (BOMA) organization's guidelines, RSMeans cost data, and from client- defined historical experience.
Vacant	Vacant refers to a facility that is not occupied but is a maintained facility. See Abandoned.
Year Built	The year that a building or addition was originally built based on substantial completion or occupancy.
Year Installed	The year a system or element was built or the most recent major renovation date where a minimum of 70% of the system's Current Replacement Value (CRV) was replaced.



Suitability Report - Full

Project #: 12382	County: Atlanta Public Schools	Site #: 0192
Project: APS Assessments 2019	Region: 761	Site: Sutton MS
Grade Config: 7-8	Site Type: Middle	Site Size: 18.00

Suitability	Rating	Score	Possible Score	Percent Score
Suitability - MS				
Learning Environment				
Learning Style Variety	Good	4.00	5.00	80.00
Interior Environment	Good	1.60	2.00	80.00
Exterior Environment	Good	1.20	1.50	80.00
General Classrooms				
Environment	Good	3.12	3.90	80.00
Size	Good	7.80	9.75	80.00
Location	Excel	2.93	2.93	100.00
Storage/Fixed Equip	Good	2.34	2.93	80.00
Self-Contained Special Ed				
Environment	(N/A)	0.00	0.00	0.00
Size	(N/A)	0.00	0.00	0.00
Location	(N/A)	0.00	0.00	0.00
Storage/Fixed Equip	(N/A)	0.00	0.00	0.00
Instructional Resource Rooms				
Environment	Good	0.66	0.82	80.00
Size	Excel	2.05	2.05	100.00
Location	Excel	0.61	0.61	100.00
Storage/Fixed Equip	Excel	0.61	0.61	100.00
Science				
Environment	Good	0.76	0.95	80.00
Size	Excel	2.39	2.39	100.00
Location	Excel	0.72	0.72	100.00
Storage/Fixed Equip	Excel	0.72	0.72	100.00
Music				
Environment	Good	0.59	0.74	80.00
Size	Excel	1.84	1.84	100.00
Location	Excel	0.55	0.55	100.00
Storage/Fixed Equip	Good	0.44	0.55	80.00
Art				
Environment	Excel	0.65	0.65	100.00
Size	Excel	1.61	1.61	100.00
Location	Excel	0.48	0.48	100.00
Storage/Fixed Equip	Excel	0.48	0.48	100.00
Career Tech Ed				
Environment	Good	1.08	1.35	80.00

Project #: 12382

County: Atlanta Public Schools

Site #: 0192

Project: APS Assessments 2019

Region: 761

Site: Sutton MS

Grade Config: 7-8

Site Type: Middle

Site Size: 18.00

Suitability	Rating	Score	Possible Score	Percent Score
Size	Excel	3.37	3.37	100.00
Location	Excel	1.01	1.01	100.00
Storage/Fixed Equip	Excel	1.01	1.01	100.00
Computer Labs				
Environment	Good	0.24	0.30	80.00
Size	Excel	0.75	0.75	100.00
Location	Excel	0.23	0.23	100.00
Storage/Fixed Equip	Excel	0.23	0.23	100.00
P.E.				
Environment	Good	1.92	2.40	80.00
Size	Excel	6.00	6.00	100.00
Location	Excel	1.80	1.80	100.00
Storage/Fixed Equip	Excel	1.80	1.80	100.00
Performing Arts				
Environment	Good	0.33	0.42	80.00
Size	Excel	1.05	1.05	100.00
Location	Excel	0.31	0.31	100.00
Storage/Fixed Equip	Excel	0.31	0.31	100.00
Media Center				
Environment	Excel	0.93	0.93	100.00
Size	Excel	2.32	2.32	100.00
Location	Excel	0.70	0.70	100.00
Storage/Fixed Equip	Excel	0.70	0.70	100.00
Restrooms (Student)	Excel	0.93	0.93	100.00
Administration	Excel	2.10	2.10	100.00
Counseling	Good	0.34	0.42	80.00
Clinic	Excel	0.34	0.34	100.00
Staff WkRm/Toilets	Excel	0.91	0.91	100.00
Cafeteria	Excel	4.00	4.00	100.00
Food Service and Prep	Excel	5.72	5.72	100.00
Custodial and Maintenance	Excel	0.50	0.50	100.00
Outside				
Vehicular Traffic	Excel	4.00	4.00	100.00
Pedestrian Traffic	Excel	0.43	0.43	100.00
Parking	Excel	0.86	0.86	100.00
Athletic Courts and Fields	Excel	1.05	1.05	100.00
Safety and Security				
Fencing	Good	0.62	0.78	80.00
Signage & Way Finding	Poor	0.50	1.00	50.00
Ease of Supervision	Excel	3.00	3.00	100.00
Controlled Entrances	Good	0.40	0.50	80.00
Total For Site:		89.91	97.27	92.43

Comments

Project #: 12382

County: Atlanta Public Schools

Site #: 0192

Project: APS Assessments 2019

Region: 761

Site: Sutton MS

Grade Config: 7-8

Site Type: Middle

Site Size: 18.00

Suitability

Rating

Score

**Possible
Score**

**Percent
Score**

Suitability - MS

Sutton Middle School houses grade 6 through 8 and was built in 1951. There have been four additions/renovations to the school since that time, the most recent in 1994.

Suitability - MS->Safety and Security-->Signage & Way Finding

The visitor sign has none of the four required security elements.