

Atlanta Public Schools/ Jackson Cluster

# Toomer Elementary School

Revised

## School Assessment Report

November 10, 2020



## Table of Contents

|   |    |
|---|----|
| School Executive Summary                        | 4  |
| School Dashboard Summary                        | 7  |
| School Condition Summary                        | 8  |
| <b><u>1967 Bldg 2010</u></b>                    | 10 |
| Executive Summary                               | 10 |
| Dashboard Summary                               | 11 |
| Condition Summary                               | 12 |
| Photo Album                                     | 13 |
| Condition Detail                                | 14 |
| System Listing                                  | 15 |
| System Notes                                    | 17 |
| Renewal Schedule                                | 30 |
| Forecasted Sustainment Requirement              | 33 |
| Condition Index Forecast by Investment Scenario | 34 |
| Deficiency Summary By System                    | 35 |
| Deficiency Summary By Priority                  | 36 |
| Deficiency By Priority Investment               | 37 |
| Deficiency Summary By Category                  | 38 |
| Deficiency Details By Priority                  | 39 |
| <b><u>1996 Bldg 2020</u></b>                    | 44 |
| Executive Summary                               | 44 |
| Dashboard Summary                               | 45 |
| Condition Summary                               | 46 |
| Photo Album                                     | 47 |
| Condition Detail                                | 48 |
| System Listing                                  | 49 |
| System Notes                                    | 51 |
| Renewal Schedule                                | 61 |
| Forecasted Sustainment Requirement              | 63 |

## School Assessment Report

---

|   |           |
|---|-----------|
| Condition Index Forecast by Investment Scenario | 64        |
| Deficiency Summary By System                    | 65        |
| Deficiency Summary By Priority                  | 66        |
| Deficiency By Priority Investment               | 67        |
| Deficiency Summary By Category                  | 68        |
| Deficiency Details By Priority                  | 69        |
| <b>Site</b>                                     | <b>73</b> |
| Executive Summary                               | 73        |
| Dashboard Summary                               | 74        |
| Condition Summary                               | 75        |
| Photo Album                                     | 76        |
| Condition Detail                                | 77        |
| System Listing                                  | 78        |
| System Notes                                    | 79        |
| Renewal Schedule                                | 84        |
| Forecasted Sustainment Requirement              | 85        |
| Condition Index Forecast by Investment Scenario | 86        |
| Deficiency Summary By System                    | 87        |
| Deficiency Summary By Priority                  | 88        |
| Deficiency By Priority Investment               | 89        |
| Deficiency Summary By Category                  | 90        |
| Deficiency Details By Priority                  | 91        |
| Glossary  | 93        |

### School Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as  $100 - \text{Total FCI}$  (without the %) where 100 is best and 0 is worst condition.

|                    |                |
|--------------------|----------------|
| Gross Area (SF):   | 70,012         |
| Year Built:        | 1967           |
| Last Renovation:   |                |
| Replacement Value: | \$14,457,070   |
| Repair Cost:       | \$3,251,588.00 |
| Total FCI:         | 22.49 %        |
| Total RSLI:        | 34.81 %        |
| FCA Score:         | 77.51          |



#### Description:

The Toomer Elementary School consists of (1) main school building located at 65 Rogers Street, in Atlanta, GA. The original 70,012 SF campus was constructed in 1967. An addition to the main building was constructed in 1996.

This report contains condition and adequacy data collected during the 2019 Facility Condition Assessment (FCA) Update. Detailed condition and deficiency statements are contained in this report for the site and building elements.

#### SUBSTRUCTURE

The buildings rest on slab-on grade and are assumed to have standard cast-in-place concrete foundations.

#### SUPERSTRUCTURE



## School Assessment Report - Toomer Elementary School

---

1967 Building 2010 The superstructure is concrete frame. Floor construction is slab on-grade. Roof construction is a concrete pan joist system with lightweight concrete fill in the main school building. The exterior enclosure is comprised of pre-cast concrete walls that are painted. Exterior windows are aluminum frame with fixed and operable panes. Exterior doors are mostly aluminum framed with glass. Roofing is low slope with modified bitumen.

1996 Building 2020 The superstructure is steel frame with load bearing CMU. Floor construction is slab on-grade. Roof construction is steel framed. The exterior enclosure is comprised of brick veneer over CMU walls. Exterior windows are aluminum frame with operable panes. Exterior doors are mostly hollow metal with view windows. Roofing is sloped with standing seam metal covering.

Roof openings include a roof hatch with fixed ladder access. Most building entrances appear to comply with ADA requirements.

### INTERIORS

Interior partitions are typically CMU. Interior doors are generally solid core wood with metal frames and mostly with glazing. Interior fittings include the following items: white boards, graphics and identifying devices, toilet accessories, storage shelving, handrails, fabricated toilet partitions. The interior wall finishes are typically painted CMU. Floor finishes in common areas are typically vinyl composition tile. Floor finishes in assigned areas consist of wood, ceramic tile for restrooms, and carpet for the administration and Media Center. Ceiling finishes in common areas are typically suspended acoustical tile.

### SERVICES CONVEYING:

The main building at the school has an elevator.

### PLUMBING:

Plumbing fixtures are typically low-flow water fixtures with manual control valves. Domestic water distribution is combination of copper and galvanized steel with electric hot water heating. Sanitary waste system is cast iron. Rainwater drainage system on most buildings is a combination of internal and external roof drains with gutters.

### HVAC:

Heating is provided by gas fired boilers with additional rooftop package DX units for heating and cooling. The heating/cooling distribution system is a ductwork system utilizing air handling units. Ceiling mounted exhaust fans are installed in bathrooms and other required areas. Controls and instrumentation are digital and are centrally controlled by an energy management system. This building has a remote Building Automation System.

### FIRE PROTECTION:

The buildings do not have a fire sprinkler system. Fire extinguishers and cabinets are distributed near fire exits and corridors.

### ELECTRICAL:

The main electrical service is fed from a pad mounted transformer to the main switchboard/distribution panel located in the building. Lighting is lay-in type, fluorescent light fixtures. Branch circuit wiring is typically copper serving electrical switches and receptacles. Emergency and life safety egress lighting systems are installed and exit signs are present at exit doors and are typically illuminated.

### COMMUNICATIONS AND SECURITY:

The fire alarm system consists of audible/visual strobe annunciators in common spaces, and interior corridors. The system is activated by manual pull stations and smoke detectors and the system is centrally monitored. The telephone and data systems are segregated and include dedicated equipment closets. This building does have a local area network (LAN). The building includes an internal security system that is actuated by the following items: contacts, infrared, optical or a combination of all devices. The building has controlled entry doors access provided by card readers; entry doors are secured with magnetic door locks. The security system has CCTV cameras and is centrally monitored; this building has a public address and paging system combined with the telephone system.

### OTHER ELECTRICAL SYSTEMS:

This school does not have a natural gas emergency generator.

## School Assessment Report - Toomer Elementary School

---

### EQUIPMENT & FURNISHINGS

This school includes the following items and equipment: fixed food service, library equipment, audio-visual, fixed casework, and computers.

### SITE

Campus site features include paved driveways and parking lots, pedestrian pavement, covered walkways, flagpole, landscaping, retaining walls, playground, play fields, and fencing. Site mechanical and electrical features include water, sewer, natural gas, and site lighting.

### CODE REVIEW

### ACCESSIBILITY:

The building is generally in compliance with applicable ADA requirements with respect to path of travel, interior and exterior doors, interior signage, and toilet room dimensions, fixtures, and fittings. Most building entrances appear to comply with ADA requirements.

### LIFE-SAFETY SYSTEMS:

The buildings are not covered with a wet sprinkler system. Fire extinguishers are located throughout the buildings. Power outlets in wet areas are GFIC protected. The fire alarm system includes detection devices, audio/visual alarms, and pull stations. Emergency/egress lighting is a combination of battery and special circuit systems. Illuminated exit signage is present in corridors and at exit doors.

### Attributes:

#### General Attributes:

|                          |                            |                                 |             |
|--------------------------|----------------------------|---------------------------------|-------------|
| Arch Condition Assessor: | Jejuan Hall                | MEP Condition Assessor:         | Jejuan Hall |
| School Grades:           | 01, 02, 03, 04, 05, KK, PK | DOE Drawing Total GSF:          | -           |
| DOE Facility Number:     | 5567                       | Total # of Modular/Portables:   | 0           |
| DOE Interior Site SF:    | 70012                      | Total GSF of Modular/Portables: | 0           |
| Approx. Acres:           | 10.6                       | Status:                         | Active      |


# School Assessment Report - Toomer Elementary School

## School Dashboard Summary


Gross Area: 70,012  
 Year Built: 1967  
 Repair Cost: \$3,251,588  
 FCI: 22.49 %

Last Renovation:  
 Replacement Value: \$14,457,070  
 RSLI%: 34.81 %


### Deficiency By Category

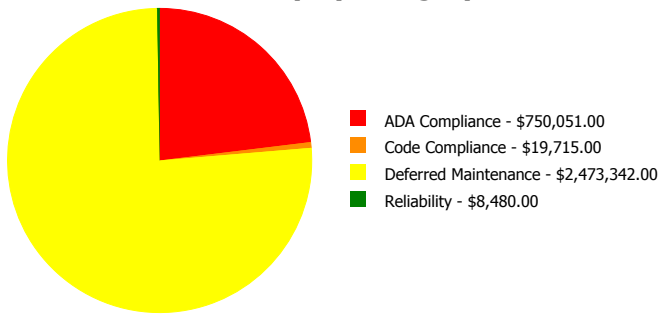


### Deficiency By Priority

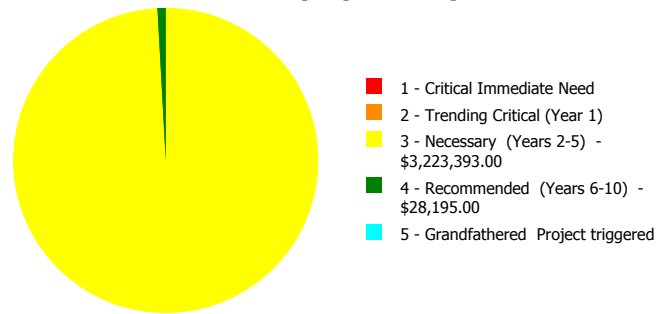

### Deficiency By System

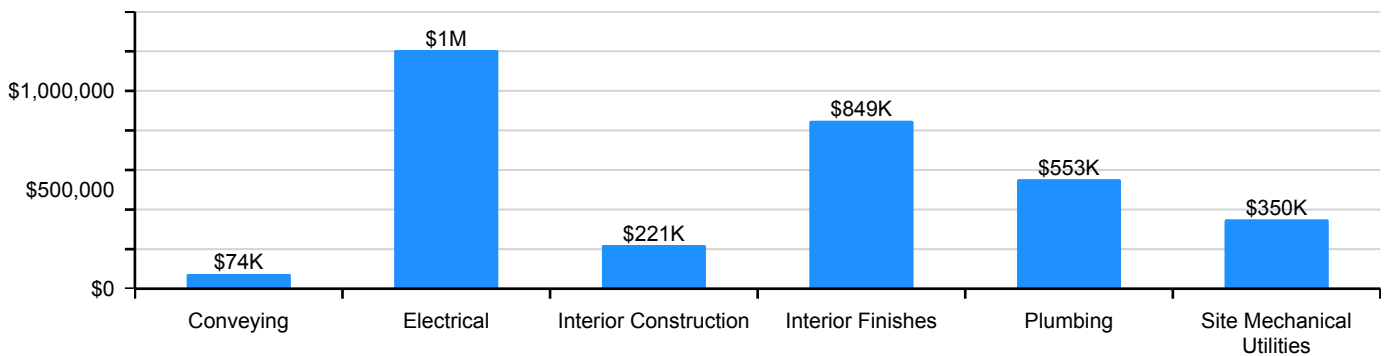

### 10 Year Investment Forecast

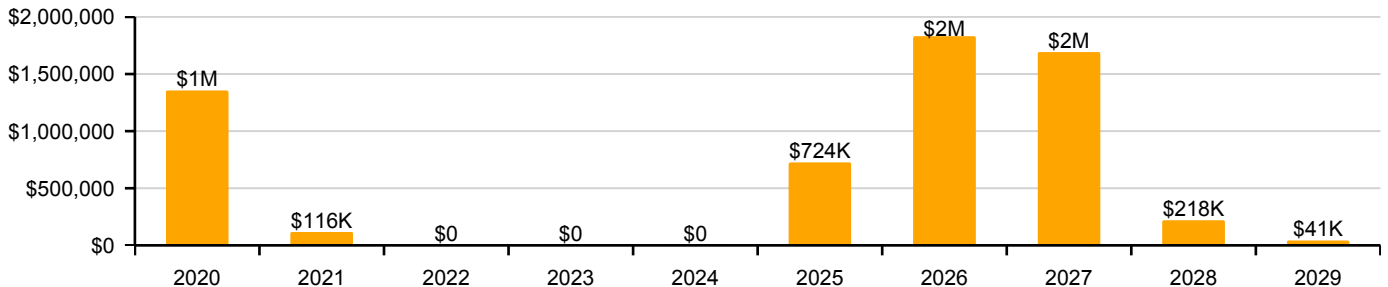

## School Condition Summary

The Table below shows the RSLI and FCI for each major system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

### Current Investment Requirement and Condition by Unifomat Classification


| UNIFORMAT Classification        | RSLI%          | FCI %          | Current Repair        |
|---------------------------------|----------------|----------------|-----------------------|
| A10 - Foundations               | 56.82 %        | 0.00 %         | \$0.00                |
| B10 - Superstructure            | 52.23 %        | 0.00 %         | \$0.00                |
| B20 - Exterior Enclosure        | 43.20 %        | 0.00 %         | \$0.00                |
| B30 - Roofing                   | 8.62 %         | 0.00 %         | \$0.00                |
| C10 - Interior Construction     | 39.77 %        | 24.49 %        | \$220,588.00          |
| C20 - Stairs                    | 48.00 %        | 0.00 %         | \$0.00                |
| C30 - Interior Finishes         | 10.63 %        | 75.47 %        | \$848,532.00          |
| D10 - Conveying                 | 0.00 %         | 110.00 %       | \$74,355.00           |
| D20 - Plumbing                  | 7.94 %         | 80.49 %        | \$552,558.00          |
| D30 - HVAC                      | 58.60 %        | 0.00 %         | \$0.00                |
| D40 - Fire Protection           | 40.79 %        | 0.00 %         | \$0.00                |
| D50 - Electrical                | 12.11 %        | 73.39 %        | \$1,205,915.00        |
| E10 - Equipment                 | 40.62 %        | 0.00 %         | \$0.00                |
| E20 - Furnishings               | 30.00 %        | 0.00 %         | \$0.00                |
| G20 - Site Improvements         | 24.19 %        | 0.00 %         | \$0.00                |
| G30 - Site Mechanical Utilities | 0.00 %         | 110.00 %       | \$349,640.00          |
| G40 - Site Electrical Utilities | 23.33 %        | 0.00 %         | \$0.00                |
| <b>Totals:</b>                  | <b>34.81 %</b> | <b>22.49 %</b> | <b>\$3,251,588.00</b> |

### Condition Deficiency Priority

| Facility Name  | Gross Area (S.F.) | FCI %        | 1 - Critical Immediate Need | 2 - Trending Critical (Year 1) | 3 - Necessary (Years 2-5) | 4 - Recommended (Years 6-10) | 5 - Grandfathered Project triggered |
|----------------|-------------------|--------------|-----------------------------|--------------------------------|---------------------------|------------------------------|-------------------------------------|
| 1967 Bldg 2010 | 51,209            | 22.06        | \$0.00                      | \$0.00                         | \$1,961,971.00            | \$19,715.00                  | \$0.00                              |
| 1996 Bldg 2020 | 18,803            | 28.96        | \$0.00                      | \$0.00                         | \$911,782.00              | \$8,480.00                   | \$0.00                              |
| Site           | 70,012            | 15.22        | \$0.00                      | \$0.00                         | \$349,640.00              | \$0.00                       | \$0.00                              |
| <b>Total:</b>  |                   | <b>22.49</b> | <b>\$0.00</b>               | <b>\$0.00</b>                  | <b>\$3,223,393.00</b>     | <b>\$28,195.00</b>           | <b>\$0.00</b>                       |

### Deficiencies By Priority



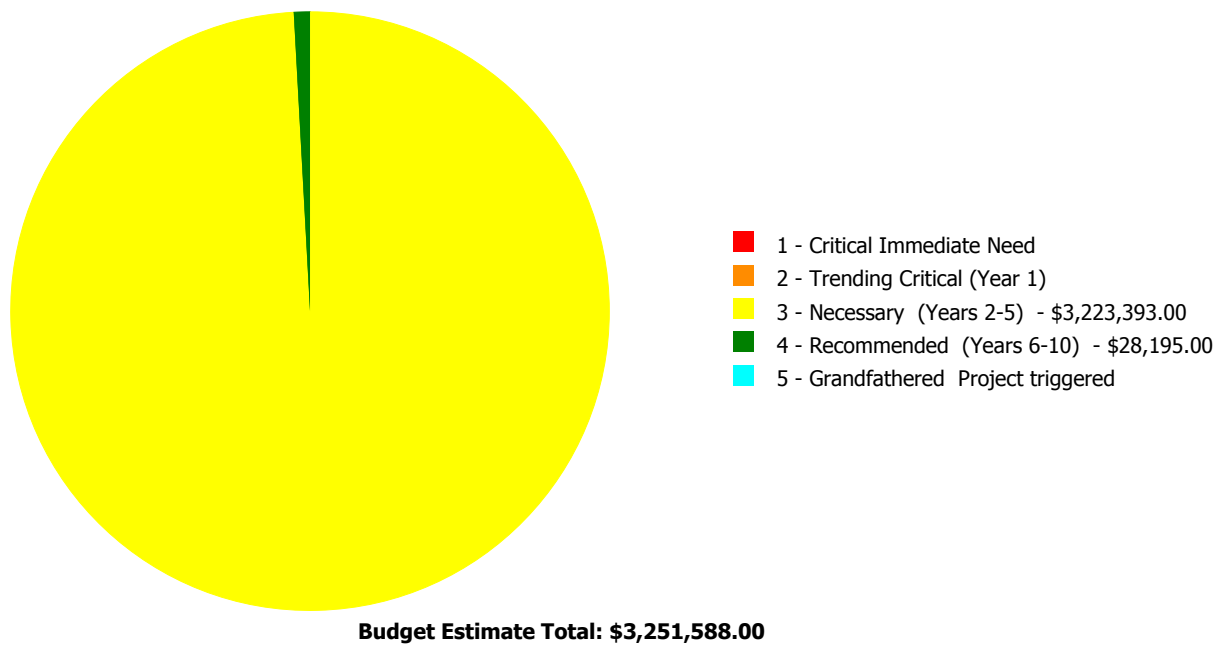

## Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as  $100 - \text{Total FCI}$  (without the %) where 100 is best and 0 is worst condition.

|                    |                |
|--------------------|----------------|
| Function:          | Elementary     |
| Gross Area (SF):   | 51,209         |
| Year Built:        | 1967           |
| Last Renovation:   |                |
| Replacement Value: | \$8,982,287    |
| Repair Cost:       | \$1,981,686.00 |
| Total FCI:         | 22.06 %        |
| Total RSLI:        | 35.34 %        |
| FCA Score:         | 77.94          |



### Description:


The narrative for this building is included in the Executive Summary Description at the front of this report.

**Attributes:** This asset has no attributes.


## Dashboard Summary

|              |             |                    |             |
|--------------|-------------|--------------------|-------------|
| Function:    | Elementary  | Gross Area:        | 51,209      |
| Year Built:  | 1967        | Last Renovation:   |             |
| Repair Cost: | \$1,981,686 | Replacement Value: | \$8,982,287 |
| FCI:         | 22.06 %     | RSLI%:             | 35.34 %     |


**Deficiency By Category**

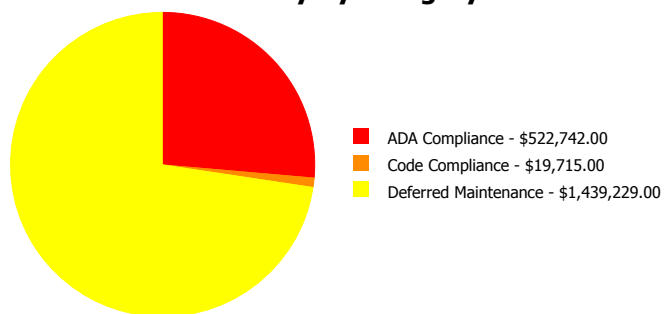


**Deficiency By Priority**

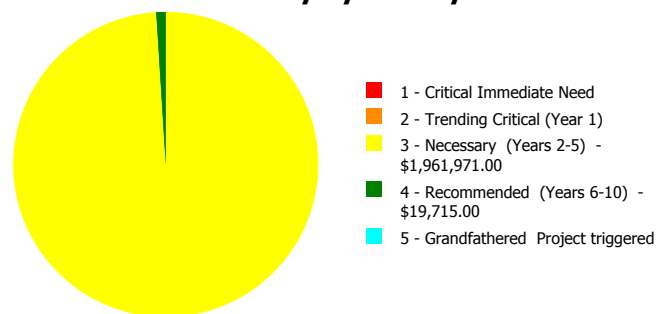

**Deficiency By System**

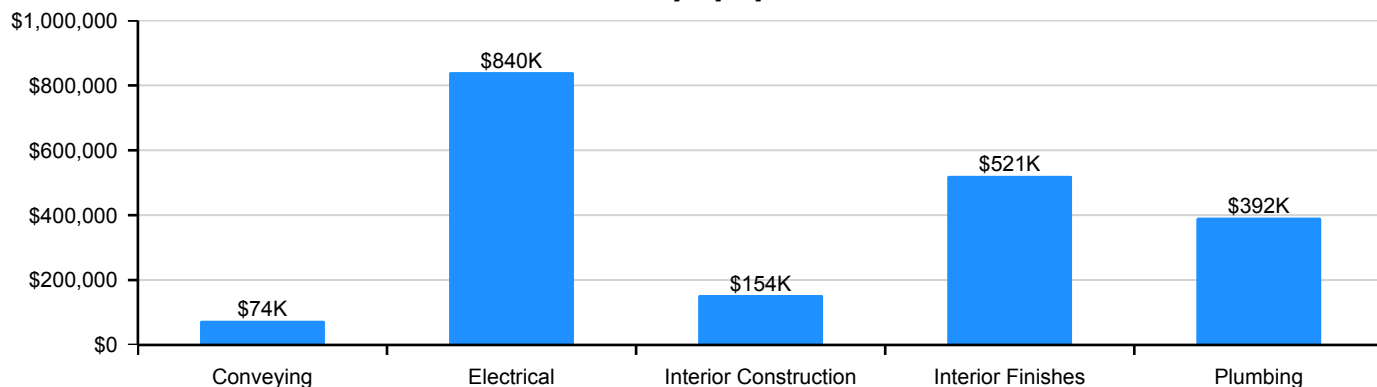

**10 Year Investment Forecast**

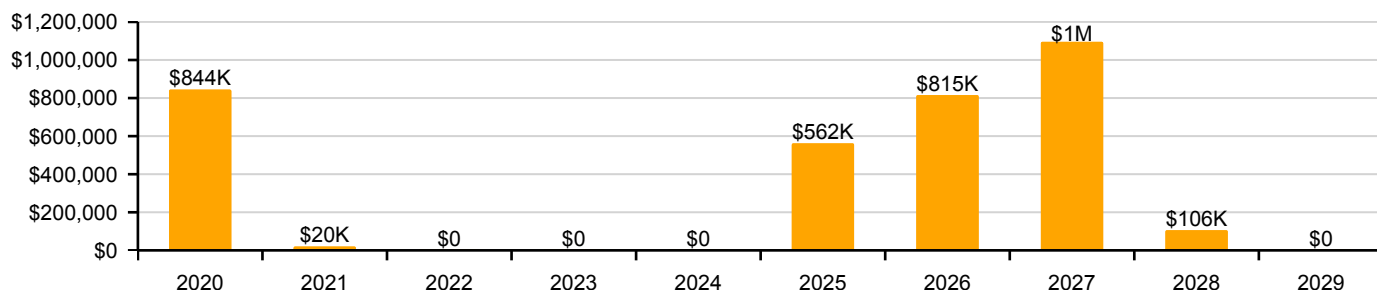

## Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

| UNIFORMAT Classification    | RSLI %         | FCI %          | Current Repair Cost   |
|-----------------------------|----------------|----------------|-----------------------|
| A10 - Foundations           | 48.00 %        | 0.00 %         | \$0.00                |
| B10 - Superstructure        | 48.00 %        | 0.00 %         | \$0.00                |
| B20 - Exterior Enclosure    | 37.97 %        | 0.00 %         | \$0.00                |
| B30 - Roofing               | 5.08 %         | 0.00 %         | \$0.00                |
| C10 - Interior Construction | 35.62 %        | 24.49 %        | \$153,781.00          |
| C20 - Stairs                | 48.00 %        | 0.00 %         | \$0.00                |
| C30 - Interior Finishes     | 14.33 %        | 63.37 %        | \$521,052.00          |
| D10 - Conveying             | 0.00 %         | 110.00 %       | \$74,355.00           |
| D20 - Plumbing              | 8.56 %         | 80.84 %        | \$392,056.00          |
| D30 - HVAC                  | 59.03 %        | 0.00 %         | \$0.00                |
| D40 - Fire Protection       | 40.00 %        | 0.00 %         | \$0.00                |
| D50 - Electrical            | 12.50 %        | 72.20 %        | \$840,442.00          |
| E10 - Equipment             | 30.00 %        | 0.00 %         | \$0.00                |
| E20 - Furnishings           | 30.00 %        | 0.00 %         | \$0.00                |
| <b>Totals:</b>              | <b>35.34 %</b> | <b>22.06 %</b> | <b>\$1,981,686.00</b> |



## Photo Album

The photo album consists of the various cardinal compass directions of the building..

1). South Elevation - Feb 20, 2020



2). East Elevation - Feb 20, 2020



3). North Elevation - Feb 20, 2020



4). West Elevation - Feb 20, 2020



## Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment)
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system as new construction.

## School Assessment Report - 1967 Bldg 2010

### System Listing

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

| System Code | System Description              | Unit Price \$ | UoM  | Qty    | Life | Year Installed | Calc Next Renewal Year | Next Renewal Year | RSLI%   | FCI%     | RSL | eCR | Deficiency \$ | Replacement Value \$ |
|-------------|---------------------------------|---------------|------|--------|------|----------------|------------------------|-------------------|---------|----------|-----|-----|---------------|----------------------|
| A1010       | Standard Foundations            | \$7.56        | S.F. | 51,209 | 100  | 1967           | 2067                   |                   | 48.00 % | 0.00 %   | 48  |     |               | \$387,140            |
| A1030       | Slab on Grade                   | \$6.38        | S.F. | 51,209 | 100  | 1967           | 2067                   |                   | 48.00 % | 0.00 %   | 48  |     |               | \$326,713            |
| B1010       | Floor Construction              | \$19.28       | S.F. | 51,209 | 100  | 1967           | 2067                   |                   | 48.00 % | 0.00 %   | 48  |     |               | \$987,310            |
| B1020       | Roof Construction               | \$12.47       | S.F. | 51,209 | 100  | 1967           | 2067                   |                   | 48.00 % | 0.00 %   | 48  |     |               | \$638,576            |
| B2010       | Exterior Walls                  | \$14.19       | S.F. | 51,209 | 100  | 1967           | 2067                   |                   | 48.00 % | 0.00 %   | 48  |     |               | \$726,656            |
| B2020       | Exterior Windows                | \$8.85        | S.F. | 51,209 | 30   | 1996           | 2026                   |                   | 23.33 % | 0.00 %   | 7   |     |               | \$453,200            |
| B2030       | Exterior Doors                  | \$0.87        | S.F. | 51,209 | 30   | 1996           | 2026                   |                   | 23.33 % | 0.00 %   | 7   |     |               | \$44,552             |
| B3010105    | Built-Up                        | \$7.15        | S.F. | 49,596 | 25   | 1995           | 2020                   |                   | 4.00 %  | 0.00 %   | 1   |     |               | \$354,611            |
| B3020       | Roof Openings                   | \$0.52        | S.F. | 49,596 | 30   | 1995           | 2025                   |                   | 20.00 % | 0.00 %   | 6   |     |               | \$25,790             |
| C1010       | Partitions                      | \$5.77        | S.F. | 51,209 | 100  | 1967           | 2067                   |                   | 48.00 % | 0.00 %   | 48  |     |               | \$295,476            |
| C1020       | Interior Doors                  | \$3.76        | S.F. | 51,209 | 40   | 1996           | 2036                   |                   | 42.50 % | 0.00 %   | 17  |     |               | \$192,546            |
| C1030       | Fittings                        | \$2.73        | S.F. | 51,209 | 20   | 1996           | 2016                   |                   | 0.00 %  | 110.00 % | -3  |     | \$153,781.00  | \$139,801            |
| C2010       | Stair Construction              | \$2.92        | S.F. | 51,209 | 100  | 1967           | 2067                   |                   | 48.00 % | 0.00 %   | 48  |     |               | \$149,530            |
| C3010220    | Tile                            | \$9.25        | S.F. | 1,172  | 30   | 1996           | 2026                   |                   | 23.33 % | 0.00 %   | 7   |     |               | \$10,841             |
| C3010230    | Paint & Covering                | \$1.47        | S.F. | 50,037 | 10   | 2018           | 2028                   |                   | 90.00 % | 0.00 %   | 9   |     |               | \$73,554             |
| C3020420    | Ceramic Tile                    | \$16.74       | S.F. | 4,047  | 50   | 1996           | 2046                   |                   | 54.00 % | 0.00 %   | 27  |     |               | \$67,747             |
| C3020901    | Carpet                          | \$6.87        | S.F. | 6,476  | 12   | 1996           | 2008                   | 2020              | 8.33 %  | 0.00 %   | 1   |     |               | \$44,490             |
| C3020903    | VCT                             | \$3.48        | S.F. | 39,686 | 18   | 1996           | 2014                   | 2020              | 5.56 %  | 0.00 %   | 1   |     |               | \$138,107            |
| C3020999    | Other - Wood                    | \$13.79       | S.F. | 1,000  | 25   | 1996           | 2021                   |                   | 8.00 %  | 0.00 %   | 2   |     |               | \$13,790             |
| C3030       | Ceiling Finishes                | \$9.25        | S.F. | 51,209 | 20   | 1996           | 2016                   |                   | 0.00 %  | 110.00 % | -3  |     | \$521,052.00  | \$473,683            |
| D1010       | Elevators and Lifts             | \$1.32        | S.F. | 51,209 | 20   | 1996           | 2016                   |                   | 0.00 %  | 110.00 % | -3  |     | \$74,355.00   | \$67,596             |
| D2010       | Plumbing Fixtures               | \$6.55        | S.F. | 51,209 | 20   | 1996           | 2016                   |                   | 0.00 %  | 110.00 % | -3  |     | \$368,961.00  | \$335,419            |
| D2020       | Domestic Water Distribution     | \$0.75        | S.F. | 51,209 | 30   | 2005           | 2035                   |                   | 53.33 % | 0.00 %   | 16  |     |               | \$38,407             |
| D2030       | Sanitary Waste                  | \$1.76        | S.F. | 51,209 | 30   | 1996           | 2026                   |                   | 23.33 % | 0.00 %   | 7   |     |               | \$90,128             |
| D2040       | Rain Water Drainage             | \$0.41        | S.F. | 51,209 | 20   | 1996           | 2016                   |                   | 0.00 %  | 110.00 % | -3  |     | \$23,095.00   | \$20,996             |
| D3020       | Heat Generating Systems         | \$3.71        | S.F. | 51,209 | 20   | 2012           | 2032                   |                   | 65.00 % | 0.00 %   | 13  |     |               | \$189,985            |
| D3040       | Distribution Systems            | \$10.96       | S.F. | 51,209 | 20   | 2012           | 2032                   |                   | 65.00 % | 0.00 %   | 13  |     |               | \$561,251            |
| D3050       | Terminal & Package Units        | \$13.07       | S.F. | 51,209 | 15   | 2012           | 2027                   |                   | 53.33 % | 0.00 %   | 8   |     |               | \$669,302            |
| D3060       | Controls & Instrumentation      | \$2.28        | S.F. | 51,209 | 15   | 2012           | 2027                   |                   | 53.33 % | 0.00 %   | 8   |     |               | \$116,757            |
| D4030       | Fire Protection Specialties     | \$0.09        | S.F. | 51,209 | 15   | 2010           | 2025                   |                   | 40.00 % | 0.00 %   | 6   |     |               | \$4,609              |
| D4090       | Other Fire Protection Systems   | \$0.61        | S.F. | 51,209 | 15   | 2010           | 2025                   |                   | 40.00 % | 0.00 %   | 6   |     |               | \$31,237             |
| D5010       | Electrical Service/Distribution | \$2.37        | S.F. | 51,209 | 20   | 1987           | 2007                   |                   | 0.00 %  | 110.00 % | -12 |     | \$133,502.00  | \$121,365            |

# School Assessment Report - 1967 Bldg 2010

| System Code  | System Description           | Unit Price \$ | UoM  | Qty    | Life | Year Installed | Calc Next Renewal Year | Next Renewal Year | RSLI%          | FCI%           | RSL | eCR | Deficiency \$         | Replacement Value \$ |
|--------------|------------------------------|---------------|------|--------|------|----------------|------------------------|-------------------|----------------|----------------|-----|-----|-----------------------|----------------------|
| D5020        | Branch Wiring                | \$4.88        | S.F. | 51,209 | 20   | 1987           | 2007                   |                   | 0.00 %         | 110.00 %       | -12 |     | \$274,890.00          | \$249,900            |
| D5020        | Lighting                     | \$7.32        | S.F. | 51,209 | 20   | 1987           | 2007                   |                   | 0.00 %         | 110.00 %       | -12 |     | \$412,335.00          | \$374,850            |
| D5030810     | Security & Detection Systems | \$1.51        | S.F. | 51,209 | 20   | 2005           | 2025                   |                   | 30.00 %        | 0.00 %         | 6   |     |                       | \$77,326             |
| D5030910     | Fire Alarm Systems           | \$2.74        | S.F. | 51,209 | 20   | 2005           | 2025                   |                   | 30.00 %        | 0.00 %         | 6   |     |                       | \$140,313            |
| D5030920     | Data Communication           | \$3.56        | S.F. | 51,209 | 25   | 2005           | 2030                   |                   | 44.00 %        | 0.00 %         | 11  |     |                       | \$182,304            |
| D5090        | Other Electrical Systems     | \$0.35        | S.F. | 51,209 | 15   | 1987           | 2002                   |                   | 0.00 %         | 110.00 %       | -17 |     | \$19,715.00           | \$17,923             |
| E1020        | Institutional Equipment      | \$0.09        | S.F. | 51,209 | 20   | 2005           | 2025                   |                   | 30.00 %        | 0.00 %         | 6   |     |                       | \$4,609              |
| E1090        | Other Equipment              | \$0.82        | S.F. | 51,209 | 20   | 2005           | 2025                   |                   | 30.00 %        | 0.00 %         | 6   |     |                       | \$41,991             |
| E2010        | Fixed Furnishings            | \$1.99        | S.F. | 51,209 | 20   | 2005           | 2025                   |                   | 30.00 %        | 0.00 %         | 6   |     |                       | \$101,906            |
| <b>Total</b> |                              |               |      |        |      |                |                        |                   | <b>35.34 %</b> | <b>22.06 %</b> |     |     | <b>\$1,981,686.00</b> | <b>\$8,982,287</b>   |



## System Notes

The facility description in the executive summary contains an overview of each system. The system notes listed below provide additional information on select systems found within the facility.

---

**System:** B2010 - Exterior Walls



**Note:**

---

**System:** B2020 - Exterior Windows



**Note:**

---

**System:** B2030 - Exterior Doors



**Note:**



## School Assessment Report - 1967 Bldg 2010

**System:** B3010105 - Built-Up



**Note:**

**System:** B3020 - Roof Openings



**Note:**

**System:** C1010 - Partitions



**Note:**



## School Assessment Report - 1967 Bldg 2010

### System: C1020 - Interior Doors





### Note:

### System: C1030 - Fittings



### Note:

### System: C2010 - Stair Construction

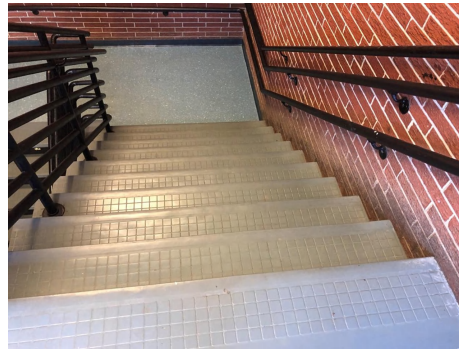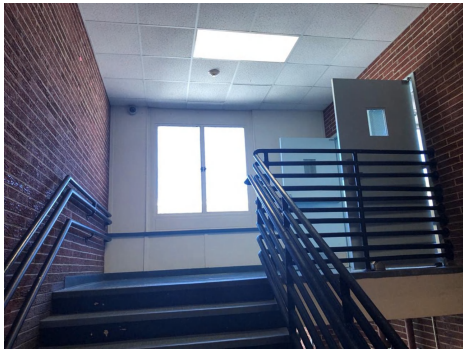

### Note:



## School Assessment Report - 1967 Bldg 2010

**System:** C3010220 - Tile



**Note:**

**System:** C3010230 - Paint & Covering

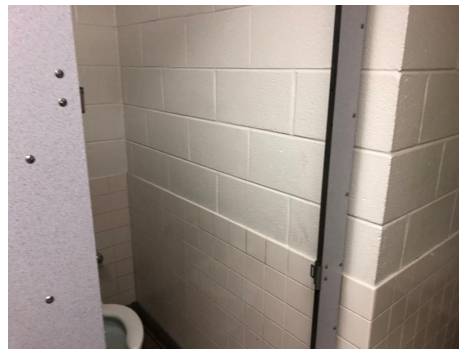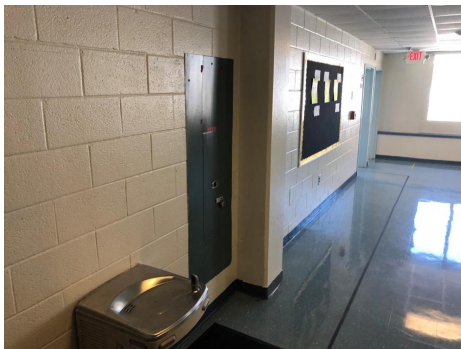

**Note:**

**System:** C3020420 - Ceramic Tile



**Note:**




## School Assessment Report - 1967 Bldg 2010

**System:** C3020901 - Carpet



**Note:**

**System:** C3020903 - VCT

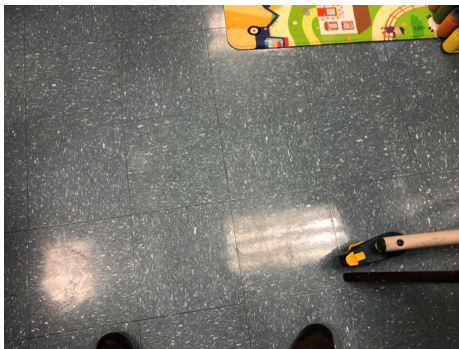

**Note:**


**System:** C3020999 - Other - Wood



**Note:**

## School Assessment Report - 1967 Bldg 2010

### System: C3030 - Ceiling Finishes

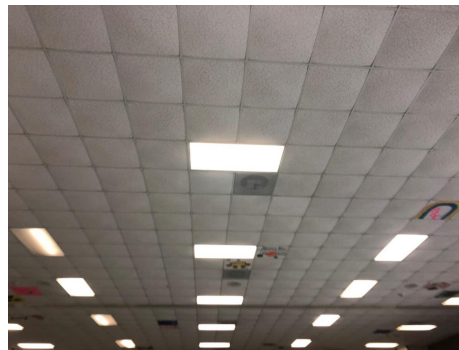

### Note:

### System: D1010 - Elevators and Lifts



### Note:

### System: D2010 - Plumbing Fixtures



### Note:



## School Assessment Report - 1967 Bldg 2010

**System:** D2020 - Domestic Water Distribution



**Note:**

**System:** D2030 - Sanitary Waste



**Note:**

**System:** D2040 - Rain Water Drainage



**Note:**



## School Assessment Report - 1967 Bldg 2010

### System: D3020 - Heat Generating Systems



**Note:**

### System: D3040 - Distribution Systems



**Note:**

### System: D3050 - Terminal & Package Units



**Note:**





## School Assessment Report - 1967 Bldg 2010

### System: D3060 - Controls & Instrumentation



### Note:

### System: D4030 - Fire Protection Specialties

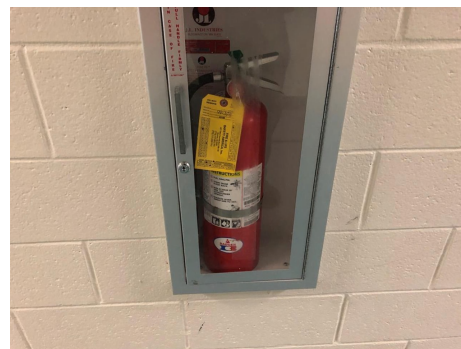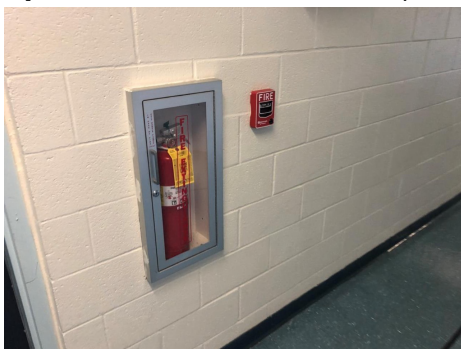

### Note:


### System: D4090 - Other Fire Protection Systems



### Note:


## School Assessment Report - 1967 Bldg 2010

**System:** D5010 - Electrical Service/Distribution

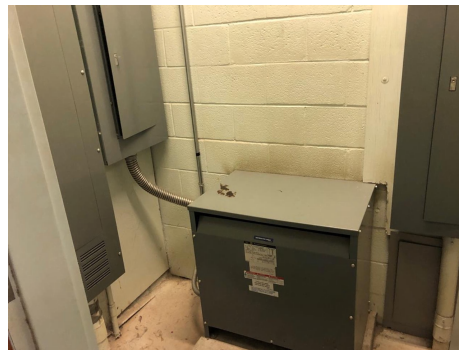

**Note:**

**System:** D5020 - Branch Wiring

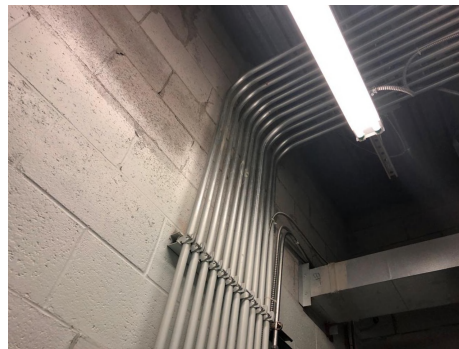

**Note:**

**System:** D5020 - Lighting




**Note:**



## School Assessment Report - 1967 Bldg 2010

### System: D5030810 - Security & Detection Systems

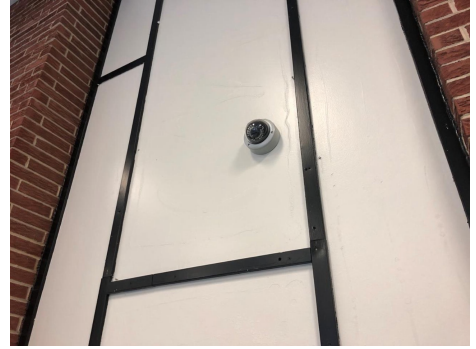

Note:

### System: D5030910 - Fire Alarm Systems



Note:

### System: D5030920 - Data Communication



Note:



## School Assessment Report - 1967 Bldg 2010

**System:** D5090 - Other Electrical Systems



**Note:**

**System:** E1020 - Institutional Equipment



**Note:**

**System:** E1090 - Other Equipment



**Note:**

## School Assessment Report - 1967 Bldg 2010

**System:** E2010 - Fixed Furnishings



**Note:**

## Renewal Schedule

eCOMET forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the System Listing table. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.

*Inflation Rate: 3%*

| System                         | Current Deficiencies | 2020             | 2021            | 2022       | 2023       | 2024       | 2025             | 2026             | 2027               | 2028             | 2029       | Total              |
|--------------------------------|----------------------|------------------|-----------------|------------|------------|------------|------------------|------------------|--------------------|------------------|------------|--------------------|
| <b>Total:</b>                  | <b>\$1,981,686</b>   | <b>\$844,337</b> | <b>\$20,043</b> | <b>\$0</b> | <b>\$0</b> | <b>\$0</b> | <b>\$561,873</b> | <b>\$815,320</b> | <b>\$1,095,330</b> | <b>\$105,569</b> | <b>\$0</b> | <b>\$5,424,159</b> |
| * A - Substructure             | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| * A10 - Foundations            | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| * A1010 - Standard Foundations | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| * A1030 - Slab on Grade        | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| B - Shell                      | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| B10 - Superstructure           | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| * B1010 - Floor Construction   | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| * B1020 - Roof Construction    | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| B20 - Exterior Enclosure       | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| * B2010 - Exterior Walls       | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| B2020 - Exterior Windows       | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$613,117        | \$0                | \$0              | \$0        | \$613,117          |
| B2030 - Exterior Doors         | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$60,272         | \$0                | \$0              | \$0        | \$60,272           |
| B30 - Roofing                  | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| B3010 - Roof Coverings         | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| B3010105 - Built-Up            | \$0                  | \$573,442        | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$573,442          |
| B3020 - Roof Openings          | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$33,874         | \$0              | \$0                | \$0              | \$0        | \$33,874           |
| C - Interiors                  | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| C10 - Interior Construction    | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| C1010 - Partitions             | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| C1020 - Interior Doors         | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| C1030 - Fittings               | \$153,781            | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$153,781          |
| C20 - Stairs                   | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| * C2010 - Stair Construction   | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| C30 - Interior Finishes        | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |
| C3010 - Wall Finishes          | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0              | \$0              | \$0                | \$0              | \$0        | \$0                |

# School Assessment Report - 1967 Bldg 2010

| System                                  | Current Deficiencies | 2020      | 2021     | 2022 | 2023 | 2024 | 2025      | 2026      | 2027      | 2028      | 2029 | Total     |
|---|----------------------|-----------|----------|------|------|------|-----------|-----------|-----------|-----------|------|-----------|
| C3010220 - Tile                         | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$20,000  | \$0       | \$0       | \$0  | \$20,000  |
| C3010230 - Paint & Covering             | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$105,569 | \$0  | \$105,569 |
| C3020 - Floor Finishes                  | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$0       |
| C3020420 - Ceramic Tile                 | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$0       |
| C3020901 - Carpet                       | \$0                  | \$50,407  | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$50,407  |
| C3020903 - VCT                          | \$0                  | \$220,488 | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$220,488 |
| C3020999 - Other - Wood                 | \$0                  | \$0       | \$20,043 | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$20,043  |
| C3030 - Ceiling Finishes                | \$521,052            | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$521,052 |
| D - Services                            | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$0       |
| D10 - Conveying                         | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$0       |
| D1010 - Elevators and Lifts             | \$74,355             | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$74,355  |
| D20 - Plumbing                          | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$0       |
| D2010 - Plumbing Fixtures               | \$368,961            | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$368,961 |
| D2020 - Domestic Water Distribution     | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$0       |
| D2030 - Sanitary Waste                  | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$121,931 | \$0       | \$0       | \$0  | \$121,931 |
| D2040 - Rain Water Drainage             | \$23,095             | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$23,095  |
| D30 - HVAC                              | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$0       |
| D3020 - Heat Generating Systems         | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$0       |
| D3040 - Distribution Systems            | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$0       |
| D3050 - Terminal & Package Units        | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$932,637 | \$0       | \$0  | \$932,637 |
| D3060 - Controls & Instrumentation      | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$162,694 | \$0       | \$0  | \$162,694 |
| D40 - Fire Protection                   | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$0       |
| D4030 - Fire Protection Specialties     | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$6,054   | \$0       | \$0       | \$0       | \$0  | \$6,054   |
| D4090 - Other Fire Protection Systems   | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$41,029  | \$0       | \$0       | \$0       | \$0  | \$41,029  |
| D50 - Electrical                        | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$0       |
| D5010 - Electrical Service/Distribution | \$133,502            | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$133,502 |
| D5020 - Branch Wiring                   | \$274,890            | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$274,890 |
| D5020 - Lighting                        | \$412,335            | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$412,335 |
| D5030 - Communications and Security     | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$0       |
| D5030810 - Security & Detection Systems | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$101,564 | \$0       | \$0       | \$0       | \$0  | \$101,564 |
| D5030910 - Fire Alarm Systems           | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$184,295 | \$0       | \$0       | \$0       | \$0  | \$184,295 |
| D5030920 - Data Communication           | \$0                  | \$0       | \$0      | \$0  | \$0  | \$0  | \$0       | \$0       | \$0       | \$0       | \$0  | \$0       |


## School Assessment Report - 1967 Bldg 2010

| System                           | Current Deficiencies | 2020 | 2021 | 2022 | 2023 | 2024 | 2025      | 2026 | 2027 | 2028 | 2029 | Total     |
|----------------------------------|----------------------|------|------|------|------|------|-----------|------|------|------|------|-----------|
| D5090 - Other Electrical Systems | \$19,715             | \$0  | \$0  | \$0  | \$0  | \$0  | \$0       | \$0  | \$0  | \$0  | \$0  | \$19,715  |
| E - Equipment & Furnishings      | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0       | \$0  | \$0  | \$0  | \$0  | \$0       |
| E10 - Equipment                  | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0       | \$0  | \$0  | \$0  | \$0  | \$0       |
| E1020 - Institutional Equipment  | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$6,054   | \$0  | \$0  | \$0  | \$0  | \$6,054   |
| E1090 - Other Equipment          | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$55,154  | \$0  | \$0  | \$0  | \$0  | \$55,154  |
| E20 - Furnishings                | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0       | \$0  | \$0  | \$0  | \$0  | \$0       |
| E2010 - Fixed Furnishings        | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$133,850 | \$0  | \$0  | \$0  | \$0  | \$133,850 |

\* Indicates non-renewable system

## Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and forecasted capital renewal (sustainment) requirements over the next ten years.

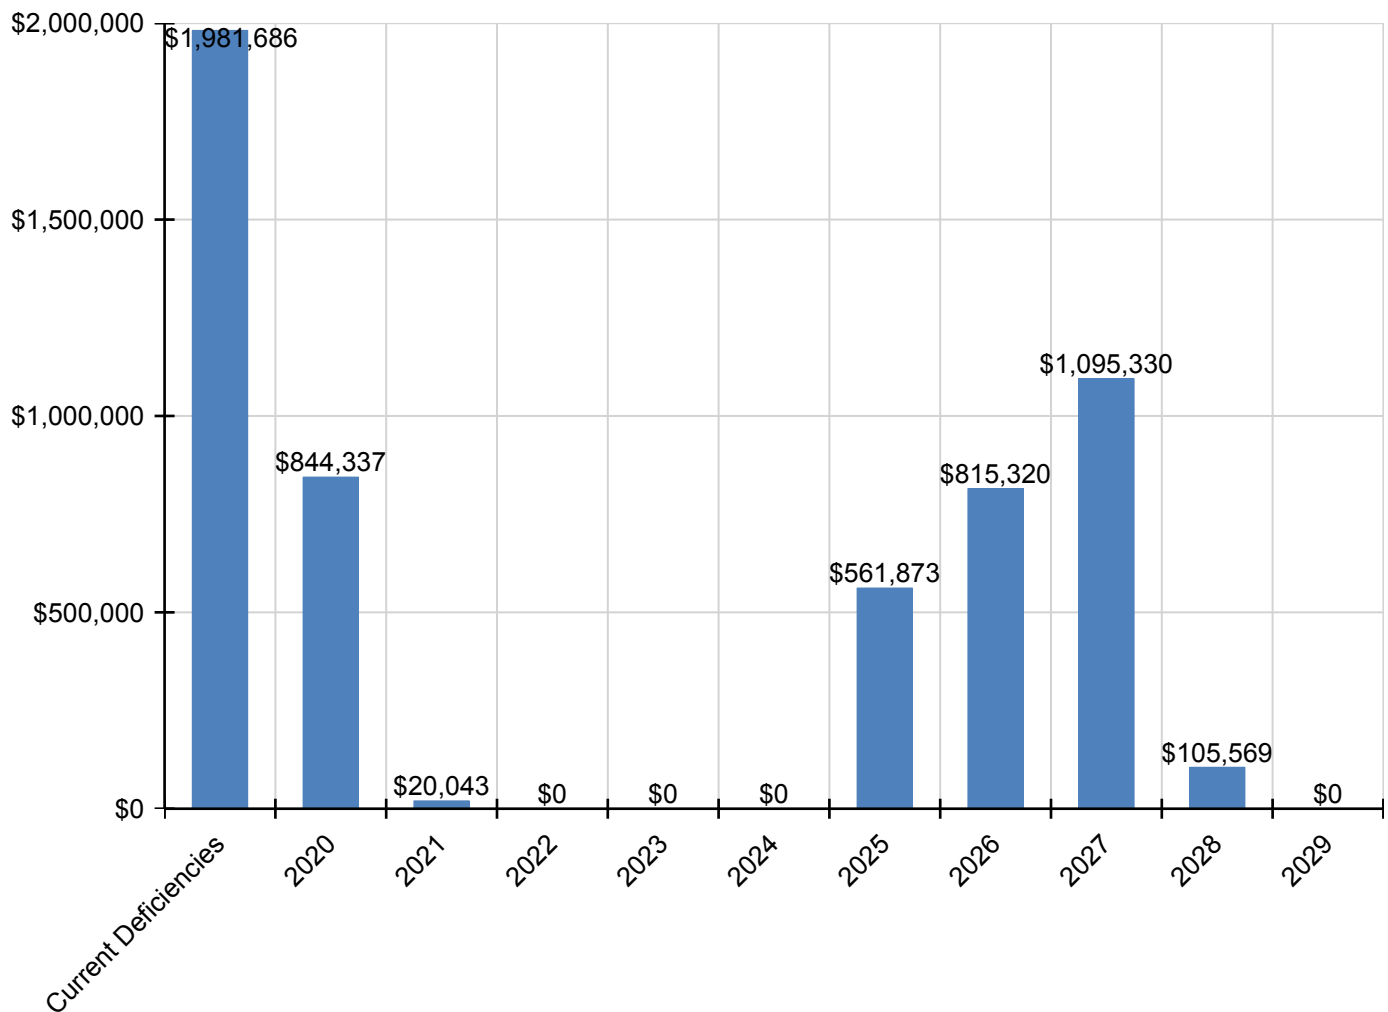




## Condition Index Forecast by Investment Scenario

The chart below illustrates the effect of various investment levels on the building FCI for the next 10 years. The levels of investment shown below include:

- Current FCI: a variable investment amount based on renewing expired systems to maintain the current FCI for the building
- 2% Investment: an annual investment of 2% of the replacement value of the building, escalated for inflation
- 4% Investment: an annual investment of 4% of the replacement value of the building, escalated for inflation

**Facility Investment vs. FCI Forecast**

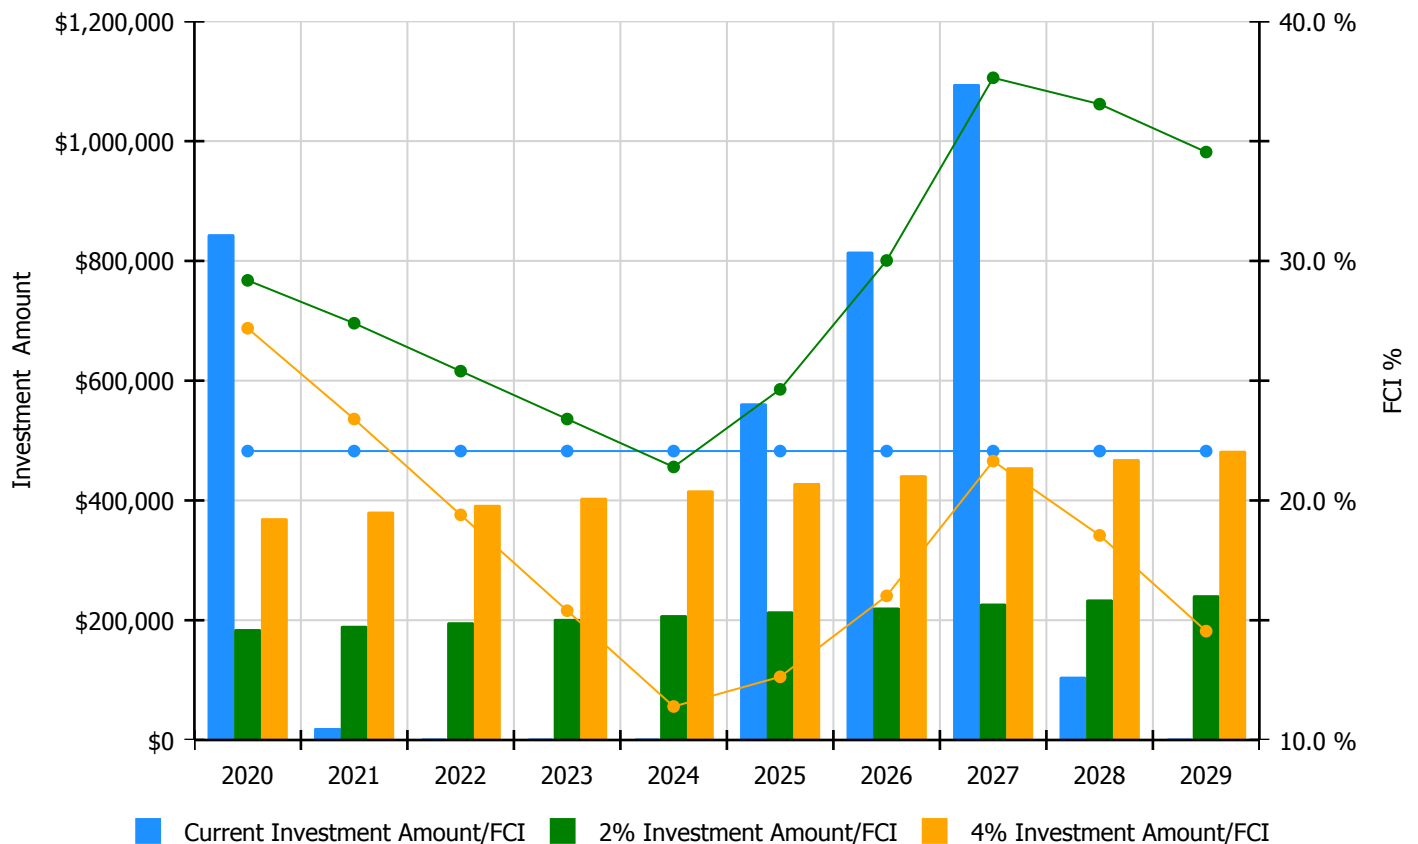


| Year          | Investment Amount<br>Current FCI - 22.06% | 2% Investment         |         | 4% Investment         |         |
|---------------|---|-----------------------|---------|-----------------------|---------|
|               |   | Amount                | FCI     | Amount                | FCI     |
| 2020          | \$844,337                                 | \$185,035.00          | 29.19 % | \$370,070.00          | 27.19 % |
| 2021          | \$20,043                                  | \$190,586.00          | 27.40 % | \$381,172.00          | 23.40 % |
| 2022          | \$0                                       | \$196,304.00          | 25.40 % | \$392,608.00          | 19.40 % |
| 2023          | \$0                                       | \$202,193.00          | 23.40 % | \$404,386.00          | 15.40 % |
| 2024          | \$0                                       | \$208,259.00          | 21.40 % | \$416,517.00          | 11.40 % |
| 2025          | \$561,873                                 | \$214,506.00          | 24.64 % | \$429,013.00          | 12.64 % |
| 2026          | \$815,320                                 | \$220,942.00          | 30.02 % | \$441,883.00          | 16.02 % |
| 2027          | \$1,095,330                               | \$227,570.00          | 37.64 % | \$455,140.00          | 21.64 % |
| 2028          | \$105,569                                 | \$234,397.00          | 36.54 % | \$468,794.00          | 18.54 % |
| 2029          | \$0                                       | \$241,429.00          | 34.54 % | \$482,858.00          | 14.54 % |
| <b>Total:</b> | <b>\$3,442,473</b>                        | <b>\$2,121,221.00</b> |         | <b>\$4,242,441.00</b> |         |



## Deficiency Summary by System


Current deficiencies included assemblies that have reached or exceeded their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Useful Life'. The following chart lists all current deficiencies associated with this facility.

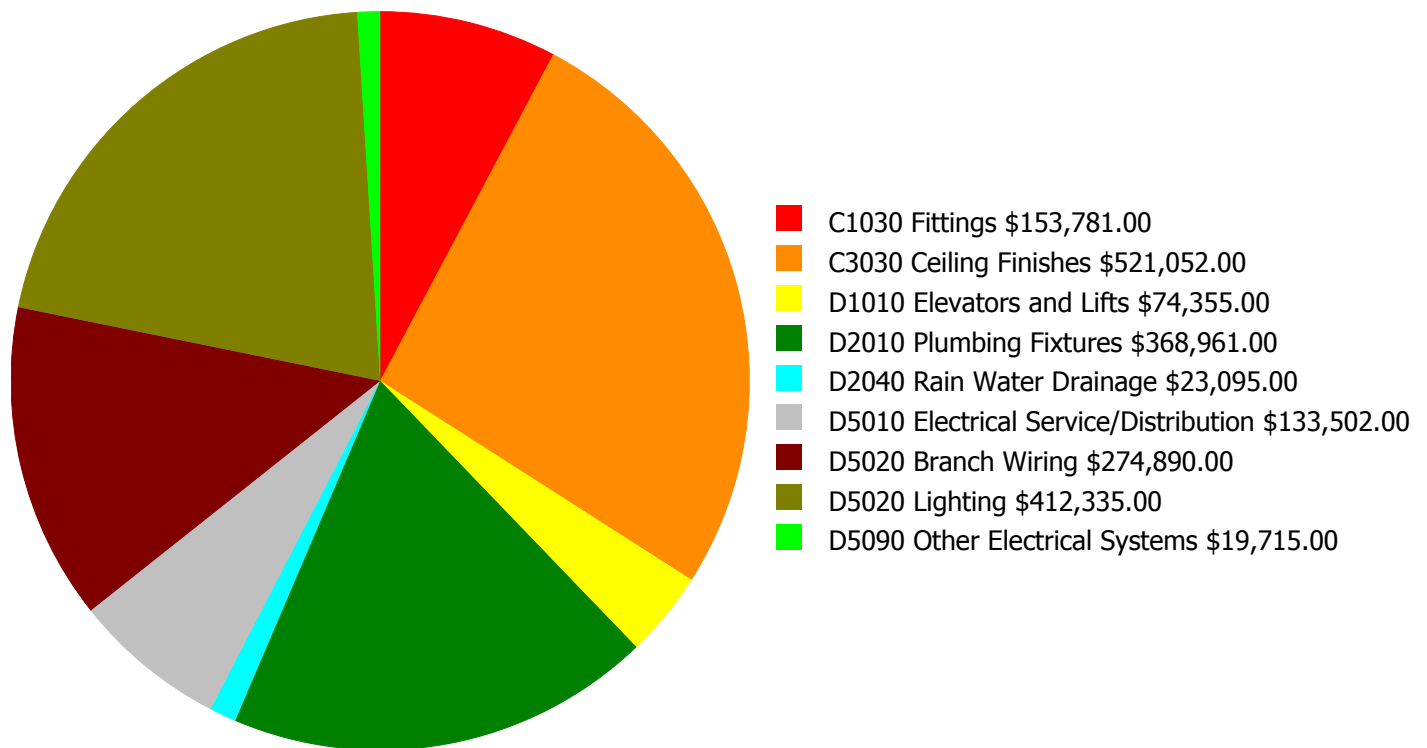

**Budget Estimate Total: \$1,981,686.00**

## Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

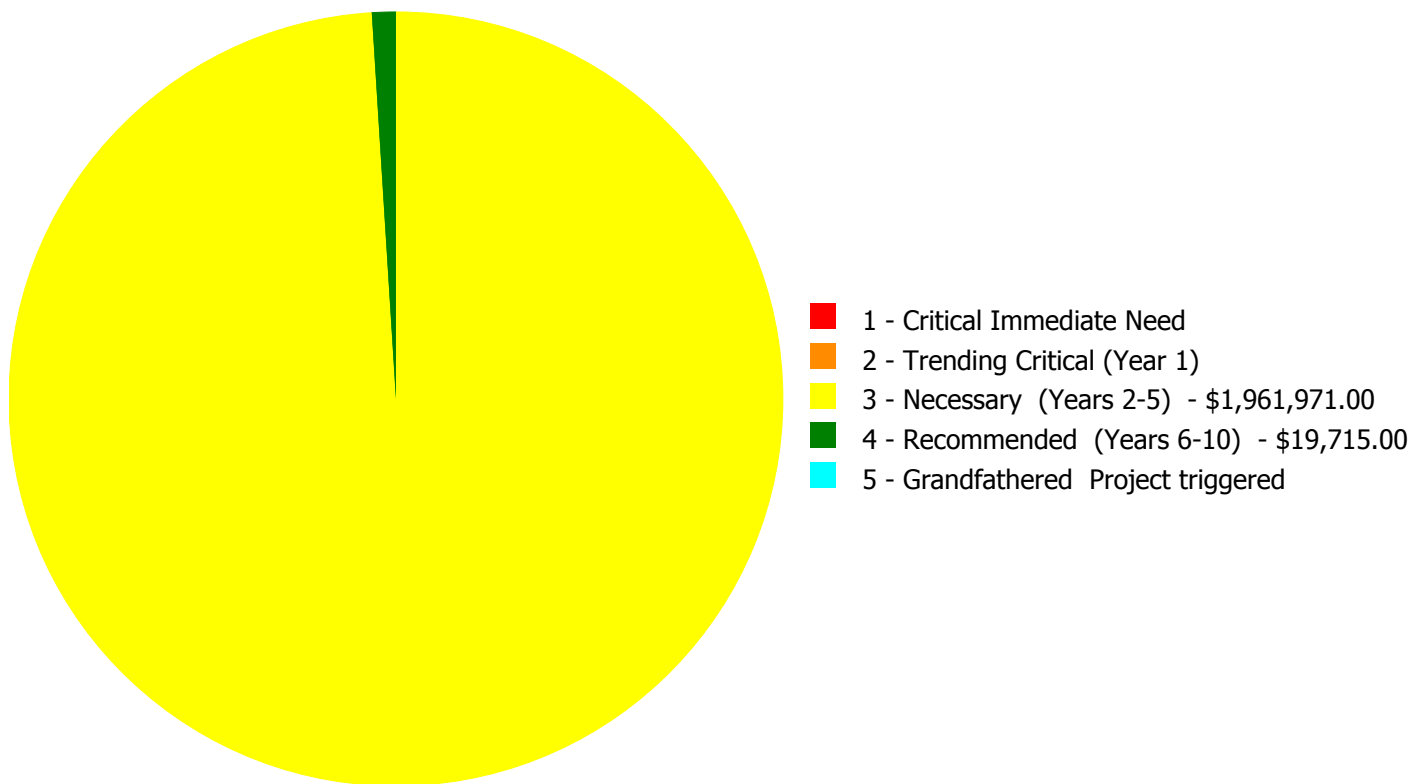

**Budget Estimate Total: \$1,981,686.00**


## Deficiency By Priority Investment Table

The table below shows the current investment cost grouped by deficiency priority and building system.

| System Code | System Description              | 1 - Critical Immediate Need | 2 - Trending Critical (Year 1) | 3 - Necessary (Years 2-5) | 4 - Recommended (Years 6-10) | 5 - Grandfathered Project triggered | Total          |
|-------------|---------------------------------|-----------------------------|--------------------------------|---------------------------|------------------------------|-------------------------------------|----------------|
| C1030       | Fittings                        | \$0.00                      | \$0.00                         | \$153,781.00              | \$0.00                       | \$0.00                              | \$153,781.00   |
| C3030       | Ceiling Finishes                | \$0.00                      | \$0.00                         | \$521,052.00              | \$0.00                       | \$0.00                              | \$521,052.00   |
| D1010       | Elevators and Lifts             | \$0.00                      | \$0.00                         | \$74,355.00               | \$0.00                       | \$0.00                              | \$74,355.00    |
| D2010       | Plumbing Fixtures               | \$0.00                      | \$0.00                         | \$368,961.00              | \$0.00                       | \$0.00                              | \$368,961.00   |
| D2040       | Rain Water Drainage             | \$0.00                      | \$0.00                         | \$23,095.00               | \$0.00                       | \$0.00                              | \$23,095.00    |
| D5010       | Electrical Service/Distribution | \$0.00                      | \$0.00                         | \$133,502.00              | \$0.00                       | \$0.00                              | \$133,502.00   |
| D5020       | Branch Wiring                   | \$0.00                      | \$0.00                         | \$274,890.00              | \$0.00                       | \$0.00                              | \$274,890.00   |
| D5020       | Lighting                        | \$0.00                      | \$0.00                         | \$412,335.00              | \$0.00                       | \$0.00                              | \$412,335.00   |
| D5090       | Other Electrical Systems        | \$0.00                      | \$0.00                         | \$0.00                    | \$19,715.00                  | \$0.00                              | \$19,715.00    |
|             | <b>Total:</b>                   | \$0.00                      | \$0.00                         | \$1,961,971.00            | \$19,715.00                  | \$0.00                              | \$1,981,686.00 |

## Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

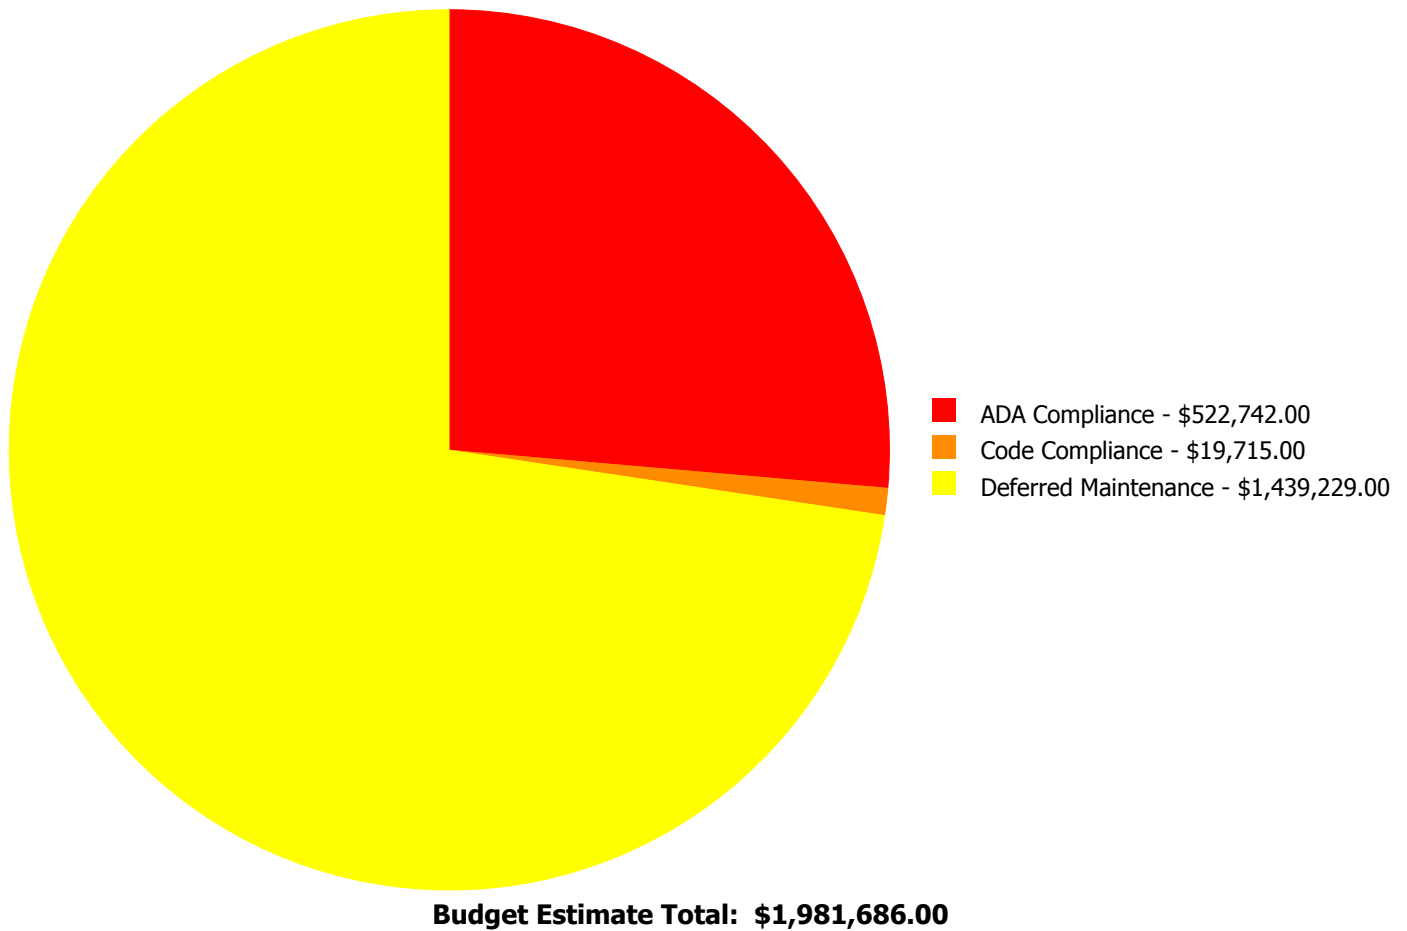

## Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

### Priority 3 - Necessary (Years 2-5):

#### System: C1030 - Fittings



**Location:** Throughout Building  
**Distress:** Beyond Expected Life  
**Category:** ADA Compliance  
**Priority:** 3 - Necessary (Years 2-5)  
**Correction:** Renew System  
**Qty:** 51,209.00  
**Unit of Measure:** S.F.  
**Estimate:** \$153,781.00  
**Assessor Name:** Hayden Collins  
**Date Created:** 08/13/2013

**Notes:** Fittings, such as toilet partitions, lockers, signage and railing, are beyond their expected service life, worn and damaged in areas, and should be replaced and upgraded for compliance with ADA standards.

---

#### System: C3030 - Ceiling Finishes



**Location:** Throughout Building  
**Distress:** Beyond Expected Life  
**Category:** Deferred Maintenance  
**Priority:** 3 - Necessary (Years 2-5)  
**Correction:** Renew System  
**Qty:** 51,209.00  
**Unit of Measure:** S.F.  
**Estimate:** \$521,052.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 09/27/2019

**Notes:** The applied ceiling finish is beyond its expected life cycle and should be replaced.

---

**System: D1010 - Elevators and Lifts**



**Location:** Main corridor  
**Distress:** Beyond Expected Life  
**Category:** Deferred Maintenance  
**Priority:** 3 - Necessary (Years 2-5)  
**Correction:** Renew System  
**Qty:** 51,209.00  
**Unit of Measure:** S.F.  
**Estimate:** \$74,355.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 09/27/2019

**Notes:** The elevator system has exceeded its life cycle and recommended for upgrade. All aspects of the current ADA standards are expected to be included in the new installation.

---

**System: D2010 - Plumbing Fixtures**



**Location:** restrooms  
**Distress:** Beyond Expected Life  
**Category:** ADA Compliance  
**Priority:** 3 - Necessary (Years 2-5)  
**Correction:** Renew System  
**Qty:** 51,209.00  
**Unit of Measure:** S.F.  
**Estimate:** \$368,961.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 09/27/2019

**Notes:** Plumbing fixtures are beyond their expected service life and should be replaced and upgraded for ADA compliance.

---

**System: D2040 - Rain Water Drainage**



**Location:** Rooftop  
**Distress:** Beyond Expected Life  
**Category:** Deferred Maintenance  
**Priority:** 3 - Necessary (Years 2-5)  
**Correction:** Renew System  
**Qty:** 51,209.00  
**Unit of Measure:** S.F.  
**Estimate:** \$23,095.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 08/13/2013

**Notes:** The rain water drains that support the water runoff from the roof are functional, However, the drains have exceeded their expected life cycle and should be replaced.

---

**System: D5010 - Electrical Service/Distribution**



**Location:** Throughout Building  
**Distress:** Beyond Expected Life  
**Category:** Deferred Maintenance  
**Priority:** 3 - Necessary (Years 2-5)  
**Correction:** Renew System  
**Qty:** 51,209.00  
**Unit of Measure:** S.F.  
**Estimate:** \$133,502.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 08/13/2014

**Notes:** The electrical service/distribution system is beyond its expected service life and should be scheduled for replacement.

---



**System: D5020 - Branch Wiring**



**Location:** Throughout Building  
**Distress:** Beyond Expected Life  
**Category:** Deferred Maintenance  
**Priority:** 3 - Necessary (Years 2-5)  
**Correction:** Renew System  
**Qty:** 51,209.00  
**Unit of Measure:** S.F.  
**Estimate:** \$274,890.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 08/13/2014

**Notes:** The branch wiring system is operational but beyond its expected service life and should be replaced.

---

**System: D5020 - Lighting**



**Location:** Throughout Building  
**Distress:** Beyond Expected Life  
**Category:** Deferred Maintenance  
**Priority:** 3 - Necessary (Years 2-5)  
**Correction:** Renew System  
**Qty:** 51,209.00  
**Unit of Measure:** S.F.  
**Estimate:** \$412,335.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 01/27/2020

**Notes:** The lighting system is operational but beyond its expected service life and should be replaced.

---

**Priority 4 - Recommended (Years 6-10):**



**System: D5090 - Other Electrical Systems**

This deficiency has no image.

**Location:** Mechanical room and electrical rooms  
**Distress:** Missing  
**Category:** Code Compliance  
**Priority:** 4 - Recommended (Years 6-10)  
**Correction:** Renew System  
**Qty:** 51,209.00  
**Unit of Measure:** S.F.  
**Estimate:** \$19,715.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 08/13/2013

**Notes:** No emergency generator, client standard required.

---

## Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as  $100 - \text{Total FCI}$  (without the %) where 100 is best and 0 is worst condition.

|                    |              |
|--------------------|--------------|
| Function:          | Elementary   |
| Gross Area (SF):   | 18,803       |
| Year Built:        | 1996         |
| Last Renovation:   |              |
| Replacement Value: | \$3,177,690  |
| Repair Cost:       | \$920,262.00 |
| Total FCI:         | 28.96 %      |
| Total RSLI:        | 43.53 %      |
| FCA Score:         | 71.04        |



### Description:


The narrative for this building is included in the Executive Summary Description at the front of this report.

**Attributes:** This asset has no attributes.


## Dashboard Summary

|              |            |                    |             |
|--------------|------------|--------------------|-------------|
| Function:    | Elementary | Gross Area:        | 18,803      |
| Year Built:  | 1996       | Last Renovation:   |             |
| Repair Cost: | \$920,262  | Replacement Value: | \$3,177,690 |
| FCI:         | 28.96 %    | RSLI%:             | 43.53 %     |


**Deficiency By Category**

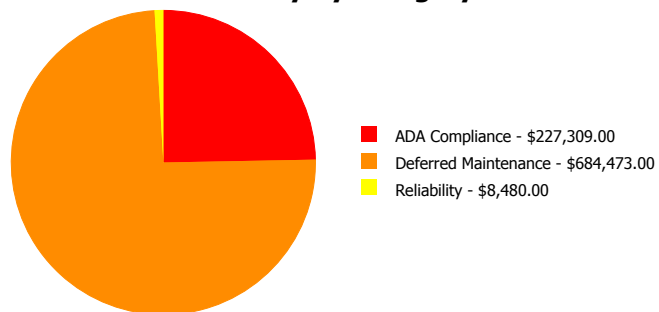


**Deficiency By Priority**

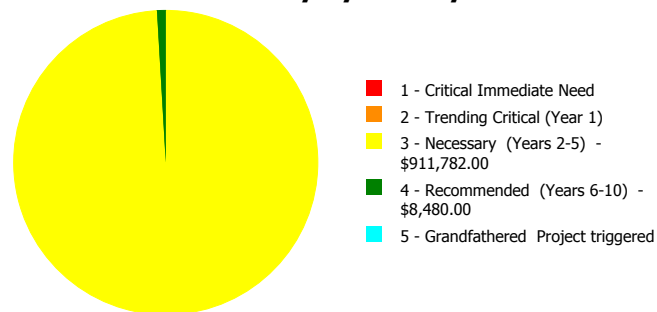

**Deficiency By System**

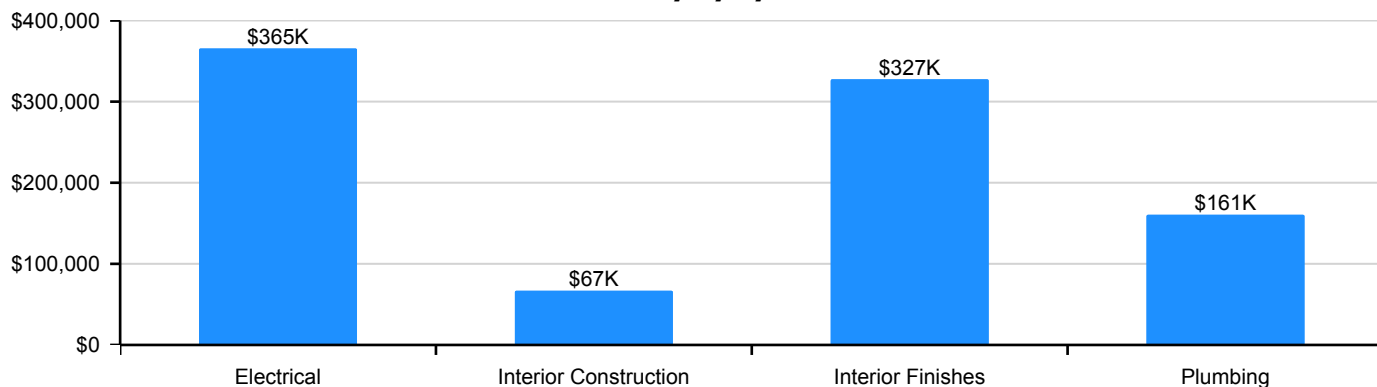

**10 Year Investment Forecast**

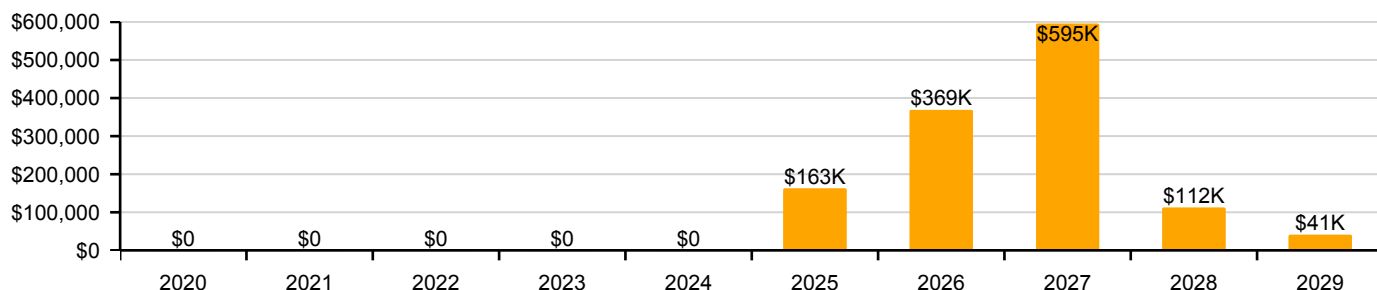

## Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

| UNIFORMAT Classification    | RSLI %         | FCI %          | Current Repair Cost |
|-----------------------------|----------------|----------------|---------------------|
| A10 - Foundations           | 77.00 %        | 0.00 %         | \$0.00              |
| B10 - Superstructure        | 77.00 %        | 0.00 %         | \$0.00              |
| B20 - Exterior Enclosure    | 55.19 %        | 0.00 %         | \$0.00              |
| B30 - Roofing               | 30.00 %        | 0.00 %         | \$0.00              |
| C10 - Interior Construction | 49.30 %        | 24.47 %        | \$66,807.00         |
| C30 - Interior Finishes     | 0.58 %         | 108.40 %       | \$327,480.00        |
| D20 - Plumbing              | 6.44 %         | 79.63 %        | \$160,502.00        |
| D30 - HVAC                  | 57.59 %        | 0.00 %         | \$0.00              |
| D40 - Fire Protection       | 53.33 %        | 0.00 %         | \$0.00              |
| D50 - Electrical            | 11.15 %        | 76.28 %        | \$365,473.00        |
| E10 - Equipment             | 65.00 %        | 0.00 %         | \$0.00              |
| E20 - Furnishings           | 30.00 %        | 0.00 %         | \$0.00              |
| <b>Totals:</b>              | <b>43.53 %</b> | <b>28.96 %</b> | <b>\$920,262.00</b> |

## Photo Album

The photo album consists of the various cardinal compass directions of the building..

1). West Elevation - Feb 20, 2020



2). South Elevation - Feb 20, 2020



3). North Elevation - Feb 20, 2020



4). East Elevation - Feb 20, 2020





## Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment)
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system as new construction.

**System Listing**

## School Assessment Report - 1996 Bldg 2020

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

| System Code  | System Description              | Unit Price \$ | UoM  | Qty    | Life | Year Installed | Calc Next Renewal Year | Next Renewal Year | RSLI%          | FCI%           | RSL | eCR | Deficiency \$       | Replacement Value \$ |
|--------------|---------------------------------|---------------|------|--------|------|----------------|------------------------|-------------------|----------------|----------------|-----|-----|---------------------|----------------------|
| A1010        | Standard Foundations            | \$8.99        | S.F. | 18,803 | 100  | 1996           | 2096                   |                   | 77.00 %        | 0.00 %         | 77  |     |                     | \$169,039            |
| A1030        | Slab on Grade                   | \$7.59        | S.F. | 18,803 | 100  | 1996           | 2096                   |                   | 77.00 %        | 0.00 %         | 77  |     |                     | \$142,715            |
| B1020        | Roof Construction               | \$14.78       | S.F. | 18,803 | 100  | 1996           | 2096                   |                   | 77.00 %        | 0.00 %         | 77  |     |                     | \$277,908            |
| B2010        | Exterior Walls                  | \$16.85       | S.F. | 18,803 | 100  | 1996           | 2096                   |                   | 77.00 %        | 0.00 %         | 77  |     |                     | \$316,831            |
| B2020        | Exterior Windows                | \$10.49       | S.F. | 18,803 | 30   | 1996           | 2026                   |                   | 23.33 %        | 0.00 %         | 7   |     |                     | \$197,243            |
| B2030        | Exterior Doors                  | \$1.05        | S.F. | 18,803 | 30   | 1996           | 2026                   |                   | 23.33 %        | 0.00 %         | 7   |     |                     | \$19,743             |
| B3010130     | Preformed Metal Roofing         | \$8.50        | S.F. | 6,000  | 30   | 1998           | 2028                   |                   | 30.00 %        | 0.00 %         | 9   |     |                     | \$51,000             |
| B3020        | Roof Openings                   | \$0.63        | S.F. | 18,803 | 30   | 1998           | 2028                   |                   | 30.00 %        | 0.00 %         | 9   |     |                     | \$11,846             |
| C1010        | Partitions                      | \$6.84        | S.F. | 18,803 | 100  | 1996           | 2096                   |                   | 77.00 %        | 0.00 %         | 77  |     |                     | \$128,613            |
| C1020        | Interior Doors                  | \$4.45        | S.F. | 18,803 | 40   | 1996           | 2036                   |                   | 42.50 %        | 0.00 %         | 17  |     |                     | \$83,673             |
| C1030        | Fittings                        | \$3.23        | S.F. | 18,803 | 20   | 1996           | 2016                   |                   | 0.00 %         | 110.00 %       | -3  |     | \$66,807.00         | \$60,734             |
| C3010230     | Paint & Covering                | \$1.47        | S.F. | 18,803 | 10   | 1996           | 2006                   |                   | 0.00 %         | 0.00 %         | -13 |     |                     | \$27,640             |
| C3020420     | Ceramic Tile                    | \$16.74       | S.F. | 194    | 50   | 1996           | 2046                   |                   | 54.00 %        | 0.00 %         | 27  |     |                     | \$3,248              |
| C3020903     | VCT                             | \$3.48        | S.F. | 18,609 | 15   | 1996           | 2011                   |                   | 0.00 %         | 155.00 %       | -8  |     | \$100,377.00        | \$64,759             |
| C3030        | Ceiling Finishes                | \$10.98       | S.F. | 18,803 | 20   | 1996           | 2016                   |                   | 0.00 %         | 110.00 %       | -3  |     | \$227,103.00        | \$206,457            |
| D2010        | Plumbing Fixtures               | \$7.76        | S.F. | 18,803 | 20   | 1996           | 2016                   |                   | 0.00 %         | 110.00 %       | -3  |     | \$160,502.00        | \$145,911            |
| D2020        | Domestic Water Distribution     | \$0.88        | S.F. | 18,803 | 30   | 1996           | 2026                   |                   | 23.33 %        | 0.00 %         | 7   |     |                     | \$16,547             |
| D2030        | Sanitary Waste                  | \$2.08        | S.F. | 18,803 | 30   | 1996           | 2026                   |                   | 23.33 %        | 0.00 %         | 7   |     |                     | \$39,110             |
| D3040        | Distribution Systems            | \$12.99       | S.F. | 18,803 | 20   | 2012           | 2032                   |                   | 65.00 %        | 0.00 %         | 13  |     |                     | \$244,251            |
| D3050        | Terminal & Package Units        | \$19.90       | S.F. | 18,803 | 15   | 2012           | 2027                   |                   | 53.33 %        | 0.00 %         | 8   |     |                     | \$374,180            |
| D3060        | Controls & Instrumentation      | \$2.70        | S.F. | 18,803 | 15   | 2012           | 2027                   |                   | 53.33 %        | 0.00 %         | 8   |     |                     | \$50,768             |
| D4030        | Fire Protection Specialties     | \$0.12        | S.F. | 18,803 | 15   | 2012           | 2027                   |                   | 53.33 %        | 0.00 %         | 8   |     |                     | \$2,256              |
| D5010        | Electrical Service/Distribution | \$2.79        | S.F. | 18,803 | 20   | 1996           | 2016                   |                   | 0.00 %         | 110.00 %       | -3  |     | \$57,706.00         | \$52,460             |
| D5020        | Branch Wiring                   | \$5.78        | S.F. | 18,803 | 20   | 1996           | 2016                   |                   | 0.00 %         | 110.00 %       | -3  |     | \$119,549.00        | \$108,681            |
| D5020        | Lighting                        | \$8.69        | S.F. | 18,803 | 20   | 1996           | 2016                   |                   | 0.00 %         | 110.00 %       | -3  |     | \$179,738.00        | \$163,398            |
| D5030810     | Security & Detection Systems    | \$1.51        | S.F. | 18,803 | 20   | 2005           | 2025                   |                   | 30.00 %        | 0.00 %         | 6   |     |                     | \$28,393             |
| D5030910     | Fire Alarm Systems              | \$2.74        | S.F. | 18,803 | 20   | 2005           | 2025                   |                   | 30.00 %        | 0.00 %         | 6   |     |                     | \$51,520             |
| D5030920     | Data Communication              | \$3.56        | S.F. | 18,803 | 25   | 2005           | 2030                   |                   | 44.00 %        | 0.00 %         | 11  |     |                     | \$66,939             |
| D5090        | Other Electrical Systems        | \$0.41        | S.F. | 18,803 | 15   | 1996           | 2011                   |                   | 0.00 %         | 110.00 %       | -8  |     | \$8,480.00          | \$7,709              |
| E1020        | Institutional Equipment         | \$0.12        | S.F. | 18,803 | 20   | 2012           | 2032                   |                   | 65.00 %        | 0.00 %         | 13  |     |                     | \$2,256              |
| E1090        | Other Equipment                 | \$0.96        | S.F. | 18,803 | 20   | 2012           | 2032                   |                   | 65.00 %        | 0.00 %         | 13  |     |                     | \$18,051             |
| E2010        | Fixed Furnishings               | \$2.33        | S.F. | 18,803 | 20   | 2005           | 2025                   |                   | 30.00 %        | 0.00 %         | 6   |     |                     | \$43,811             |
| <b>Total</b> |                                 |               |      |        |      |                |                        |                   | <b>43.53 %</b> | <b>28.96 %</b> |     |     | <b>\$920,262.00</b> | <b>\$3,177,690</b>   |

## System Notes

The facility description in the executive summary contains an overview of each system. The system notes listed below provide additional information on select systems found within the facility.

---

**System:** B2010 - Exterior Walls



**Note:**

---

**System:** B2020 - Exterior Windows



**Note:**

---

**System:** B2030 - Exterior Doors



**Note:**

## School Assessment Report - 1996 Bldg 2020

**System:** B3010130 - Preformed Metal Roofing





**Note:**

**System:** B3020 - Roof Openings



**Note:**

**System:** C1010 - Partitions

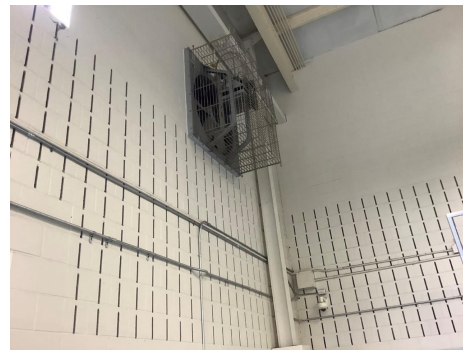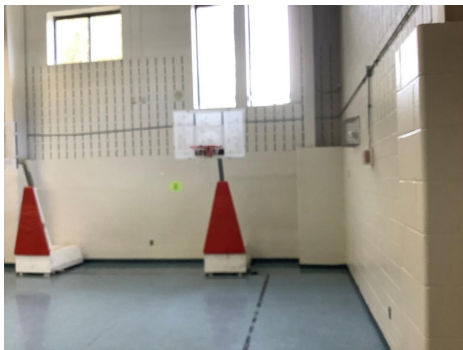


**Note:**




## School Assessment Report - 1996 Bldg 2020

### System: C1020 - Interior Doors

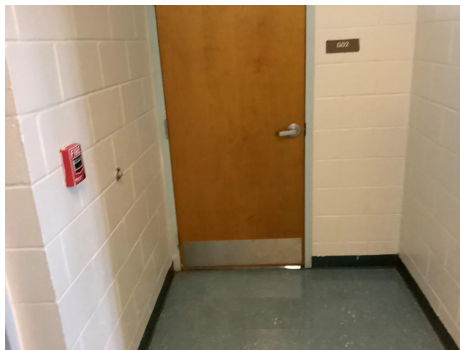

### Note:

### System: C1030 - Fittings

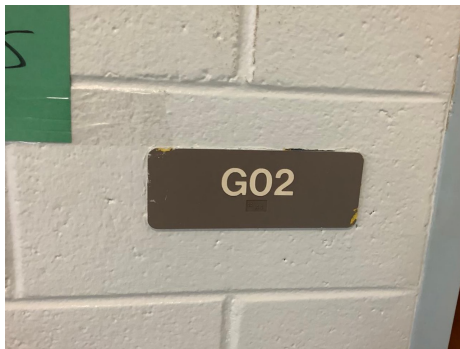

### Note:

### System: C3010230 - Paint & Covering



### Note:

## School Assessment Report - 1996 Bldg 2020

**System:** C3020420 - Ceramic Tile




**Note:**

**System:** C3020903 - VCT



**Note:**

**System:** C3030 - Ceiling Finishes

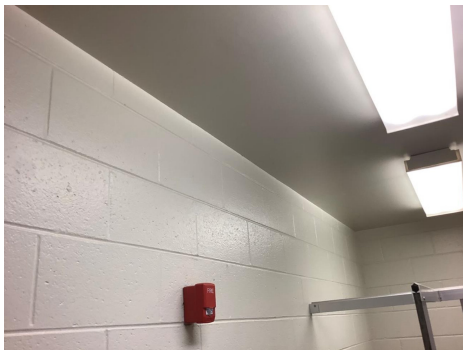

**Note:**



## School Assessment Report - 1996 Bldg 2020

**System:** D2010 - Plumbing Fixtures



**Note:**

**System:** D2020 - Domestic Water Distribution



**Note:**



**System:** D2030 - Sanitary Waste



**Note:**

## School Assessment Report - 1996 Bldg 2020

### **System:** D3040 - Distribution Systems

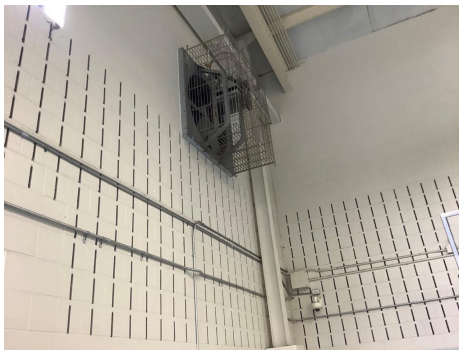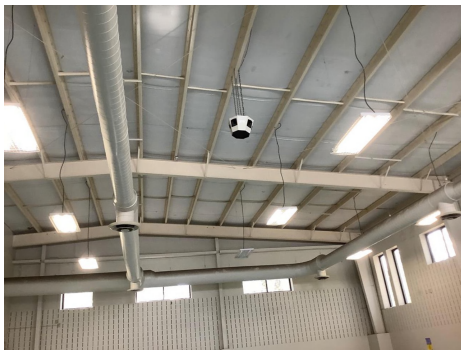

**Note:**

### **System:** D3050 - Terminal & Package Units



**Note:**


### **System:** D3060 - Controls & Instrumentation



**Note:**

## School Assessment Report - 1996 Bldg 2020

**System:** D4030 - Fire Protection Specialties

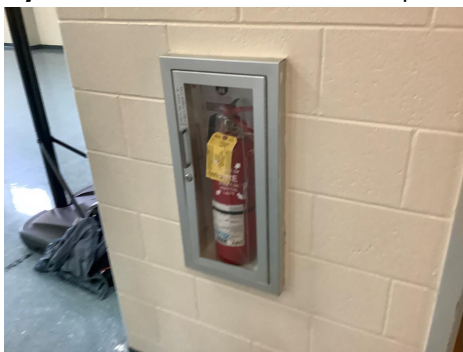

**Note:**

**System:** D5010 - Electrical Service/Distribution



**Note:**

**System:** D5020 - Branch Wiring




**Note:**



## School Assessment Report - 1996 Bldg 2020

### **System:** D5020 - Lighting

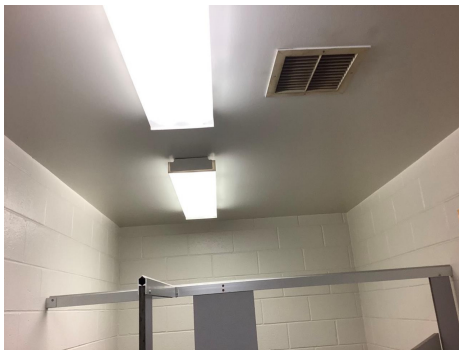




### **Note:**

### **System:** D5030810 - Security & Detection Systems



### **Note:**

### **System:** D5030910 - Fire Alarm Systems

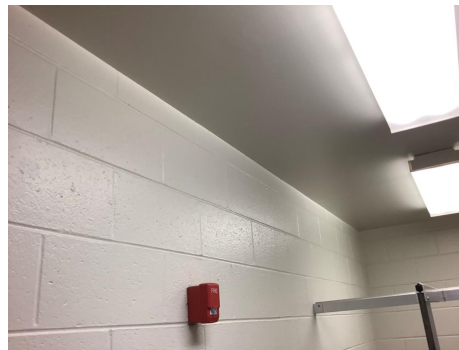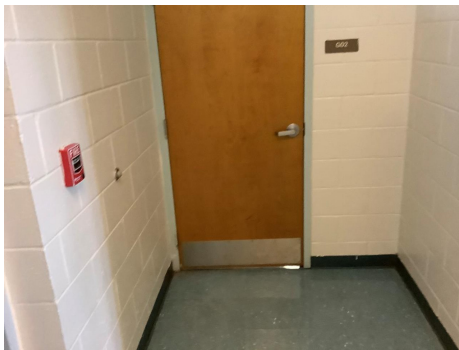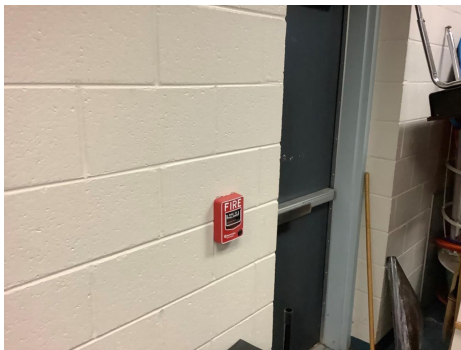

### **Note:**

## School Assessment Report - 1996 Bldg 2020

---

**System:** D5030920 - Data Communication



**Note:**

**System:** D5090 - Other Electrical Systems



**Note:**

**System:** E1020 - Institutional Equipment




**Note:**

## School Assessment Report - 1996 Bldg 2020

---

**System:** E1090 - Other Equipment

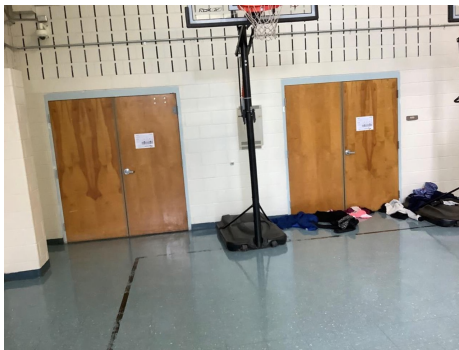

**Note:**

**System:** E2010 - Fixed Furnishings



**Note:**

## Renewal Schedule

eCOMET forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the System Listing table. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.

*Inflation Rate: 3%*

| System                             | Current Deficiencies | 2020       | 2021       | 2022       | 2023       | 2024       | 2025             | 2026             | 2027             | 2028             | 2029            | Total              |
|------------------------------------|----------------------|------------|------------|------------|------------|------------|------------------|------------------|------------------|------------------|-----------------|--------------------|
| <b>Total:</b>                      | <b>\$920,262</b>     | <b>\$0</b> | <b>\$0</b> | <b>\$0</b> | <b>\$0</b> | <b>\$0</b> | <b>\$162,506</b> | <b>\$368,848</b> | <b>\$595,287</b> | <b>\$112,158</b> | <b>\$40,860</b> | <b>\$2,199,921</b> |
| * A - Substructure                 | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| * A10 - Foundations                | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| * A1010 - Standard Foundations     | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| * A1030 - Slab on Grade            | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| B - Shell                          | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| B10 - Superstructure               | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| * B1020 - Roof Construction        | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| B20 - Exterior Enclosure           | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| * B2010 - Exterior Walls           | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| B2020 - Exterior Windows           | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$266,843        | \$0              | \$0              | \$0             | \$266,843          |
| B2030 - Exterior Doors             | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$26,709         | \$0              | \$0              | \$0             | \$26,709           |
| B30 - Roofing                      | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| B3010 - Roof Coverings             | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| B3010130 - Preformed Metal Roofing | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$95,157         | \$0             | \$95,157           |
| B3020 - Roof Openings              | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$17,001         | \$0             | \$17,001           |
| C - Interiors                      | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| C10 - Interior Construction        | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| C1010 - Partitions                 | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| C1020 - Interior Doors             | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| C1030 - Fittings                   | \$66,807             | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$66,807           |
| C30 - Interior Finishes            | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| C3010 - Wall Finishes              | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| C3010230 - Paint & Covering        | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$40,860        | \$40,860           |
| C3020 - Floor Finishes             | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |
| C3020420 - Ceramic Tile            | \$0                  | \$0        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0              | \$0              | \$0              | \$0             | \$0                |

## School Assessment Report - 1996 Bldg 2020


| System                                  | Current Deficiencies | 2020 | 2021 | 2022 | 2023 | 2024 | 2025     | 2026     | 2027      | 2028 | 2029 | Total     |
|---|----------------------|------|------|------|------|------|----------|----------|-----------|------|------|-----------|
| C3020903 - VCT                          | \$100,377            | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$100,377 |
| C3030 - Ceiling Finishes                | \$227,103            | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$227,103 |
| D - Services                            | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$0       |
| D20 - Plumbing                          | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$0       |
| D2010 - Plumbing Fixtures               | \$160,502            | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$160,502 |
| D2020 - Domestic Water Distribution     | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$22,385 | \$0       | \$0  | \$0  | \$22,385  |
| D2030 - Sanitary Waste                  | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$52,910 | \$0       | \$0  | \$0  | \$52,910  |
| D30 - HVAC                              | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$0       |
| D3040 - Distribution Systems            | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$0       |
| D3050 - Terminal & Package Units        | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$521,400 | \$0  | \$0  | \$521,400 |
| D3060 - Controls & Instrumentation      | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$70,743  | \$0  | \$0  | \$70,743  |
| D40 - Fire Protection                   | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$0       |
| D4030 - Fire Protection Specialties     | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$3,144   | \$0  | \$0  | \$3,144   |
| D50 - Electrical                        | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$0       |
| D5010 - Electrical Service/Distribution | \$57,706             | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$57,706  |
| D5020 - Branch Wiring                   | \$119,549            | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$119,549 |
| D5020 - Lighting                        | \$179,738            | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$179,738 |
| D5030 - Communications and Security     | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$0       |
| D5030810 - Security & Detection Systems | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$37,293 | \$0      | \$0       | \$0  | \$0  | \$37,293  |
| D5030910 - Fire Alarm Systems           | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$67,669 | \$0      | \$0       | \$0  | \$0  | \$67,669  |
| D5030920 - Data Communication           | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$0       |
| D5090 - Other Electrical Systems        | \$8,480              | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$8,480   |
| E - Equipment & Furnishings             | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$0       |
| E10 - Equipment                         | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$0       |
| E1020 - Institutional Equipment         | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$0       |
| E1090 - Other Equipment                 | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$0       |
| E20 - Furnishings                       | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$0      | \$0      | \$0       | \$0  | \$0  | \$0       |
| E2010 - Fixed Furnishings               | \$0                  | \$0  | \$0  | \$0  | \$0  | \$0  | \$57,544 | \$0      | \$0       | \$0  | \$0  | \$57,544  |

\* Indicates non-renewable system



Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and forecasted capital renewal (sustainment) requirements over the next ten years.

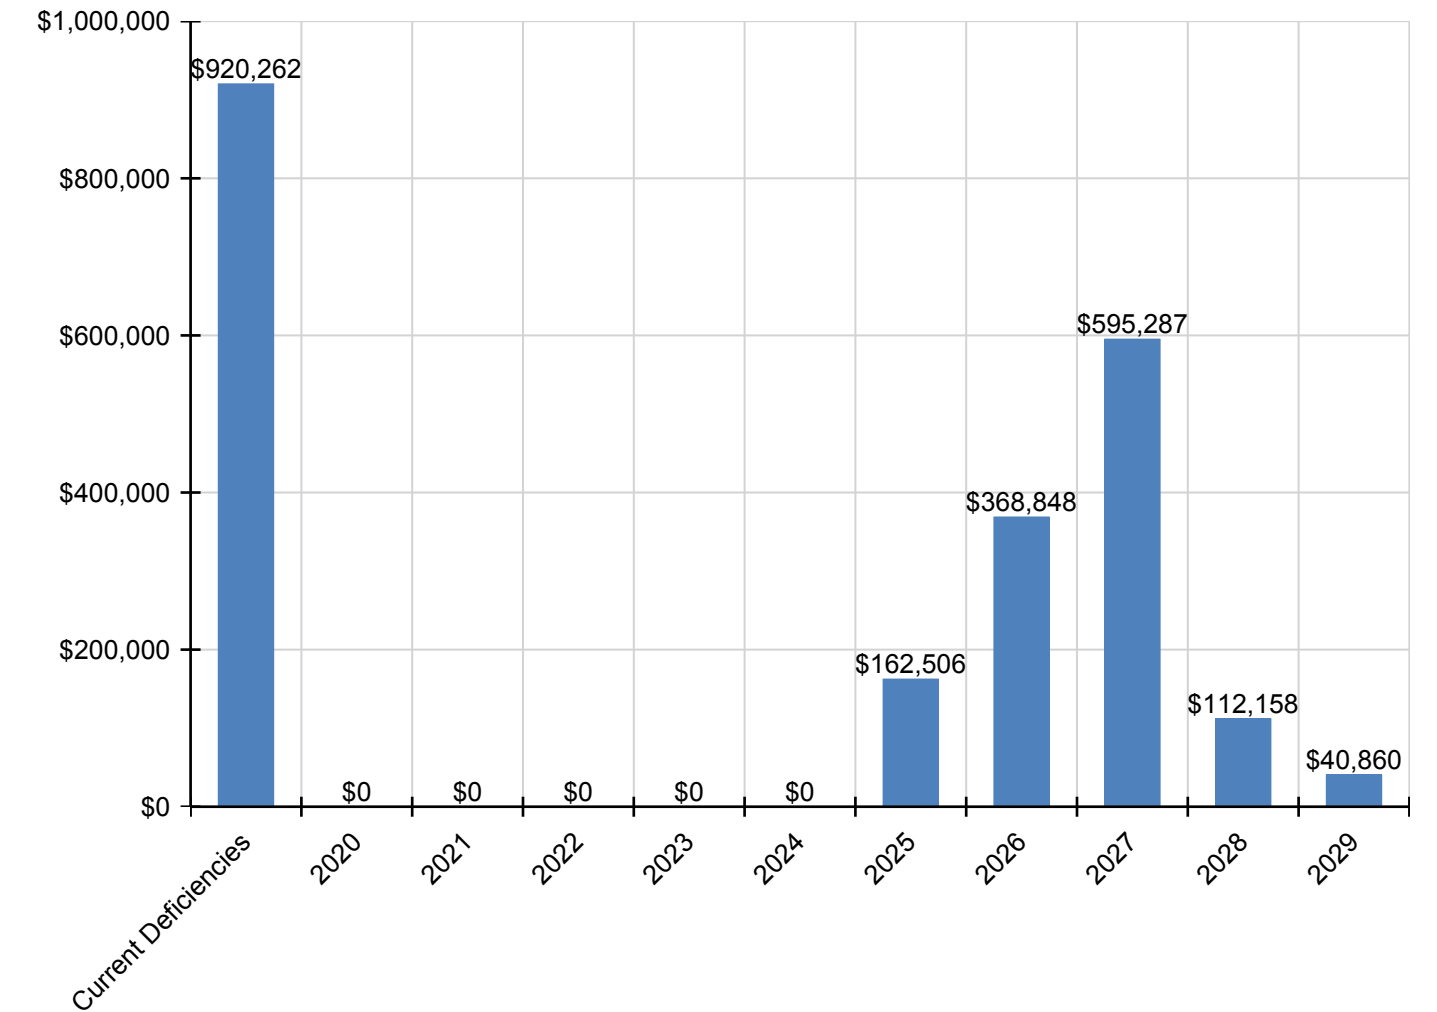


## Condition Index Forecast by Investment Scenario

The chart below illustrates the effect of various investment levels on the building FCI for the next 10 years. The levels of investment shown below include:

- Current FCI: a variable investment amount based on renewing expired systems to maintain the current FCI for the building
- 2% Investment: an annual investment of 2% of the replacement value of the building, escalated for inflation
- 4% Investment: an annual investment of 4% of the replacement value of the building, escalated for inflation


### Facility Investment vs. FCI Forecast

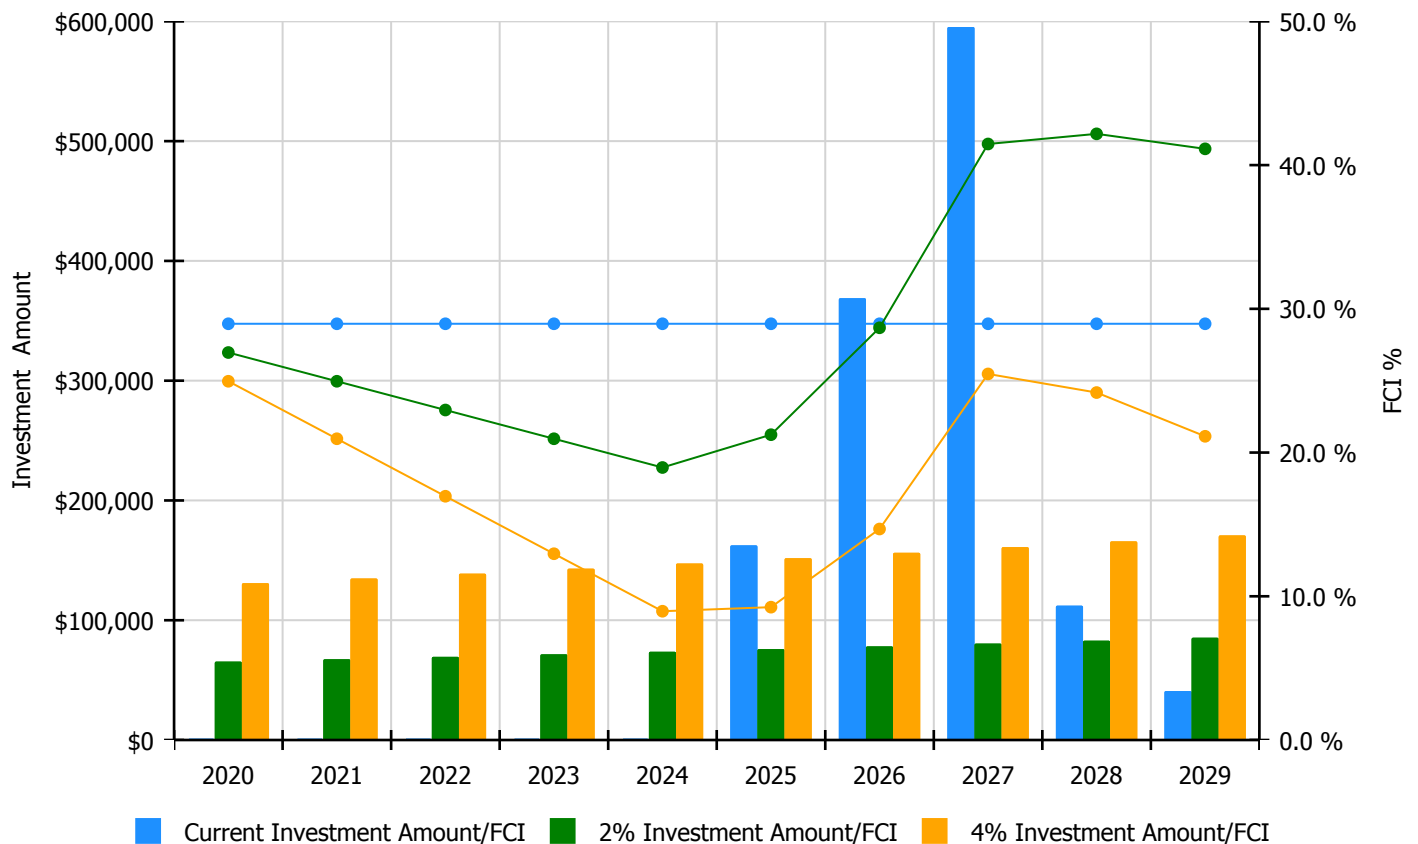

| Year          | Investment Amount<br>Current FCI - 28.96% | 2% Investment       |         | 4% Investment         |         |
|---------------|---|---------------------|---------|-----------------------|---------|
|               |   | Amount              | FCI     | Amount                | FCI     |
| 2020          | \$0                                       | \$65,460.00         | 26.96 % | \$130,921.00          | 24.96 % |
| 2021          | \$0                                       | \$67,424.00         | 24.96 % | \$134,848.00          | 20.96 % |
| 2022          | \$0                                       | \$69,447.00         | 22.96 % | \$138,894.00          | 16.96 % |
| 2023          | \$0                                       | \$71,530.00         | 20.96 % | \$143,061.00          | 12.96 % |
| 2024          | \$0                                       | \$73,676.00         | 18.96 % | \$147,353.00          | 8.96 %  |
| 2025          | \$162,506                                 | \$75,887.00         | 21.24 % | \$151,773.00          | 9.24 %  |
| 2026          | \$368,848                                 | \$78,163.00         | 28.68 % | \$156,326.00          | 14.68 % |
| 2027          | \$595,287                                 | \$80,508.00         | 41.47 % | \$161,016.00          | 25.47 % |
| 2028          | \$112,158                                 | \$82,923.00         | 42.17 % | \$165,847.00          | 24.17 % |
| 2029          | \$40,860                                  | \$85,411.00         | 41.13 % | \$170,822.00          | 21.13 % |
| <b>Total:</b> | <b>\$1,279,659</b>                        | <b>\$750,429.00</b> |         | <b>\$1,500,861.00</b> |         |

## Deficiency Summary by System


Current deficiencies included assemblies that have reached or exceeded their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Useful Life'. The following chart lists all current deficiencies associated with this facility.

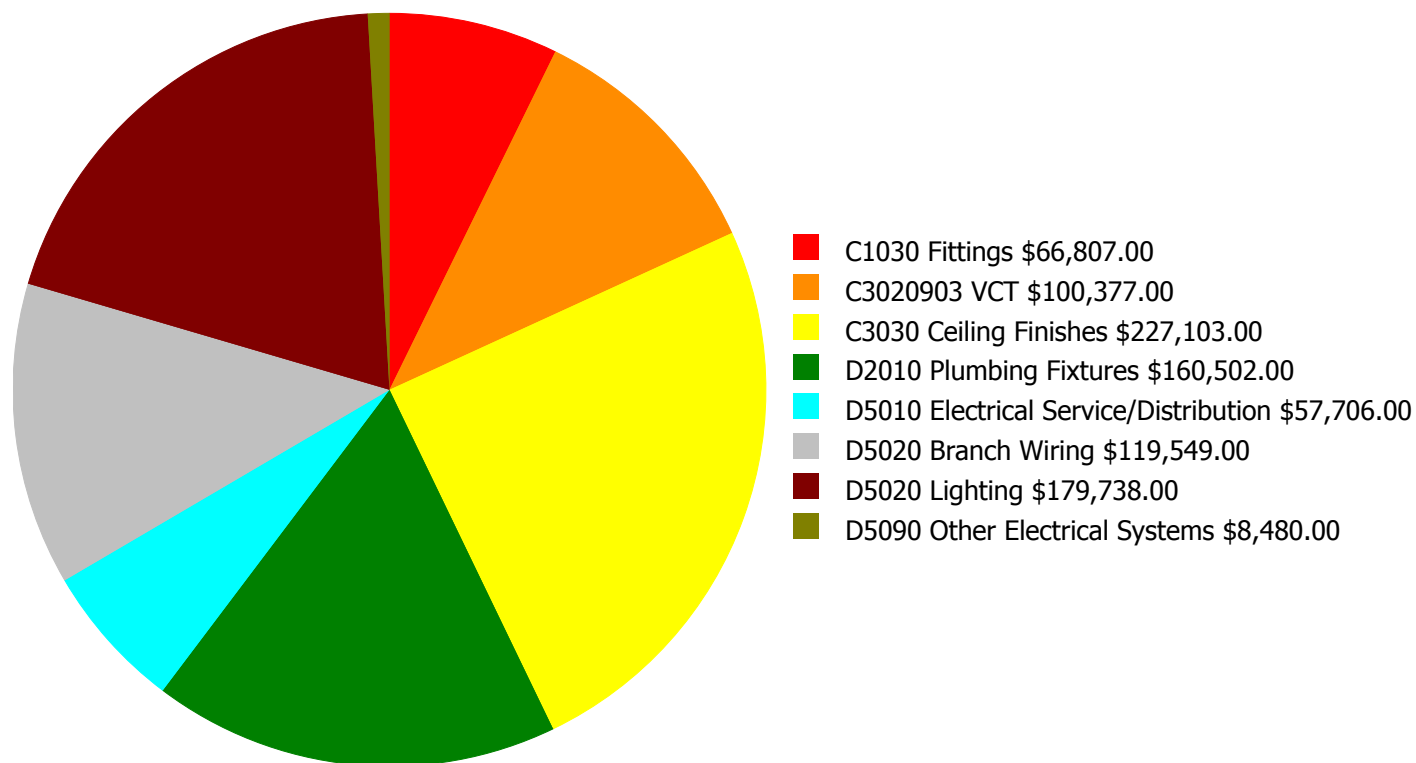

**Budget Estimate Total: \$920,262.00**

## Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

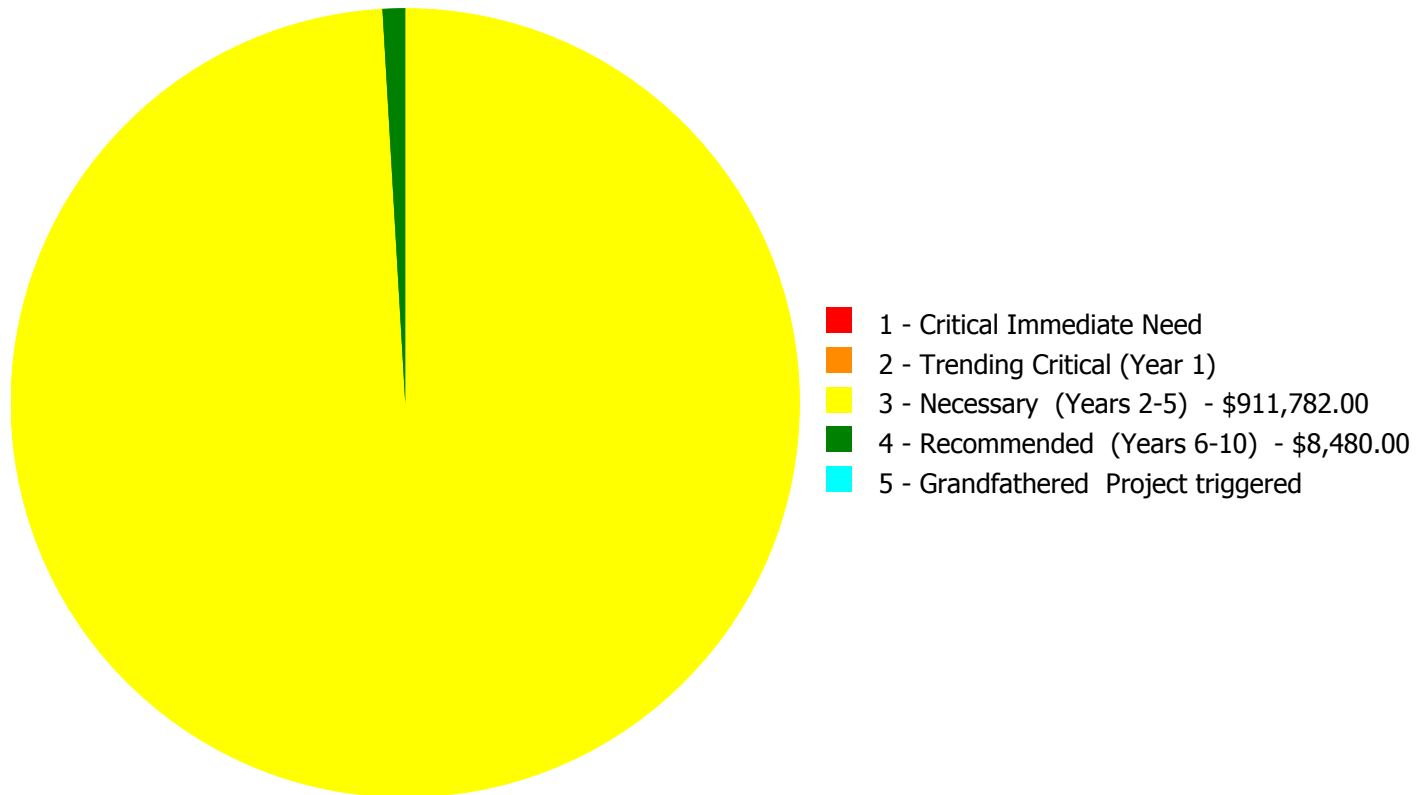

**Budget Estimate Total: \$920,262.00**

## Deficiency By Priority Investment Table


The table below shows the current investment cost grouped by deficiency priority and building system.

| System Code | System Description              | 1 - Critical Immediate Need | 2 - Trending Critical (Year 1) | 3 - Necessary (Years 2-5) | 4 - Recommended (Years 6-10) | 5 - Grandfathered Project triggered | Total        |
|-------------|---------------------------------|-----------------------------|--------------------------------|---------------------------|------------------------------|-------------------------------------|--------------|
| C1030       | Fittings                        | \$0.00                      | \$0.00                         | \$66,807.00               | \$0.00                       | \$0.00                              | \$66,807.00  |
| C3020903    | VCT                             | \$0.00                      | \$0.00                         | \$100,377.00              | \$0.00                       | \$0.00                              | \$100,377.00 |
| C3030       | Ceiling Finishes                | \$0.00                      | \$0.00                         | \$227,103.00              | \$0.00                       | \$0.00                              | \$227,103.00 |
| D2010       | Plumbing Fixtures               | \$0.00                      | \$0.00                         | \$160,502.00              | \$0.00                       | \$0.00                              | \$160,502.00 |
| D5010       | Electrical Service/Distribution | \$0.00                      | \$0.00                         | \$57,706.00               | \$0.00                       | \$0.00                              | \$57,706.00  |
| D5020       | Branch Wiring                   | \$0.00                      | \$0.00                         | \$119,549.00              | \$0.00                       | \$0.00                              | \$119,549.00 |
| D5020       | Lighting                        | \$0.00                      | \$0.00                         | \$179,738.00              | \$0.00                       | \$0.00                              | \$179,738.00 |
| D5090       | Other Electrical Systems        | \$0.00                      | \$0.00                         | \$0.00                    | \$8,480.00                   | \$0.00                              | \$8,480.00   |
|             | <b>Total:</b>                   | \$0.00                      | \$0.00                         | \$911,782.00              | \$8,480.00                   | \$0.00                              | \$920,262.00 |



## Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

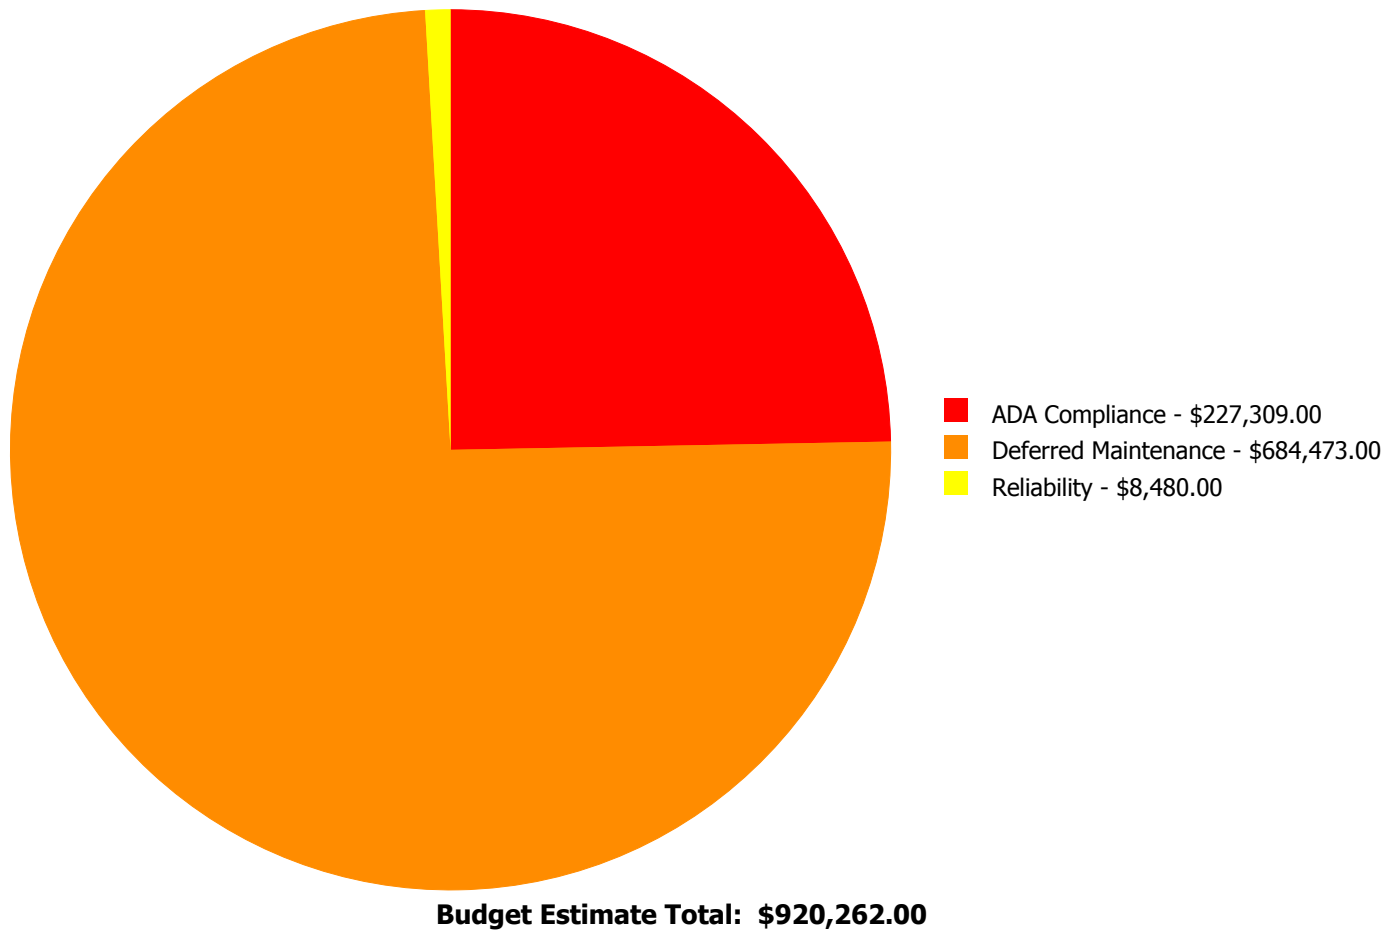

## Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

### Priority 3 - Necessary (Years 2-5):

#### System: C1030 - Fittings



**Location:** Throughout Building  
**Distress:** Beyond Expected Life  
**Category:** ADA Compliance  
**Priority:** 3 - Necessary (Years 2-5)  
**Correction:** Renew System  
**Qty:** 18,803.00  
**Unit of Measure:** S.F.  
**Estimate:** \$66,807.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 09/27/2019

**Notes:** Fittings, such as toilet partitions, signage and railing, are beyond their expected service life, outdated and should be replaced and upgraded for compliance with ADA standards.

#### System: C3020903 - VCT



**Location:** Throughout Building  
**Distress:** Beyond Expected Life  
**Category:** Deferred Maintenance  
**Priority:** 3 - Necessary (Years 2-5)  
**Correction:** Renew System  
**Qty:** 18,609.00  
**Unit of Measure:** S.F.  
**Estimate:** \$100,377.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 01/27/2020

**Notes:** The VCT floor finish is beyond its expected service life, worn and damaged, and is recommended for replacement.

**System: C3030 - Ceiling Finishes**



**Location:** Throughout Building  
**Distress:** Beyond Expected Life  
**Category:** Deferred Maintenance  
**Priority:** 3 - Necessary (Years 2-5)  
**Correction:** Renew System  
**Qty:** 18,803.00  
**Unit of Measure:** S.F.  
**Estimate:** \$227,103.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 09/27/2019

**Notes:** The applied ceiling finish is beyond its expected life cycle and should be replaced.

---

**System: D2010 - Plumbing Fixtures**



**Location:** restrooms  
**Distress:** Beyond Expected Life  
**Category:** ADA Compliance  
**Priority:** 3 - Necessary (Years 2-5)  
**Correction:** Renew System  
**Qty:** 18,803.00  
**Unit of Measure:** S.F.  
**Estimate:** \$160,502.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 09/27/2019

**Notes:** Plumbing fixtures are beyond their expected service life and should be replaced and upgraded for ADA compliance.

---

**System: D5010 - Electrical Service/Distribution**



**Location:** Throughout Building  
**Distress:** Beyond Expected Life  
**Category:** Deferred Maintenance  
**Priority:** 3 - Necessary (Years 2-5)  
**Correction:** Renew System  
**Qty:** 18,803.00  
**Unit of Measure:** S.F.  
**Estimate:** \$57,706.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 09/27/2019

**Notes:** The Electrical Service/Distribution system is operational but beyond its expected service life and should be replaced.

---

**System: D5020 - Branch Wiring**



**Location:** Throughout Building  
**Distress:** Beyond Expected Life  
**Category:** Deferred Maintenance  
**Priority:** 3 - Necessary (Years 2-5)  
**Correction:** Renew System  
**Qty:** 18,803.00  
**Unit of Measure:** S.F.  
**Estimate:** \$119,549.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 09/27/2019

**Notes:** The branch wiring system is operational but beyond its expected service life and should be replaced.

---

**System: D5020 - Lighting**



**Location:** Throughout Building  
**Distress:** Beyond Expected Life  
**Category:** Deferred Maintenance  
**Priority:** 3 - Necessary (Years 2-5)  
**Correction:** Renew System  
**Qty:** 18,803.00  
**Unit of Measure:** S.F.  
**Estimate:** \$179,738.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 01/27/2020

**Notes:** TThe lighting system is operational but beyond its expected service life and should be replaced.

---

**Priority 4 - Recommended (Years 6-10):**

**System: D5090 - Other Electrical Systems**

This deficiency has no image.

**Location:** 1996 Bldg 2020  
**Distress:** Missing  
**Category:** Reliability  
**Priority:** 4 - Recommended (Years 6-10)  
**Correction:** Renew System  
**Qty:** 18,803.00  
**Unit of Measure:** S.F.  
**Estimate:** \$8,480.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 08/13/2013

**Notes:** No emergency generator, client standard required.

---



## Executive Summary

The condition of a Campus is the accumulation of the condition evaluations of the component buildings and the site. Building condition is evaluated based on the functional systems and elements of a building and organized according to the **UNIFORMAT II Elemental Classification**. eCOMET uses parametric estimating methodology whereby historical costs for systems, components and equipment are collected by entities such as RSMeans and converted to unit costs, typically \$/SF, and used to approximate future construction costs or replacement values. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Current Replacement Value (CRV)** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as  $100 - \text{Total FCI}$  (without the %) where 100 is best and 0 is worst condition.

Function:

Gross Area (SF): 70,012

Year Built: 1967

Last Renovation:

Replacement Value: \$2,297,093

Repair Cost: \$349,640.00

Total FCI: 15.22 %

Total RSLI: 20.67 %

FCA Score: 84.78



### Description:

The narrative for this site is included in the Executive Summary Description at the front of this report.

**Attributes:** This asset has no attributes.




## Dashboard Summary

|              |           |                    |             |
|--------------|-----------|--------------------|-------------|
| Function:    |           | Gross Area:        | 70,012      |
| Year Built:  | 1967      | Last Renovation:   |             |
| Repair Cost: | \$349,640 | Replacement Value: | \$2,297,093 |
| FCI:         | 15.22 %   | RSLI%:             | 20.67 %     |


**Deficiency By Category**




**Deficiency By Priority**

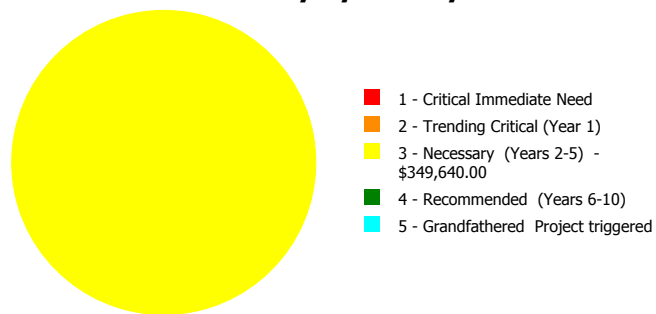

**Deficiency By System**

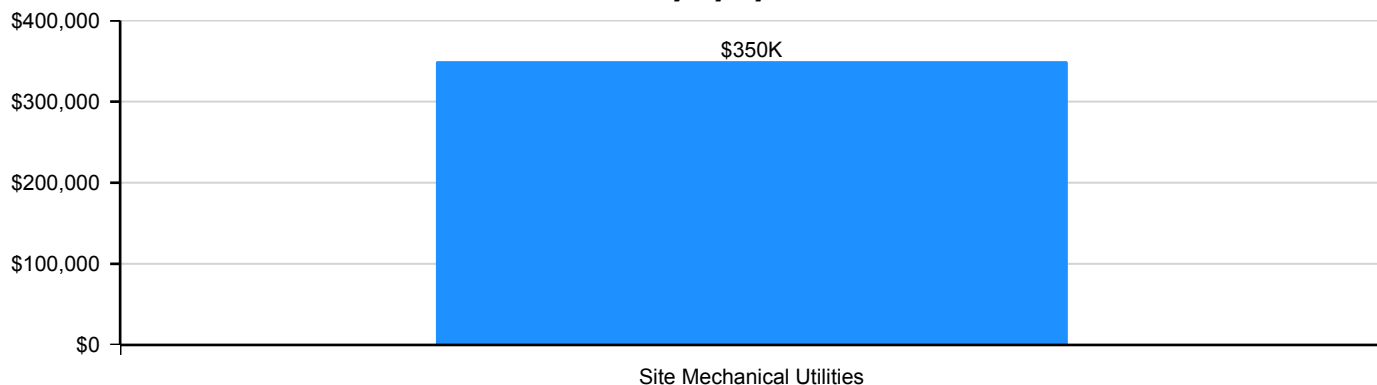

**10 Year Investment Forecast**

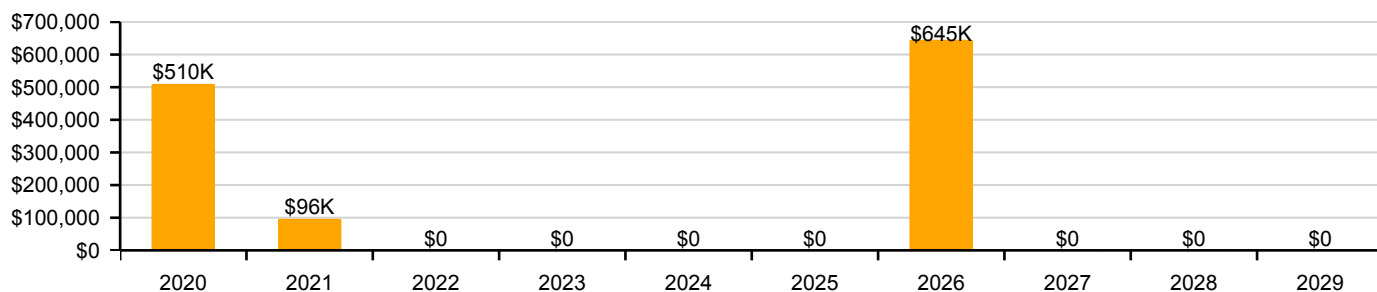

## Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT II classification Level 2. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

| UNIFORMAT Classification        | RSLI %         | FCI %          | Current Repair Cost |
|---------------------------------|----------------|----------------|---------------------|
| G20 - Site Improvements         | 24.19 %        | 0.00 %         | \$0.00              |
| G30 - Site Mechanical Utilities | 0.00 %         | 110.00 %       | \$349,640.00        |
| G40 - Site Electrical Utilities | 23.33 %        | 0.00 %         | \$0.00              |
| <b>Totals:</b>                  | <b>20.67 %</b> | <b>15.22 %</b> | <b>\$349,640.00</b> |

## Photo Album

The photo album consists of the various cardinal compass directions of the building..



### Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment)
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system as new construction.



## System Listing

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

| System Code  | System Description              | Unit Price \$ | UoM  | Qty    | Life | Year Installed | Calc Next Renewal Year | Next Renewal Year | RSLI%          | FCI%           | RSL | eCR | Deficiency \$       | Replacement Value \$ |
|--------------|---------------------------------|---------------|------|--------|------|----------------|------------------------|-------------------|----------------|----------------|-----|-----|---------------------|----------------------|
| G2010        | Roadways                        | \$2.37        | S.F. | 70,012 | 35   | 1996           | 2031                   |                   | 34.29 %        | 0.00 %         | 12  |     |                     | \$165,928            |
| G2020        | Parking Lots                    | \$8.00        | S.F. | 70,012 | 35   | 1996           | 2031                   |                   | 34.29 %        | 0.00 %         | 12  |     |                     | \$560,096            |
| G2030        | Pedestrian Paving               | \$2.33        | S.F. | 70,012 | 35   | 1996           | 2031                   |                   | 34.29 %        | 0.00 %         | 12  |     |                     | \$163,128            |
| G2040105     | Fence & Guardrails              | \$1.15        | S.F. | 70,012 | 30   | 2000           | 2030                   |                   | 36.67 %        | 0.00 %         | 11  |     |                     | \$80,514             |
| G2040950     | Covered Walkways                | \$1.44        | S.F. | 70,012 | 20   | 2000           | 2020                   |                   | 5.00 %         | 0.00 %         | 1   |     |                     | \$100,817            |
| G2040950     | Hard Surface Play Area          | \$0.71        | S.F. | 70,012 | 20   | 2000           | 2020                   |                   | 5.00 %         | 0.00 %         | 1   |     |                     | \$49,709             |
| G2040950     | Play Field                      | \$4.28        | S.F. | 70,012 | 20   | 2000           | 2020                   |                   | 5.00 %         | 0.00 %         | 1   |     |                     | \$299,651            |
| G2050        | Landscaping                     | \$1.18        | S.F. | 70,012 | 25   | 1996           | 2021                   |                   | 8.00 %         | 0.00 %         | 2   |     |                     | \$82,614             |
| G3010        | Water Supply                    | \$1.09        | S.F. | 70,012 | 50   | 1967           | 2017                   |                   | 0.00 %         | 110.00 %       | -2  |     | \$83,944.00         | \$76,313             |
| G3020        | Sanitary Sewer                  | \$2.20        | S.F. | 70,012 | 50   | 1967           | 2017                   |                   | 0.00 %         | 110.00 %       | -2  |     | \$169,429.00        | \$154,026            |
| G3030        | Storm Sewer                     | \$1.25        | S.F. | 70,012 | 50   | 1967           | 2017                   |                   | 0.00 %         | 110.00 %       | -2  |     | \$96,267.00         | \$87,515             |
| G4010        | Electrical Distribution         | \$2.55        | S.F. | 70,012 | 30   | 1996           | 2026                   |                   | 23.33 %        | 0.00 %         | 7   |     |                     | \$178,531            |
| G4020        | Site Lighting                   | \$2.98        | S.F. | 70,012 | 30   | 1996           | 2026                   |                   | 23.33 %        | 0.00 %         | 7   |     |                     | \$208,636            |
| G4030        | Site Communication and Security | \$1.28        | S.F. | 70,012 | 30   | 1996           | 2026                   |                   | 23.33 %        | 0.00 %         | 7   |     |                     | \$89,615             |
| <b>Total</b> |                                 |               |      |        |      |                |                        |                   | <b>20.67 %</b> | <b>15.22 %</b> |     |     | <b>\$349,640.00</b> | <b>\$2,297,093</b>   |

## System Notes

The facility description in the executive summary contains an overview of each system. The system notes listed below provide additional information on select systems found within the facility.

---

**System:** G2010 - Roadways



**Note:**

---

**System:** G2020 - Parking Lots



**Note:**

---

**System:** G2030 - Pedestrian Paving



**Note:**



## School Assessment Report - Site

**System:** G2040105 - Fence & Guardrails



**Note:**

**System:** G2040950 - Covered Walkways



**Note:**

**System:** G2040950 - Hard Surface Play Area



**Note:**



## School Assessment Report - Site

---

**System:** G2040950 - Play Field



**Note:**

**System:** G2050 - Landscaping



**Note:**

**System:** G3010 - Water Supply



**Note:**



## School Assessment Report - Site

---

**System:** G3020 - Sanitary Sewer



**Note:**

**System:** G3030 - Storm Sewer



**Note:**

**System:** G4020 - Site Lighting



**Note:**

## School Assessment Report - Site

---

**System:** G4030 - Site Communication and Security



**Note:**

## Renewal Schedule

eCOMET forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the System Listing table. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.


*Inflation Rate: 3%*

| System   | Current Deficiencies | 2020             | 2021            | 2022       | 2023       | 2024       | 2025       | 2026             | 2027       | 2028       | 2029       | Total              |
|--|----------------------|------------------|-----------------|------------|------------|------------|------------|------------------|------------|------------|------------|--------------------|
| <b>Total:</b>                                  | <b>\$349,640</b>     | <b>\$510,050</b> | <b>\$96,410</b> | <b>\$0</b> | <b>\$0</b> | <b>\$0</b> | <b>\$0</b> | <b>\$645,020</b> | <b>\$0</b> | <b>\$0</b> | <b>\$0</b> | <b>\$1,601,120</b> |
| <b>G - Building Sitework</b>                   | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0        | \$0              | \$0        | \$0        | \$0        | \$0                |
| <b>G20 - Site Improvements</b>                 | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0        | \$0              | \$0        | \$0        | \$0        | \$0                |
| <b>G2010 - Roadways</b>                        | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0        | \$0              | \$0        | \$0        | \$0        | \$0                |
| <b>G2020 - Parking Lots</b>                    | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0        | \$0              | \$0        | \$0        | \$0        | \$0                |
| <b>G2030 - Pedestrian Paving</b>               | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0        | \$0              | \$0        | \$0        | \$0        | \$0                |
| <b>G2040 - Site Development</b>                | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0        | \$0              | \$0        | \$0        | \$0        | \$0                |
| <b>G2040105 - Fence &amp; Guardrails</b>       | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0        | \$0              | \$0        | \$0        | \$0        | \$0                |
| <b>G2040950 - Covered Walkways</b>             | \$0                  | \$114,226        | \$0             | \$0        | \$0        | \$0        | \$0        | \$0              | \$0        | \$0        | \$0        | \$114,226          |
| <b>G2040950 - Hard Surface Play Area</b>       | \$0                  | \$56,319         | \$0             | \$0        | \$0        | \$0        | \$0        | \$0              | \$0        | \$0        | \$0        | \$56,319           |
| <b>G2040950 - Play Field</b>                   | \$0                  | \$339,504        | \$0             | \$0        | \$0        | \$0        | \$0        | \$0              | \$0        | \$0        | \$0        | \$339,504          |
| <b>G2050 - Landscaping</b>                     | \$0                  | \$0              | \$96,410        | \$0        | \$0        | \$0        | \$0        | \$0              | \$0        | \$0        | \$0        | \$96,410           |
| <b>G30 - Site Mechanical Utilities</b>         | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0        | \$0              | \$0        | \$0        | \$0        | \$0                |
| <b>G3010 - Water Supply</b>                    | \$83,944             | \$0              | \$0             | \$0        | \$0        | \$0        | \$0        | \$0              | \$0        | \$0        | \$0        | \$83,944           |
| <b>G3020 - Sanitary Sewer</b>                  | \$169,429            | \$0              | \$0             | \$0        | \$0        | \$0        | \$0        | \$0              | \$0        | \$0        | \$0        | \$169,429          |
| <b>G3030 - Storm Sewer</b>                     | \$96,267             | \$0              | \$0             | \$0        | \$0        | \$0        | \$0        | \$0              | \$0        | \$0        | \$0        | \$96,267           |
| <b>G40 - Site Electrical Utilities</b>         | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0        | \$0              | \$0        | \$0        | \$0        | \$0                |
| <b>G4010 - Electrical Distribution</b>         | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0        | \$241,528        | \$0        | \$0        | \$0        | \$241,528          |
| <b>G4020 - Site Lighting</b>                   | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0        | \$282,255        | \$0        | \$0        | \$0        | \$282,255          |
| <b>G4030 - Site Communication and Security</b> | \$0                  | \$0              | \$0             | \$0        | \$0        | \$0        | \$0        | \$121,237        | \$0        | \$0        | \$0        | \$121,237          |

*\* Indicates non-renewable system*

Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and forecasted capital renewal (sustainment) requirements over the next ten years.

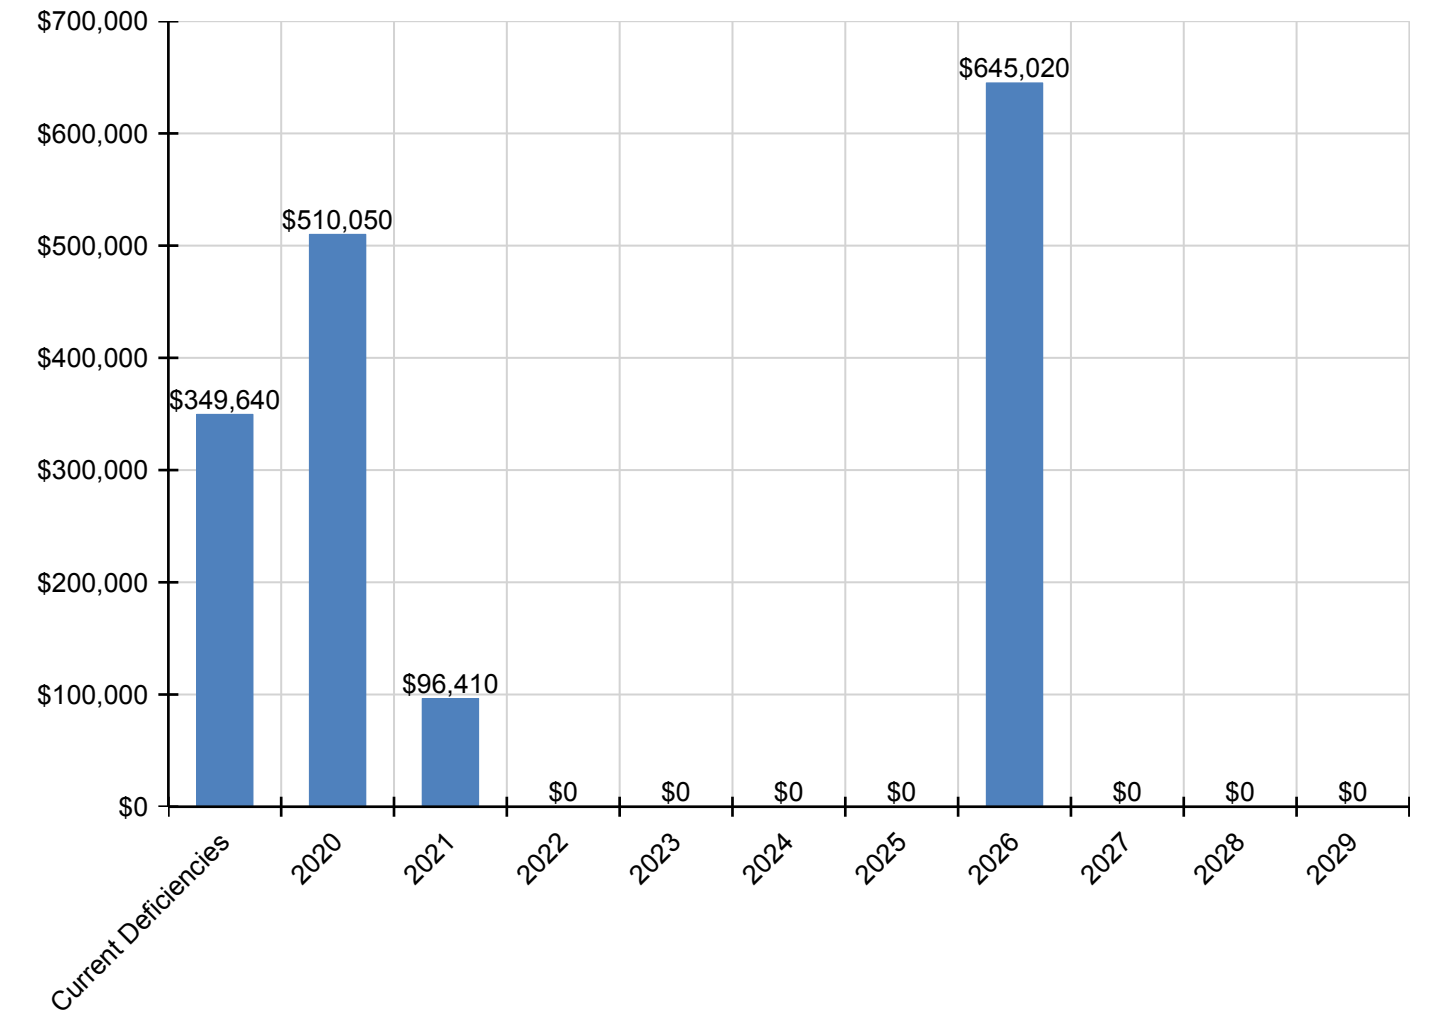




## Condition Index Forecast by Investment Scenario

The chart below illustrates the effect of various investment levels on the building FCI for the next 10 years. The levels of investment shown below include:

- Current FCI: a variable investment amount based on renewing expired systems to maintain the current FCI for the building
- 2% Investment: an annual investment of 2% of the replacement value of the building, escalated for inflation
- 4% Investment: an annual investment of 4% of the replacement value of the building, escalated for inflation


### Facility Investment vs. FCI Forecast

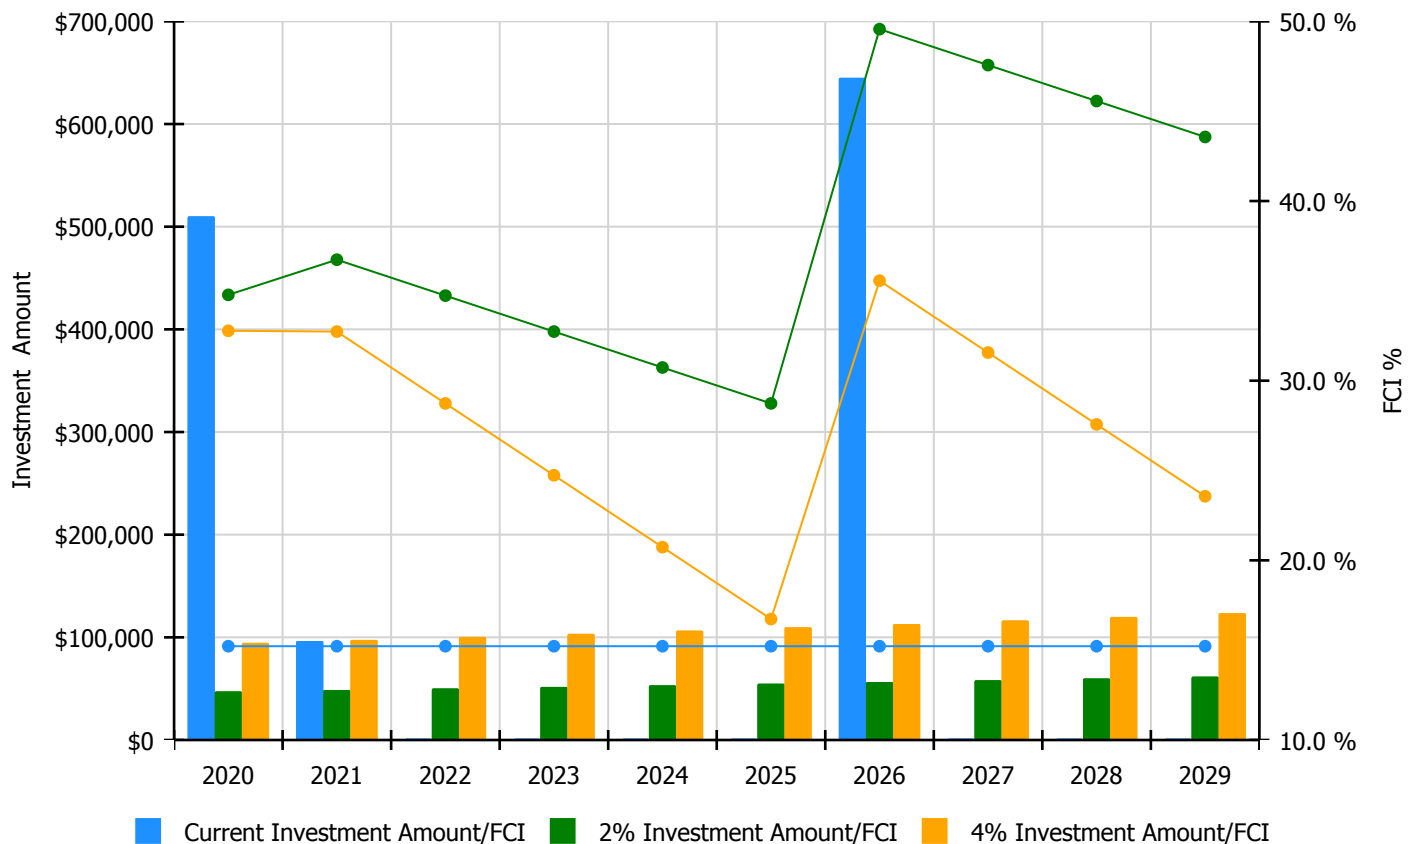

| Year          | Investment Amount<br>Current FCI - 15.22% | 2% Investment       |         | 4% Investment         |         |
|---------------|---|---------------------|---------|-----------------------|---------|
|               |   | Amount              | FCI     | Amount                | FCI     |
| 2020          | \$510,050                                 | \$47,320.00         | 34.78 % | \$94,640.00           | 32.78 % |
| 2021          | \$96,410                                  | \$48,740.00         | 36.73 % | \$97,479.00           | 32.73 % |
| 2022          | \$0                                       | \$50,202.00         | 34.73 % | \$100,404.00          | 28.73 % |
| 2023          | \$0                                       | \$51,708.00         | 32.73 % | \$103,416.00          | 24.73 % |
| 2024          | \$0                                       | \$53,259.00         | 30.73 % | \$106,518.00          | 20.73 % |
| 2025          | \$0                                       | \$54,857.00         | 28.73 % | \$109,714.00          | 16.73 % |
| 2026          | \$645,020                                 | \$56,503.00         | 49.57 % | \$113,005.00          | 35.57 % |
| 2027          | \$0                                       | \$58,198.00         | 47.57 % | \$116,396.00          | 31.57 % |
| 2028          | \$0                                       | \$59,944.00         | 45.57 % | \$119,887.00          | 27.57 % |
| 2029          | \$0                                       | \$61,742.00         | 43.57 % | \$123,484.00          | 23.57 % |
| <b>Total:</b> | <b>\$1,251,480</b>                        | <b>\$542,473.00</b> |         | <b>\$1,084,943.00</b> |         |


## Deficiency Summary by System

Current deficiencies included assemblies that have reached or exceeded their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Useful Life'. The following chart lists all current deficiencies associated with this facility.

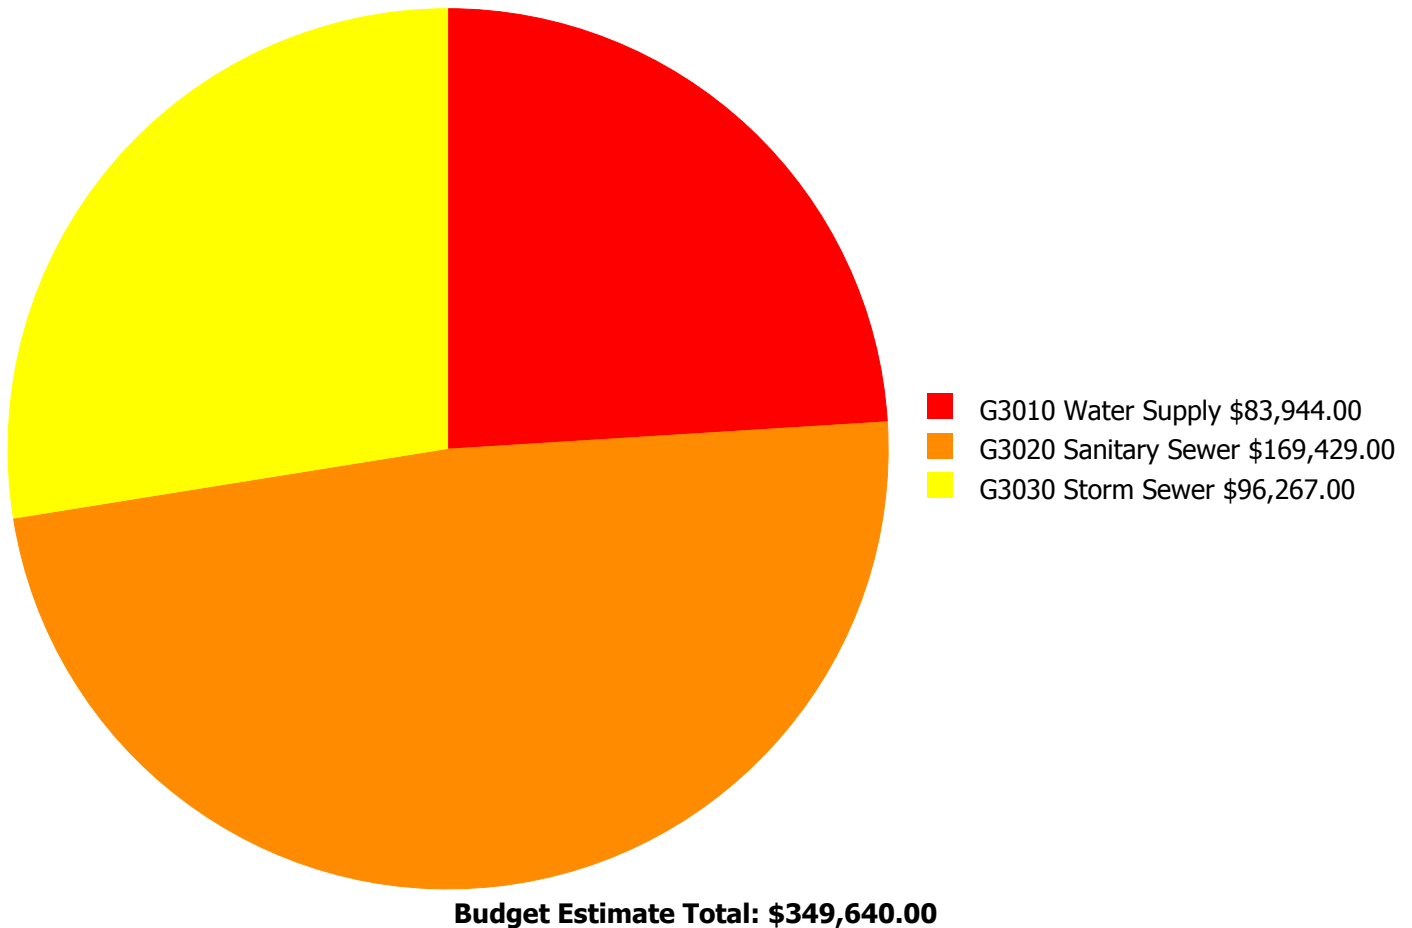

## Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

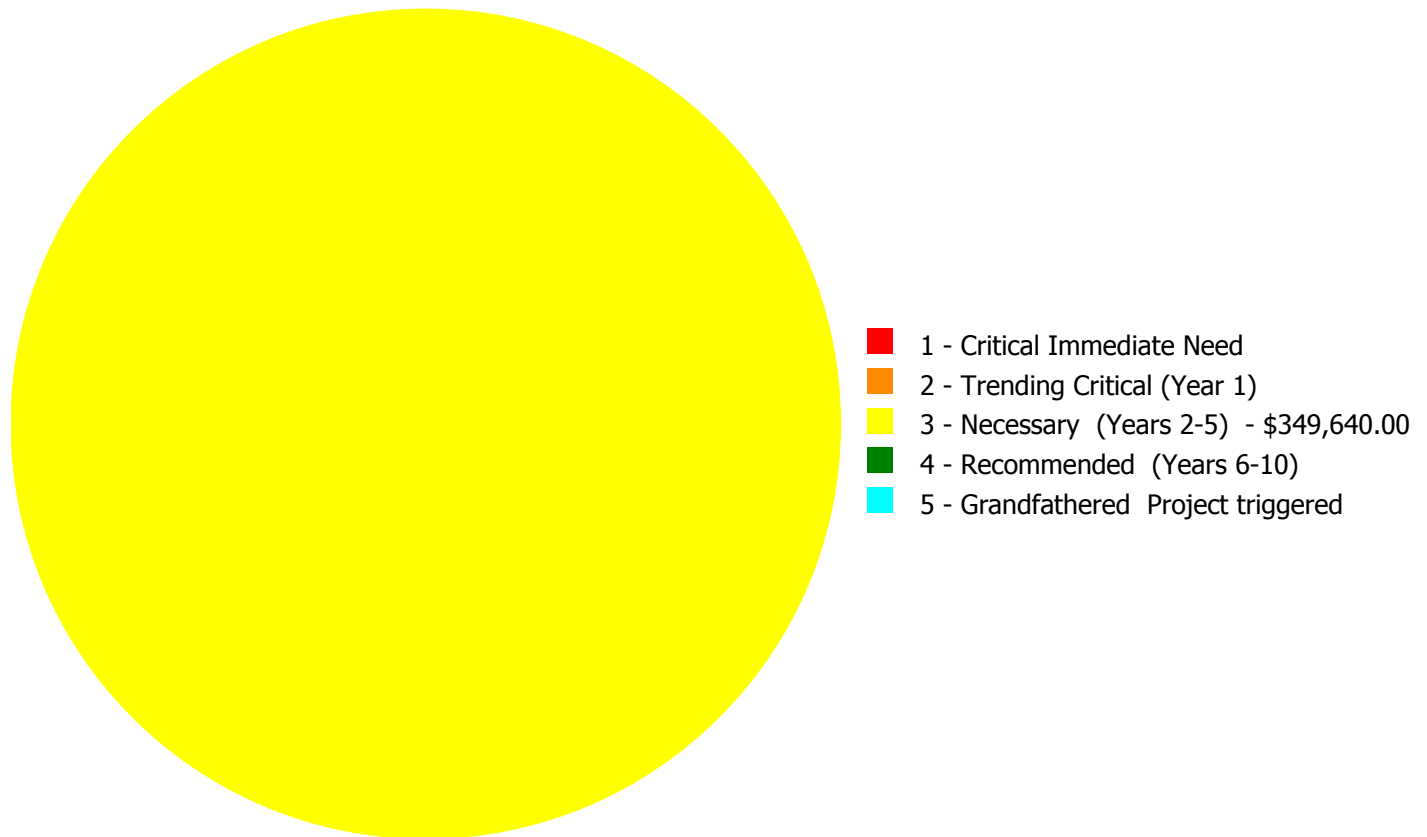

**Budget Estimate Total: \$349,640.00**

## Deficiency By Priority Investment Table


The table below shows the current investment cost grouped by deficiency priority and building system.

| System Code | System Description | 1 - Critical Immediate Need | 2 - Trending Critical (Year 1) | 3 - Necessary (Years 2-5) | 4 - Recommended (Years 6-10) | 5 - Grandfathered Project triggered | Total        |
|-------------|--------------------|-----------------------------|--------------------------------|---------------------------|------------------------------|-------------------------------------|--------------|
| G3010       | Water Supply       | \$0.00                      | \$0.00                         | \$83,944.00               | \$0.00                       | \$0.00                              | \$83,944.00  |
| G3020       | Sanitary Sewer     | \$0.00                      | \$0.00                         | \$169,429.00              | \$0.00                       | \$0.00                              | \$169,429.00 |
| G3030       | Storm Sewer        | \$0.00                      | \$0.00                         | \$96,267.00               | \$0.00                       | \$0.00                              | \$96,267.00  |
|             | <b>Total:</b>      | \$0.00                      | \$0.00                         | \$349,640.00              | \$0.00                       | \$0.00                              | \$349,640.00 |



## Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

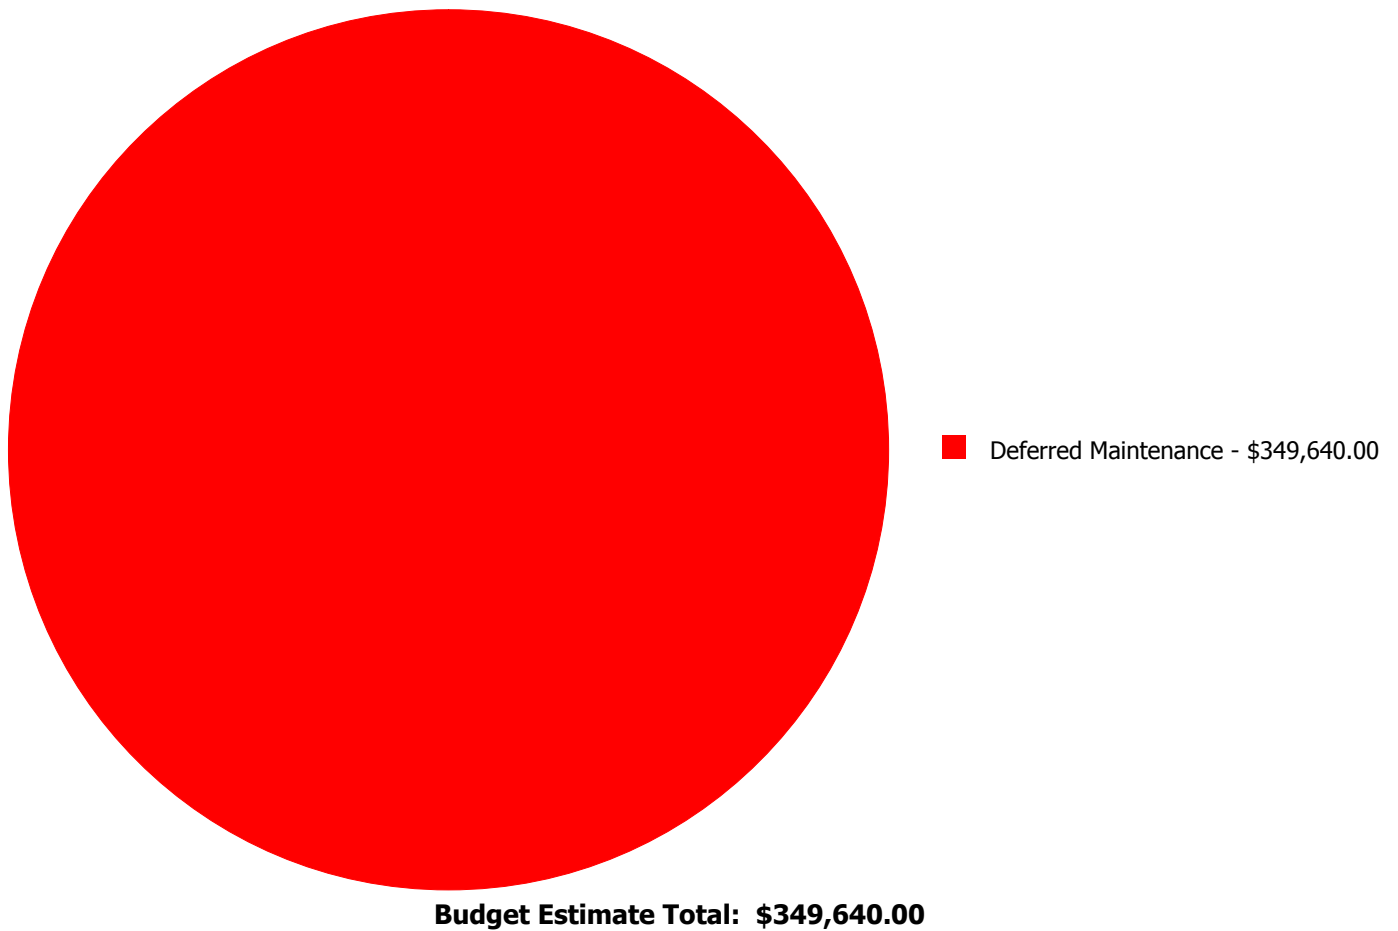

## Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

### Priority 3 - Necessary (Years 2-5):

#### System: G3010 - Water Supply



**Location:** outside of building  
**Distress:** Beyond Expected Life  
**Category:** Deferred Maintenance  
**Priority:** 3 - Necessary (Years 2-5)  
**Correction:** Renew System  
**Qty:** 70,012.00  
**Unit of Measure:** S.F.  
**Estimate:** \$83,944.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 09/28/2019

**Notes:** The original domestic water distribution system components consist of galvanized and copper pipes, valves and domestic water supply. The system has exceeded its life expectancy and needs to be upgraded or replaced.

#### System: G3020 - Sanitary Sewer



**Location:** outside of building  
**Distress:** Beyond Expected Life  
**Category:** Deferred Maintenance  
**Priority:** 3 - Necessary (Years 2-5)  
**Correction:** Renew System  
**Qty:** 70,012.00  
**Unit of Measure:** S.F.  
**Estimate:** \$169,429.00  
**Assessor Name:** Jejuan Hall  
**Date Created:** 09/28/2019

**Notes:** The sanitary system is original and beyond the expected life cycle. Upgrades to the existing sanitary sewer system are considered necessary.

### **System: G3030 - Storm Sewer**



**Location:** outside of building

**Distress:** Beyond Expected Life

**Category:** Deferred Maintenance

**Priority:** 3 - Necessary (Years 2-5)

**Correction:** Renew System

**Qty:** 70,012.00

**Unit of Measure:** S.F.

**Estimate:** \$96,267.00

**Assessor Name:** Jejuan Hall

**Date Created:** 09/28/2019

**Notes:** The site storm drains that support the water runoff are functional however, have exceeded the expected life cycle. This project provides a budgetary consideration for a new rainwater drainage system. This is expected to be completed as part of an overall effort to upgrade the site and should be completed as part of the recommended site upgrades also in this report.

---

## Glossary

|                         |   |
|-------------------------|---|
| Abandoned               | A facility owned by the city that is not occupied and not maintained. See Vacant.   |
| Additional Cost         | Total project cost is composed of hard and soft costs. Additional costs or soft expenses are costs that are necessary to accomplish the corrective work but are not directly attributable to the deficient systems direct construction cost, which are often referred to as hard cost. The components included in the soft costs vary by owner but usually include architect and contractor fees, contingencies and other owner-incurred costs necessary to fully develop and build a facility. These soft cost factors can be adjusted anytime within the eCOMET database at the owner's discretion. |
| Assessment              | Visual survey of a facility to determine its condition. It involves looking at the age of systems, reviewing information from local sources and visual evidence of potential problems to assign a condition rating. It does not include destructive testing of materials or testing of systems or equipment for functionality.  |
| ASTM                    | ASTM International (ASTM): Originally known as the American Society for Testing and Materials, ASTM is an international standards organization that develops and publishes voluntary consensus technical standards for a wide range of materials, products, systems, and services.  |
| BOMA                    | Building Owners Managers of America (BOMA): National organization of public and private facility owners focused on building management tools and maintenance techniques. eCOMET® reference: Building and component system effective economic life expectancies.   |
| Building                | A fully enclosed and roofed structure that can be traversed internally without exiting to the exterior.   |
| Building Addition       | An area, space or component of a building added to a building after the original building's year built date. NOTE: As a convention in the database, "Main" was used to designate the original building. Additions built prior to 1987 (30 years) were included in the main building area calculations to reflect their predicted system depreciation characteristics and remaining service life.  |
| Building Systems        | eCOMET® uses UNIFORMAT II to organize building data. UNIFORMAT II was originally developed by the federal General Services Administration to delineate building costs by systems rather than by material. UNIFORMAT II was formalized by an NIST standard, NISTIR 6389 in 1999. It has been further quantified and updated by ASTM standard 2005, E1557-05. The Construction Specifications Institute, CSI, has taken over the standard as part of their MasterFormat / MasterSpec system.  |
| Calculated Next Renewal | The year a system or building element would be expected to expire based solely on the date it was installed and the expected useful lifetime for that kind of system.   |
| Capital Renewal         | Capital renewal refers to the cyclical replacement of building systems or elements as they become obsolete or beyond their useful life. It is not normally included in an annual operating/maintenance budget. See calculated next renewal and next renewal.  |
| City Cost Index (CCI)   | RS Means provides building system, equipment, and construction costs at a national level. The City Cost Index (also provided by RS Means) localizes those costs to a geographic region of the United States. In eCOMET®, each building or site is assigned a City Cost Index, which adjusts all of the associated costs for systems, deficiencies and inventory to the local value.   |
| Condition               | Condition refers to the state of physical fitness or readiness of a facility system or system element for its intended use.   |
| Condition Budget        | The Condition Budget, also known as Condition Needs, represents the budgeted contractor installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging the work.  |



## School Assessment Report - Toomer Elementary School

---

|                                 |  |
|---------------------------------|--|
| Condition Index (CI) %          | The Condition Index (CI) also known as the Remaining Service Life Index (RSLI) is calculated as the sum of a renewable system's Remaining Service Life (RSL) Value divided by the sum of a system's Replacement Value (both values exclude soft cost to simplify calculation updates) expressed as a percentage ranging from 100.00% (new) to 0.00% (expired - no remaining life).   |
| Correction                      | Correction refers to an assessor's recommended deficiency repair or replacement action. For any system or element deficiency, there can be multiple and alternative solutions for its repair or replacement. A Correction is user defined and tied to a UNIFORMAT II element, or system it is intended to address. It excludes other peripheral costs that may also be included in the packaging of repair, replacement or renewal improvements that may also be triggered by the deficiency correction.   |
| Cost Model                      | A cost model is a list of facility systems which could represent the installed systems a given facility. Included in the cost model are standard unit cost estimates, gross areas, life cycles and installed dates. Also represented is the repair cost for deficient systems, replacement values. See eCOMET® cost models.  |
| Criteria                        | Criteria refer to the set of requirements, guidelines or standards that are assessed and rated to develop a score.   |
| Current Period                  | The Current Period is the current year plus a user defined number of forward years.  |
| Current Replacement Value (CRV) | The Current Replacement Value (CRV) of a facility, building or system represents the hypothetical cost of rebuilding or replacing an existing facility under today's codes and construction standards, using its current configuration. It is calculated by multiplying the gross area of the facility by a square foot cost developed in that facility's cost model. Replacement cost includes construction costs and owner's additional or soft costs for fees, permits and other expenses to reflect a total project cost.  |
| Deferred Maintenance            | Deferred maintenance is condition work deferred on a planned or unplanned basis to a future budget cycle or postponed until funds are available.   |
| Deficiency                      | A deficiency is a repair item that is damaged, missing, inadequate or insufficient for an intended purpose.  |
| Deficiency Category             | Category refers to the type or class of a user defined deficiency grouping with shared or similar characteristics. Category descriptions include, but are not limited to: Accessibility Code Compliance, Appearance, Building Code Compliance, Deferred Maintenance, Energy, Environmental, Life Safety Code Compliance, and Safety.   |
| Deficiency Priority             | Priority refers to a deficiency's urgency for repair as determined by the assessment team. Five typical industry priority settings were used for the assessment: Priority 1 – Currently Critical; Priority 2 – Potentially Critical; Priority 3 – Necessary/Not Yet Critical; Priority 4 – Recommended.  |
| Distress                        | Distress refers to a user-defined root cause of a deficiency. Distress descriptions are: Beyond Service Life, Damaged, Inadequate, Needs Remediation, and Missing.   |
| eCOMET®                         | Energy and Condition Management Estimation Technology (eCOMET®) is Parsons proprietary facility asset management software developed to provide facility managers with a state of the art, web-based tool to develop and maintain a comprehensive database of FCA data and information used for facility asset management, maintenance and repair, and capital renewal planning. eCOMET® is used by Parsons and its clients as the primary tool for collecting FCA data, preparing cost estimates, generating individual facility reports and cost estimates, and developing the overall capital renewal program. |
| eCOMET® Cost Models             | eCOMET cost models are derived from RS Means Square Foot Cost Data cost models and these models are used to develop the current replacement value (CRV) and assign life cycle costs to the various systems within a building. Cost models are assigned current costs-per-square-foot to establish replacement values. The Cost models are designed to represent a client specific facility that meets local standards cost trends.   |

## School Assessment Report - Toomer Elementary School

---

|                                     |  |
|-------------------------------------|--|
| Element                             | Elements are the major components that comprise building systems as defined by UNIFORMAT II.   |
| Expected Life                       | Also referred to as Useful Life. See Useful Life definition.   |
| Facility                            | A facility refers to site(s) building(s) or building addition(s) or combinations thereof that provide a particular service.  |
| Facility Attributes                 | Customizable eCOMET fields to identify attributes specific to a facility. These fields are part of the eCOMET database set-up with the owner.  |
| Facility Condition Assessment (FCA) | A facility condition assessment (FCA) is a visual inspection of buildings and grounds at a facility to identify and estimate current and future needed repairs or replacements of major systems for planning and budgeting purposes. It is typically performed for organizations that are tasked with the day to day maintenance, operation, and capital renewal (replacement) of building systems and components of a large inventory of facilities. The primary goal of an FCA is to objectively and quantifiably identify, inspect, and prioritize the repair and replacement needs of the building and ground systems (e.g., roofs, windows, doors, floor finishes, plumbing fixtures, parking lot, and sidewalks) within facilities that have either failed or have surpassed their service life, and to identify and forecast future capital replacement needs for systems that have not yet failed, but planned replacement of those systems is needed to ensure that the facilities will continue to meet the mission of the organization. |
| Facility Condition Index (FCI%)     | FCI is an industry-standard measurement of a facility's condition that is the ratio of the cost to correct a facility's deficiencies to the Current Replacement Value of the facilities. The higher the FCI the poorer the condition of a facility. After an FCI is established for all buildings within a portfolio a building's condition can be ranked relative to other buildings. The FCI may also represent the condition of a portfolio based on the cumulative FCIs of the portfolio's facilities.   |
| Forecast Period                     | The Forecast Period refers to a user defined number of years forward of the Current Period.  |
| Gen (Generate)                      | The Cost Model has a Gen box for each system line item. By checking the box, eCOMET will generate life cycle deficiencies based on the Year Installed and the Life for that system. Systems that typically do not re-generate (foundations, floor construction, roof construction, basement walls, etc.) would not have the Gen box checked as those systems would not re-generate at the end of a life cycle. In those instances, it would be more practical and cost effective to demolish the entire facility than re-new those systems.  |
| Gross Square Feet (GSF)             | The size of the enclosed floor space of a building in square feet measured to the outside face of the enclosing wall.  |
| Life Cycle                          | Life cycle refers to the period of time that a building or site system or element can be expected to adequately serve its intended function. Parsons assigns expected life cycles to all building systems based on Building Operators and Managers of America (BOMA) recommended life cycles, manufacturers suggested life, and RS Means cost data, and client-provided historical data. BOMA standards are a nationally recognized source of life cycle data for various components and/or systems associated with facilities. RS Means is a national company specializing in construction estimating and costs.  |
| Next Renewal                        | Next Renewal refers to a manually-adjusted expected useful life of a system or element based on on-site inspection either by reducing or extending the Calculated Next Renewal to more accurately reflect current conditions.  |
| Order of Magnitude                  | Order of Magnitude refers to a rough approximation made with a degree of knowledge and confidence that the budgeted, projected or estimated cost falls within a reasonable range of cost values.   |
| Remaining Service Life (RSL)        | RSL is the number of years service remaining for a system or equipment item. It is automatically calculated based on the difference between the current year and the 'Calculated Next Renewal' date or the 'Next Renewal' date whichever one is the later date.  |

## School Assessment Report - Toomer Elementary School

---

|                                     |  |
|-------------------------------------|--|
| Remaining Service Life Index (RSLI) | The Remaining Service Life Index (RSLI), also known as the Condition Index (CI), is calculated as the sum of a renewable system's or component's Remaining Service Life (RSL) Value divided by the sum of a system's or component's Replacement Value (both values exclude softcost to simplify calculation updates) expressed as a percentage ranging from 100.00% (new) to 0.00% (expired - no remaining service life).  |
| Remaining Service Life Value        | Remaining Service Life Value, also known as the RSL Weight, is a calculated value used to determine the RSLI and is equal to the system Value (Unit Cost * Qty) * RSL (not displayed).   |
| Renewal Factors                     | Renewal factors represent the difference in cost of renovating or replacing an existing system, rather than new construction of a building system. For example, installing a new built-up roof on an existing building would include removing and disposing of the old roof, a cost not associated with new construction. Using a renewal premium to account for demolition and other difficulty costs, Parsons typically assigns a renewal factor of 110%.  |
| Renewal Schedule                    | A timeline that provides the items that need repair the year in which the repair is needed and the estimated price of the renewal.   |
| Repair Cost                         | Repair cost is the sum of all the deficiencies associated with a building or multiple buildings/facilities. It will include any applied soft costs or City Cost Indexes.   |
| Replacement Value                   | See Current Replacement Value.   |
| Site                                | A facility's grounds and its utilities, roadways, landscaping, fencing and other typical land improvements needed to support a facility.   |
| Soft Costs                          | Soft Costs are a construction industry term that refers to expense items that are not considered direct construction costs. Soft costs are user-defined and include architectural, engineering, management, testing, and mitigation fees, and other owner pre- and post-construction expenses.   |
| Sustainability                      | Sustainability refers to the collection of policies and strategies that meet society's present needs without compromising the ability of future generations to meet their own needs.   |
| System                              | System refers to building and related site work elements as described by ASTM Uniformat II Classification for Building Elements (E1557-97) a format for classifying major facility elements common to most buildings. Elements usually perform a given function regardless of the design specification construction method or materials used. See also Uniformat II.   |
| System Generated Deficiency         | eCOMET automatically generates system deficiencies based on system life cycles using the systems installation dates as the base year. By adjusting the Next Renewal date ahead or behind the predicted or stated life cycle date, a system cost will come due earlier or later than the originally installed life cycle date. This utility accounts for good maintenance conditions and a longer life, or early expiration of a system life due to any number of adverse factors such as poor installation, acts of god, material defects, poor design applications and other factors that may shorten the life of a material or system. It is important to mention that the condition of the systems is not necessarily a reflection of maintenance practices, but a combination of system usage and age. |
| UNIFORMAT                           | ASTM UNIFORMAT II, Classification for Building Elements (E1557-97), a publication of the Construction Specification Institute (CSI), is a format used to classify major facility components common to most buildings. The format is based on functional elements or parts of a facility characterized by their functions without regard to the materials and methods used to accomplish them. These elements are often referred to as systems or assemblies.   |
| Unit Price                          | The Unit Price (Raw) x the Additional Cost Template percentage.  |
| Unit Price (Raw)                    | The actual \$/sq. ft. cost being used for the building and systems. It will include adjustments for the City Cost Index applied to the facility.   |

## School Assessment Report - Toomer Elementary School

---

|                |   |
|----------------|---|
| Useful Life    | Also known as Expected Life, Useful Life refers to the intrinsic period of time a system or element is expected to perform as intended. Useful life is generally provided by manufacturers of materials, systems and elements through their literature, testing and experience. Useful Lives in the database are derived from the Building Owners and Managers (BOMA) organization's guidelines, RSMeans cost data, and from client- defined historical experience. |
| Vacant         | Vacant refers to a facility that is not occupied but is a maintained facility. See Abandoned.   |
| Year Built     | The year that a building or addition was originally built based on substantial completion or occupancy.   |
| Year Installed | The year a system or element was built or the most recent major renovation date where a minimum of 70% of the system's Current Replacement Value (CRV) was replaced.  |





## Suitability Report - Full

|                               |                                |                  |
|-------------------------------|--------------------------------|------------------|
| Project #: 12382              | County: Atlanta Public Schools | Site #: 5567     |
| Project: APS Assessments 2019 | Region: 761                    | Site: Toomer ES  |
| Grade Config: PK-5            | Site Type: Elementary          | Site Size: 11.00 |

| Suitability                         | Rating | Score | Possible Score | Percent Score |
|-------------------------------------|--------|-------|----------------|---------------|
| <b>Suitability - ES</b>             |        |       |                |               |
| <b>Learning Environment</b>         |        |       |                |               |
| Learning Style Variety              | Excel  | 5.00  | 5.00           | 100.00        |
| Interior Environment                | Excel  | 2.00  | 2.00           | 100.00        |
| Exterior Environment                | Good   | 1.20  | 1.50           | 80.00         |
| <b>General Classrooms</b>           |        |       |                |               |
| Environment                         | Excel  | 4.65  | 4.65           | 100.00        |
| Size                                | Fair   | 7.56  | 11.63          | 65.00         |
| Location                            | Excel  | 3.49  | 3.49           | 100.00        |
| Storage/Fixed Equip                 | Excel  | 3.49  | 3.49           | 100.00        |
| <b>Kindergarten</b>                 |        |       |                |               |
| Environment                         | Excel  | 0.42  | 0.42           | 100.00        |
| Size                                | Excel  | 1.04  | 1.04           | 100.00        |
| Location                            | Excel  | 0.31  | 0.31           | 100.00        |
| Storage/Fixed Equip                 | Excel  | 0.31  | 0.31           | 100.00        |
| <b>ECE</b>                          |        |       |                |               |
| Environment                         | (N/A)  | 0.00  | 0.00           | 0.00          |
| Size                                | (N/A)  | 0.00  | 0.00           | 0.00          |
| Location                            | (N/A)  | 0.00  | 0.00           | 0.00          |
| Storage/Fixed Equip                 | (N/A)  | 0.00  | 0.00           | 0.00          |
| <b>Self-Contained Special Ed</b>    |        |       |                |               |
| Environment                         | Good   | 0.38  | 0.48           | 80.00         |
| Size                                | Good   | 0.96  | 1.20           | 80.00         |
| Location                            | Excel  | 0.36  | 0.36           | 100.00        |
| Storage/Fixed Equip                 | Fair   | 0.23  | 0.36           | 65.00         |
| <b>Instructional Resource Rooms</b> |        |       |                |               |
| Environment                         | Excel  | 0.72  | 0.72           | 100.00        |
| Size                                | Excel  | 1.80  | 1.80           | 100.00        |
| Location                            | Excel  | 0.54  | 0.54           | 100.00        |
| Storage/Fixed Equip                 | Excel  | 0.54  | 0.54           | 100.00        |
| <b>Science</b>                      |        |       |                |               |
| Environment                         | Unsat  | 0.00  | 0.40           | 0.00          |
| Size                                | Unsat  | 0.00  | 1.00           | 0.00          |
| Location                            | Unsat  | 0.00  | 0.30           | 0.00          |
| Storage/Fixed Equip                 | Unsat  | 0.00  | 0.30           | 0.00          |
| <b>Music</b>                        |        |       |                |               |
| Environment                         | Good   | 0.59  | 0.74           | 80.00         |

Project #: 12382

County: Atlanta Public Schools

Site #: 5567

Project: APS Assessments 2019

Region: 761

Site: Toomer ES

Grade Config: PK-5

Site Type: Elementary

Site Size: 11.00

| Suitability                      | Rating | Score | Possible Score | Percent Score |
|----------------------------------|--------|-------|----------------|---------------|
| Size                             | Excel  | 1.85  | 1.85           | 100.00        |
| Location                         | Excel  | 0.56  | 0.56           | 100.00        |
| Storage/Fixed Equip              | Poor   | 0.28  | 0.56           | 50.00         |
| <b>Art</b>                       |        |       |                |               |
| Environment                      | Excel  | 0.47  | 0.47           | 100.00        |
| Size                             | Excel  | 1.17  | 1.17           | 100.00        |
| Location                         | Excel  | 0.35  | 0.35           | 100.00        |
| Storage/Fixed Equip              | Fair   | 0.23  | 0.35           | 65.00         |
| <b>Maker Space</b>               |        |       |                |               |
| Environment                      | (N/A)  | 0.00  | 0.00           | 0.00          |
| Size                             | (N/A)  | 0.00  | 0.00           | 0.00          |
| Location                         | (N/A)  | 0.00  | 0.00           | 0.00          |
| Storage/Fixed Equip              | (N/A)  | 0.00  | 0.00           | 0.00          |
| <b>Computer Labs</b>             |        |       |                |               |
| Environment                      | (N/A)  | 0.00  | 0.00           | 0.00          |
| Size                             | (N/A)  | 0.00  | 0.00           | 0.00          |
| Location                         | (N/A)  | 0.00  | 0.00           | 0.00          |
| Storage/Fixed Equip              | (N/A)  | 0.00  | 0.00           | 0.00          |
| <b>P.E.</b>                      |        |       |                |               |
| Environment                      | Good   | 1.54  | 1.92           | 80.00         |
| Size                             | Excel  | 4.80  | 4.80           | 100.00        |
| Location                         | Excel  | 1.44  | 1.44           | 100.00        |
| Storage/Fixed Equip              | Good   | 1.15  | 1.44           | 80.00         |
| <b>Performing Arts</b>           |        |       |                |               |
| Environment                      | Good   | 0.48  | 0.60           | 80.00         |
| Size                             | Excel  | 1.51  | 1.51           | 100.00        |
| Location                         | Excel  | 0.45  | 0.45           | 100.00        |
| Storage/Fixed Equip              | Excel  | 0.45  | 0.45           | 100.00        |
| <b>Media Center</b>              |        |       |                |               |
| Environment                      | Excel  | 0.97  | 0.97           | 100.00        |
| Size                             | Excel  | 2.44  | 2.44           | 100.00        |
| Location                         | Excel  | 0.73  | 0.73           | 100.00        |
| Storage/Fixed Equip              | Excel  | 0.73  | 0.73           | 100.00        |
| <b>Restrooms (Student)</b>       | Excel  | 0.89  | 0.89           | 100.00        |
| <b>Administration</b>            | Excel  | 2.56  | 2.56           | 100.00        |
| <b>Counseling</b>                | Good   | 0.23  | 0.29           | 80.00         |
| <b>Clinic</b>                    | Excel  | 0.58  | 0.58           | 100.00        |
| <b>Staff WkRm/Toilets</b>        | Excel  | 1.27  | 1.27           | 100.00        |
| <b>Cafeteria</b>                 | Excel  | 5.00  | 5.00           | 100.00        |
| <b>Food Service and Prep</b>     | Excel  | 6.20  | 6.20           | 100.00        |
| <b>Custodial and Maintenance</b> | Excel  | 0.50  | 0.50           | 100.00        |
| <b>Outside</b>                   |        |       |                |               |
| Vehicular Traffic                | Unsat  | 0.00  | 2.00           | 0.00          |
| Pedestrian Traffic               | Good   | 0.78  | 0.97           | 80.00         |
| Parking                          | Excel  | 0.81  | 0.81           | 100.00        |
| Play Areas                       | Excel  | 2.34  | 2.34           | 100.00        |

Project #: 12382

County: Atlanta Public Schools

Site #: 5567

Project: APS Assessments 2019

Region: 761

Site: Toomer ES

Grade Config: PK-5

Site Type: Elementary

Site Size: 11.00

| Suitability                | Rating | Score        | Possible Score | Percent Score |
|----------------------------|--------|--------------|----------------|---------------|
| <b>Safety and Security</b> |        |              |                |               |
| Fencing                    | Unsat  | 0.00         | 0.75           | 0.00          |
| Signage & Way Finding      | Poor   | 0.50         | 1.00           | 50.00         |
| Ease of Supervision        | Good   | 2.40         | 3.00           | 80.00         |
| Controlled Entrances       | Good   | 0.40         | 0.50           | 80.00         |
| <b>Total For Site:</b>     |        | <b>81.67</b> | <b>94.05</b>   | <b>86.84</b>  |

Comments

## Suitability - ES

Fred A. Toomer Elementary is a K-5 Title I School. It was built in 1968, and serves families in Atlanta's Kirkwood and Edgewood neighborhoods.

## Suitability - ES-&gt;General Classrooms--&gt;Size

One-third of the classrooms are below the size standard.

## Suitability - ES-&gt;Self-Contained Special Ed--&gt;Storage/Fixed Equip

The self-contained special education space did not have a shower, or an ADA accessible restroom.

## Suitability - ES-&gt;Science--&gt;Environment

The school does not have a science space.

## Suitability - ES-&gt;Science--&gt;Size

The school does not have a science space.

## Suitability - ES-&gt;Science--&gt;Location

The school does not have a science space.

## Suitability - ES-&gt;Science--&gt;Storage/Fixed Equip

The school does not have a science space.

## Suitability - ES-&gt;Music--&gt;Storage/Fixed Equip

The music room does not have adequate storage space for instruments or other equipment.

## Suitability - ES-&gt;Art--&gt;Storage/Fixed Equip

There is only one sink and there is no clay trap.

## Suitability - ES-&gt;Outside--&gt;Vehicular Traffic

There are not a separate bus and car ride lanes at the school.

## Suitability - ES-&gt;Safety and Security--&gt;Fencing

There is no fencing around the school.

## Suitability - ES-&gt;Safety and Security--&gt;Signage &amp; Way Finding

There is limited way-finding signage on the exterior and interior. The entrance announcement sign has only one of the four required elements (no weapons allowed).